

FIRE LANE GUIDELINES

When striping is utilized to mark a designated fire lane, the 6-inch wide red striping must be along the perimeter and contain the words "FIRE LANE NO PARKING" in 4-inch high white letters, at 25-foot intervals. (See Illustration 1)

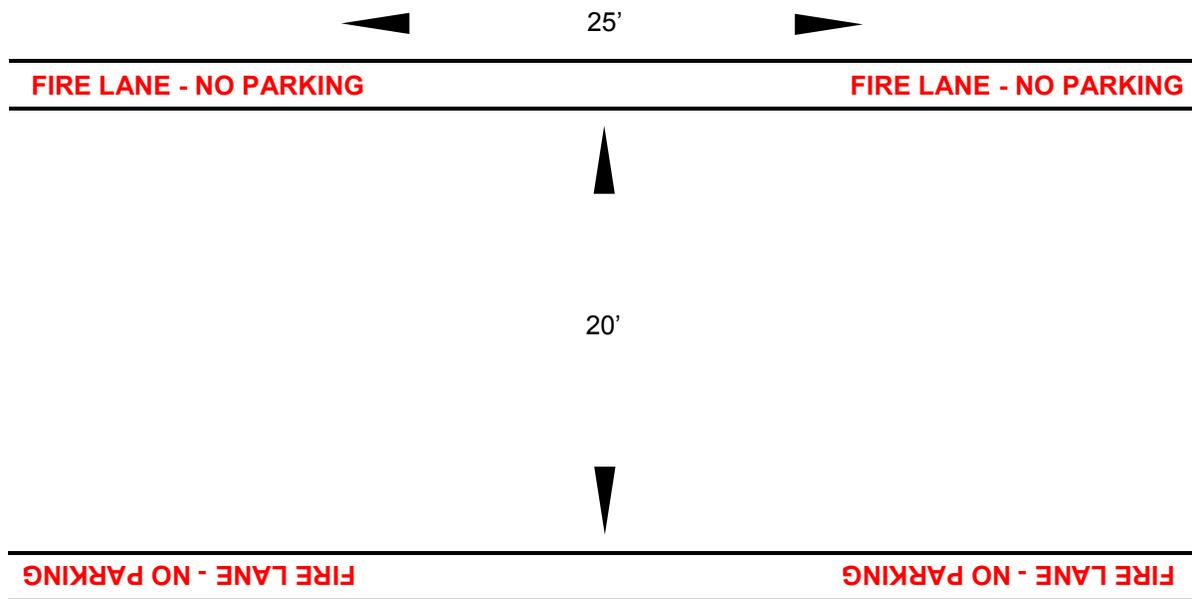


Illustration 1

When signs are utilized to mark designated fire apparatus access roads, the signs shall have 2-inch high red lettering on a white background, reading "FIRE LANE NO PARKING." The signs shall be affixed to stationary posts at no greater than 50-foot intervals along both sides of the fire lane. The bottom of each sign must be 6 feet 6 inches above finished grade. The signs shall have a minimum area of 12 inches by 18 inches.

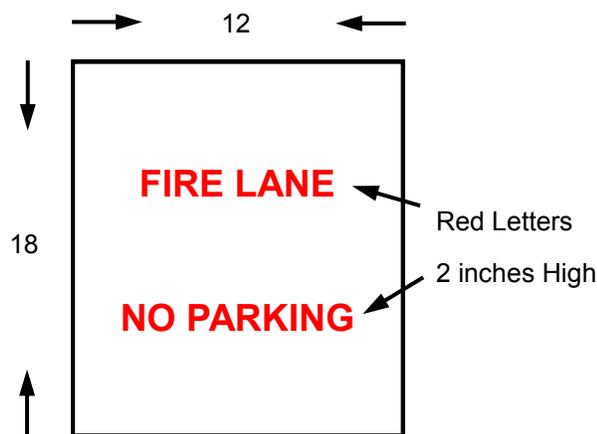


Illustration 2

Designated fire lanes must be kept free of all obstructions likely to interfere with fire department emergency activities. It is the responsibility of the operator of premises having a fire lane to maintain it in good condition, free of obstruction.