




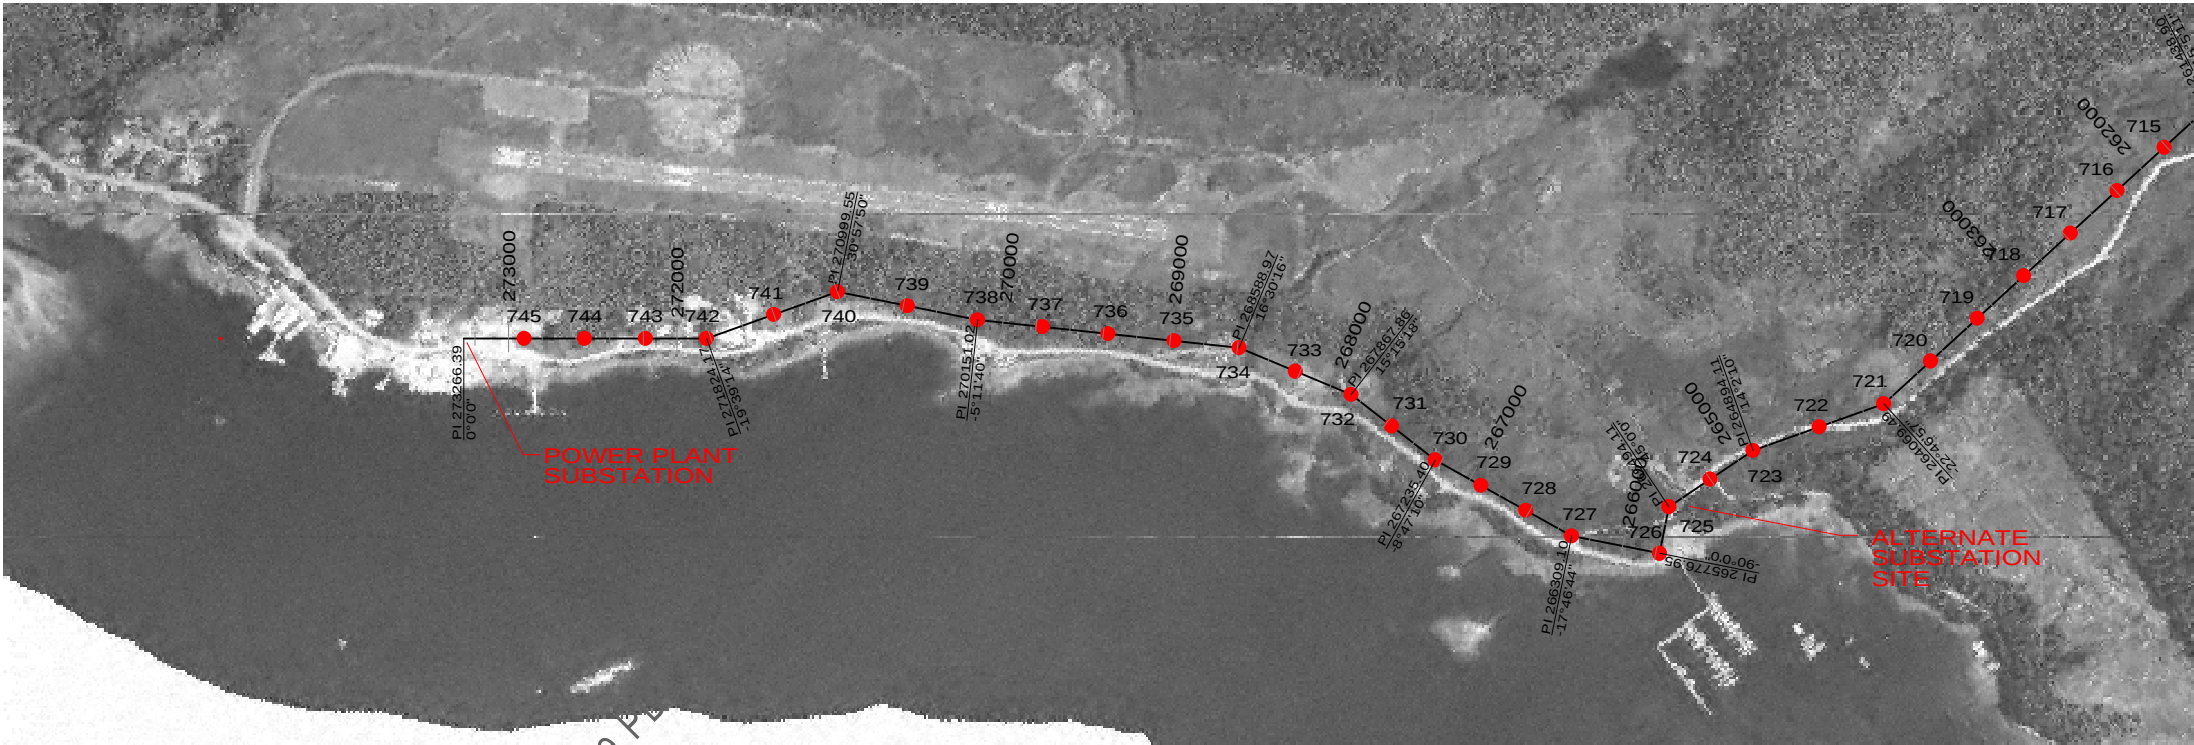


- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

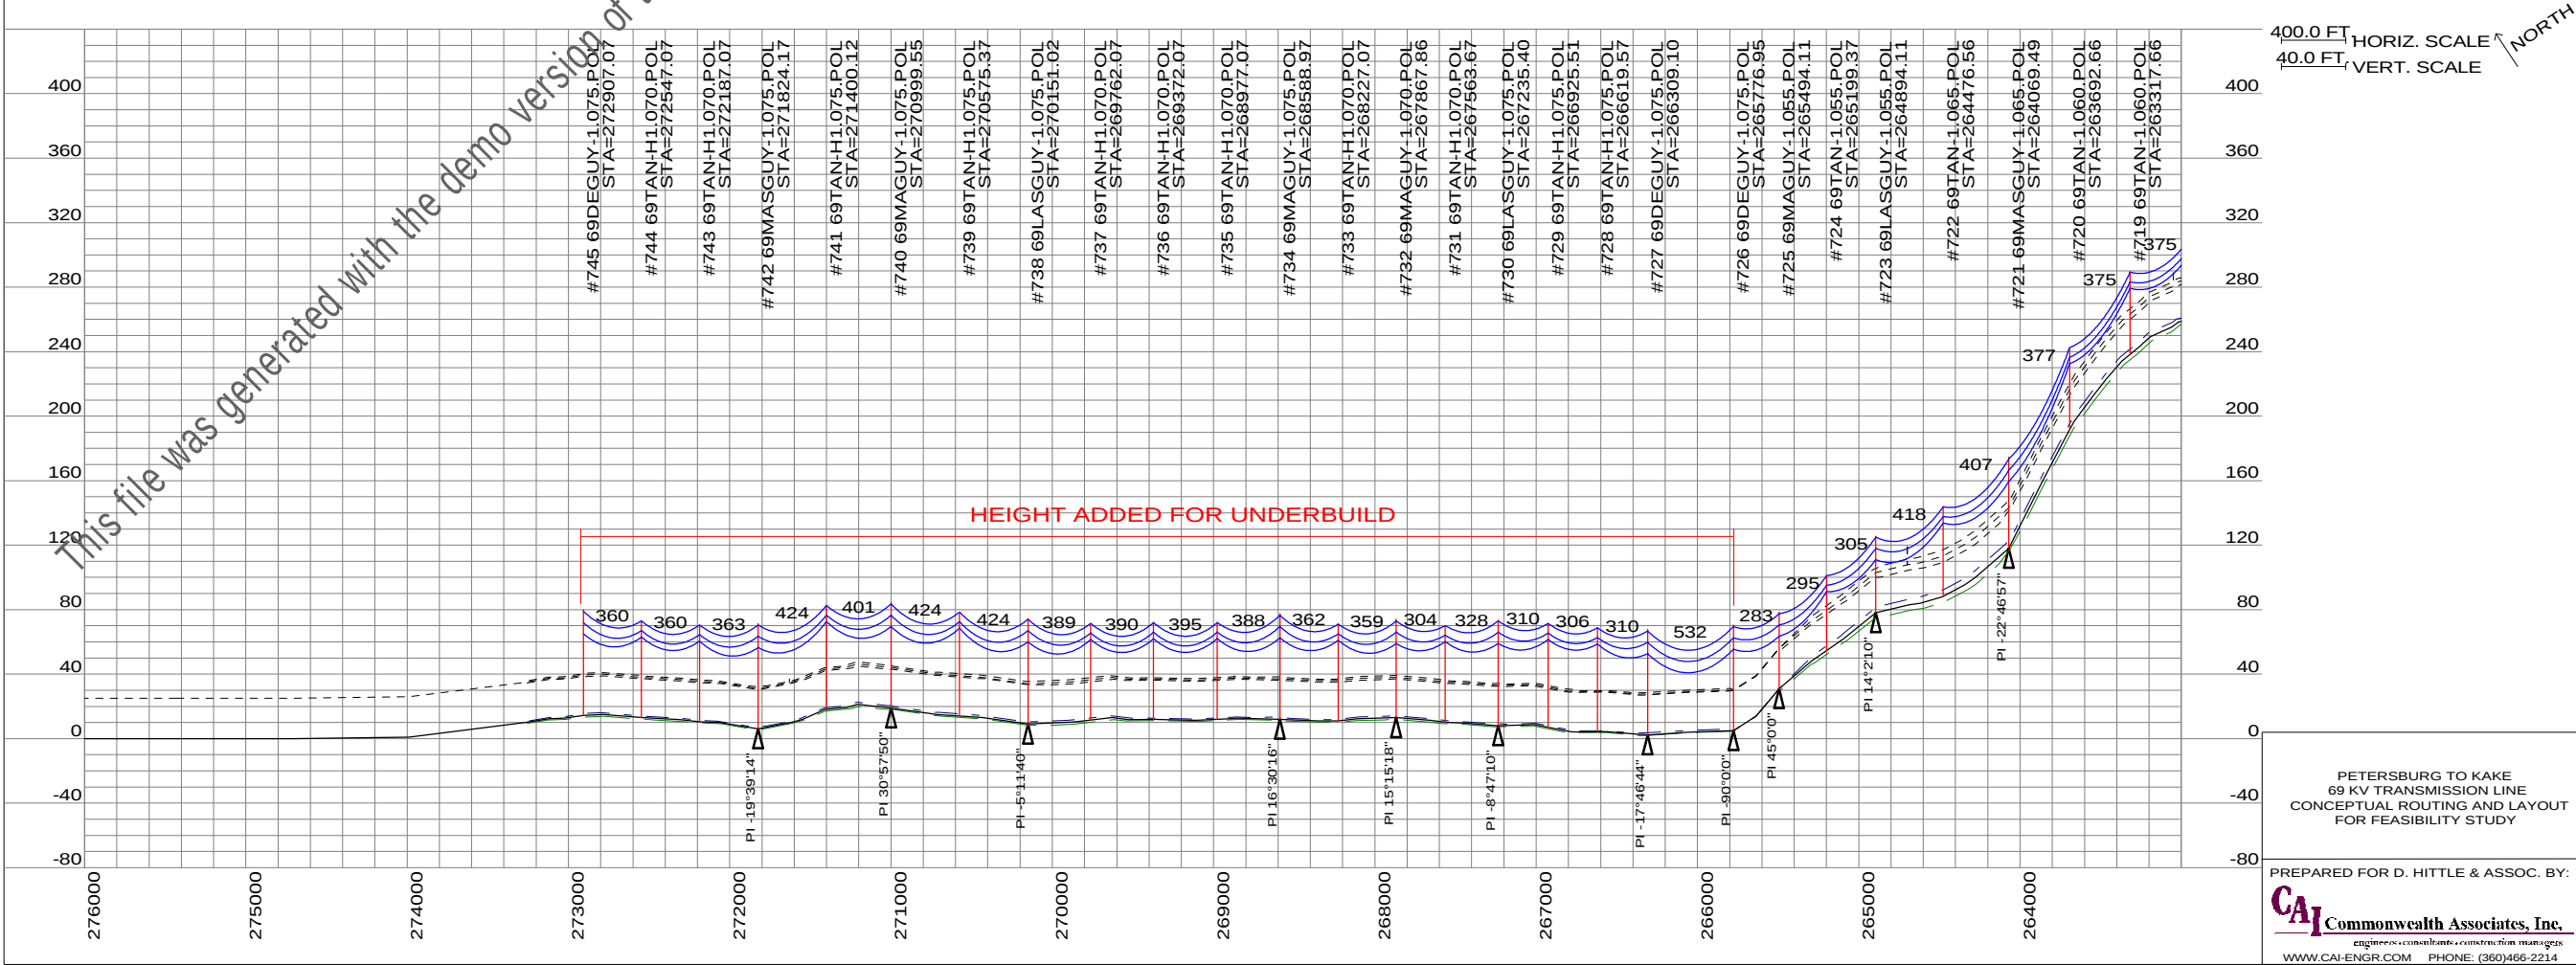

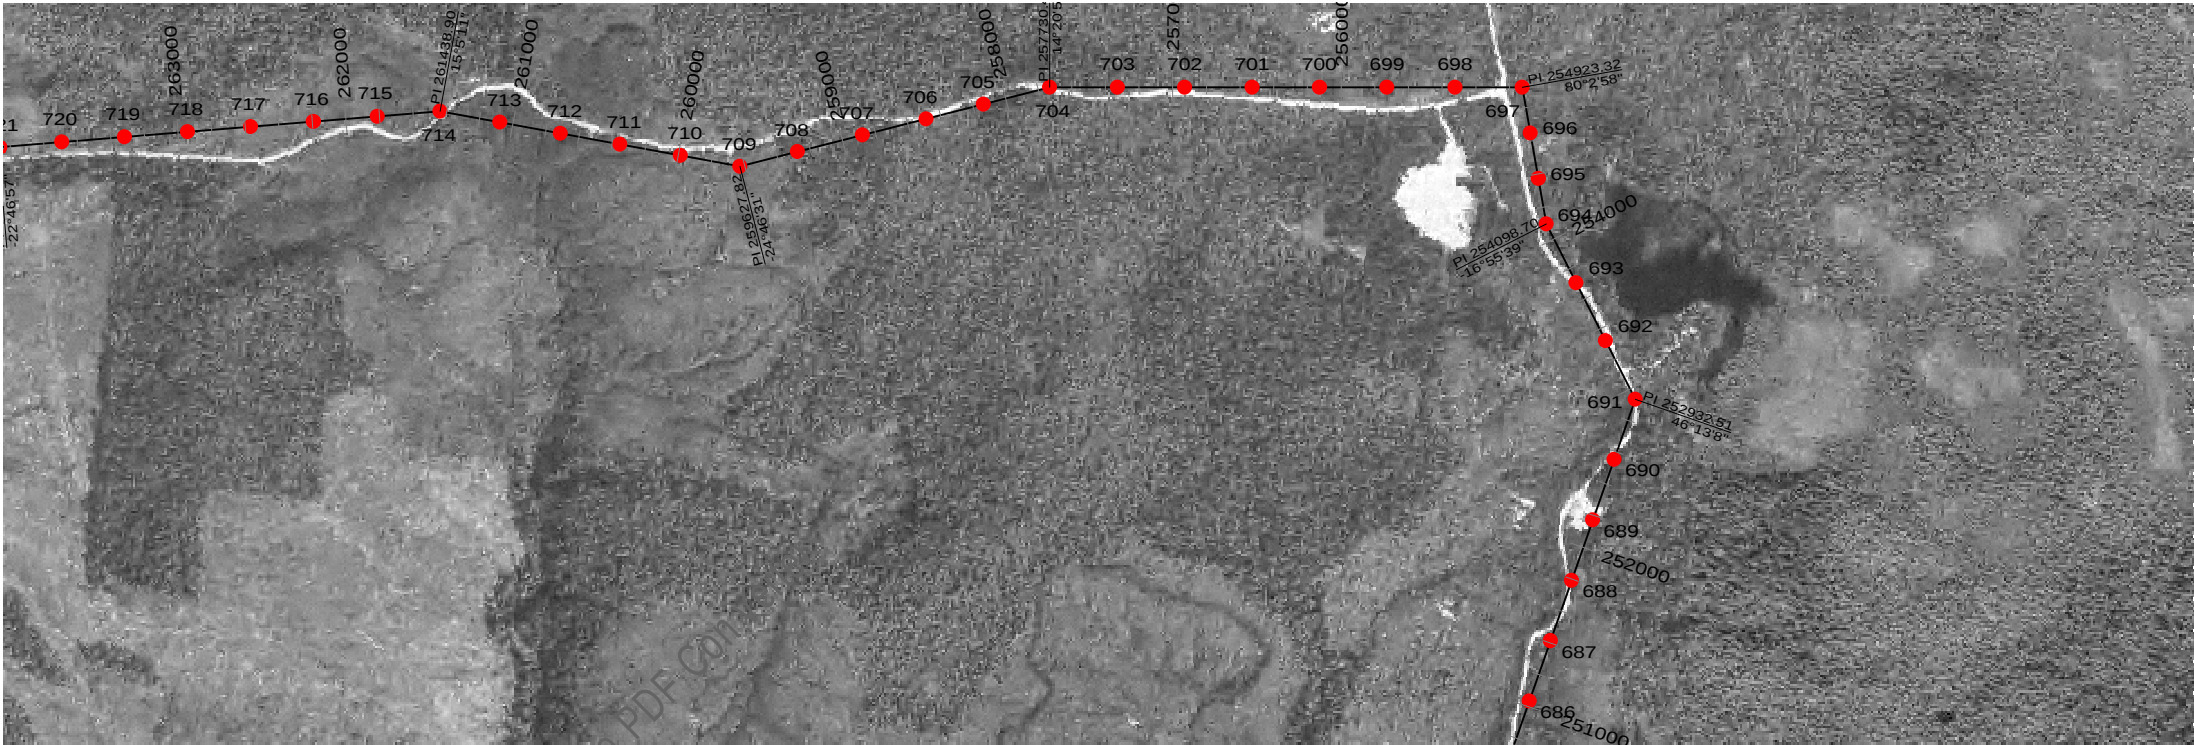

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

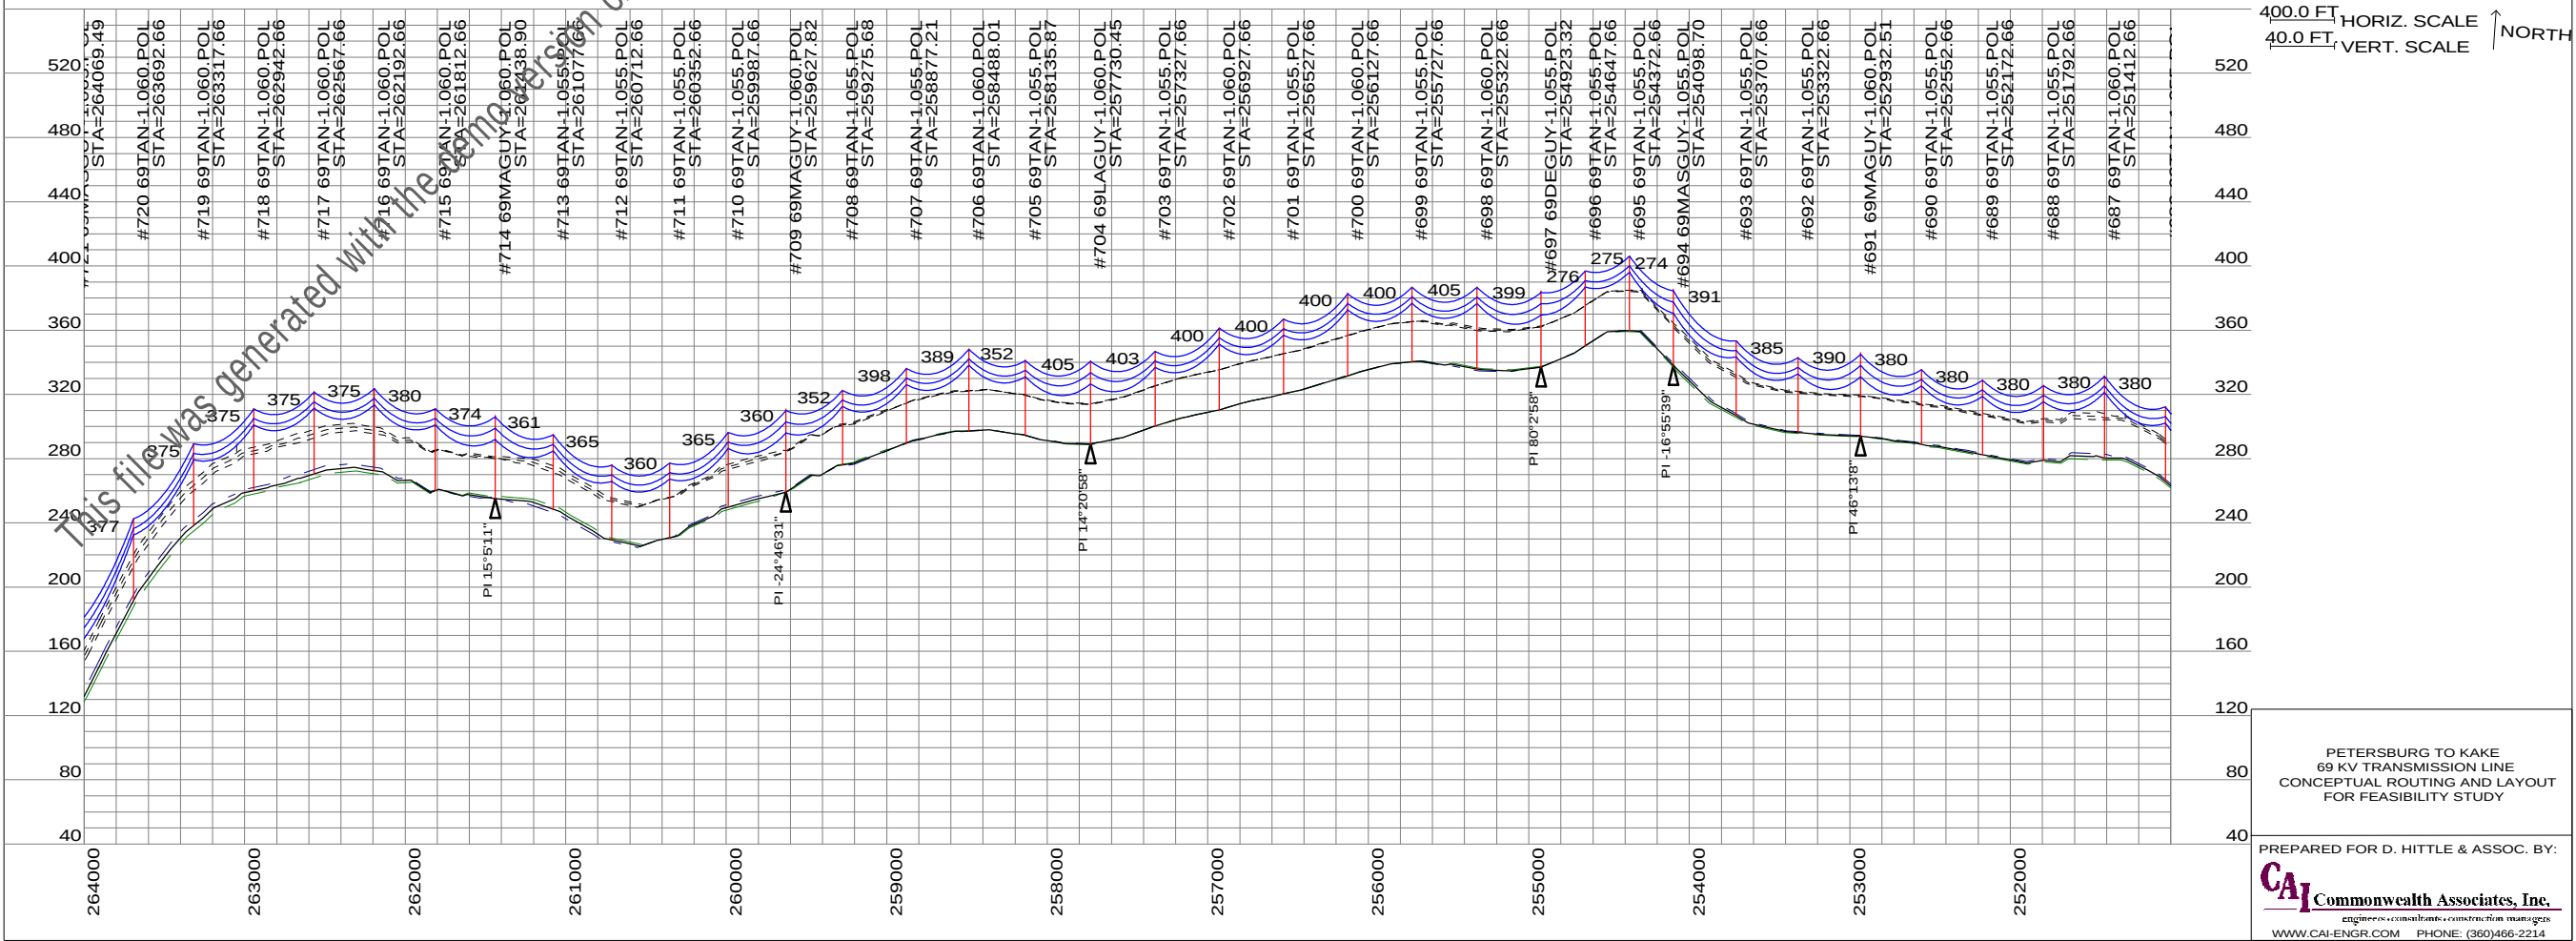



PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY

PREPARED FOR D. HITTLE & ASSOC. BY:

CAI Commonwealth Associates, Inc.
engineers • consultants • construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214

3/27/2023
PAGE 2/23

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

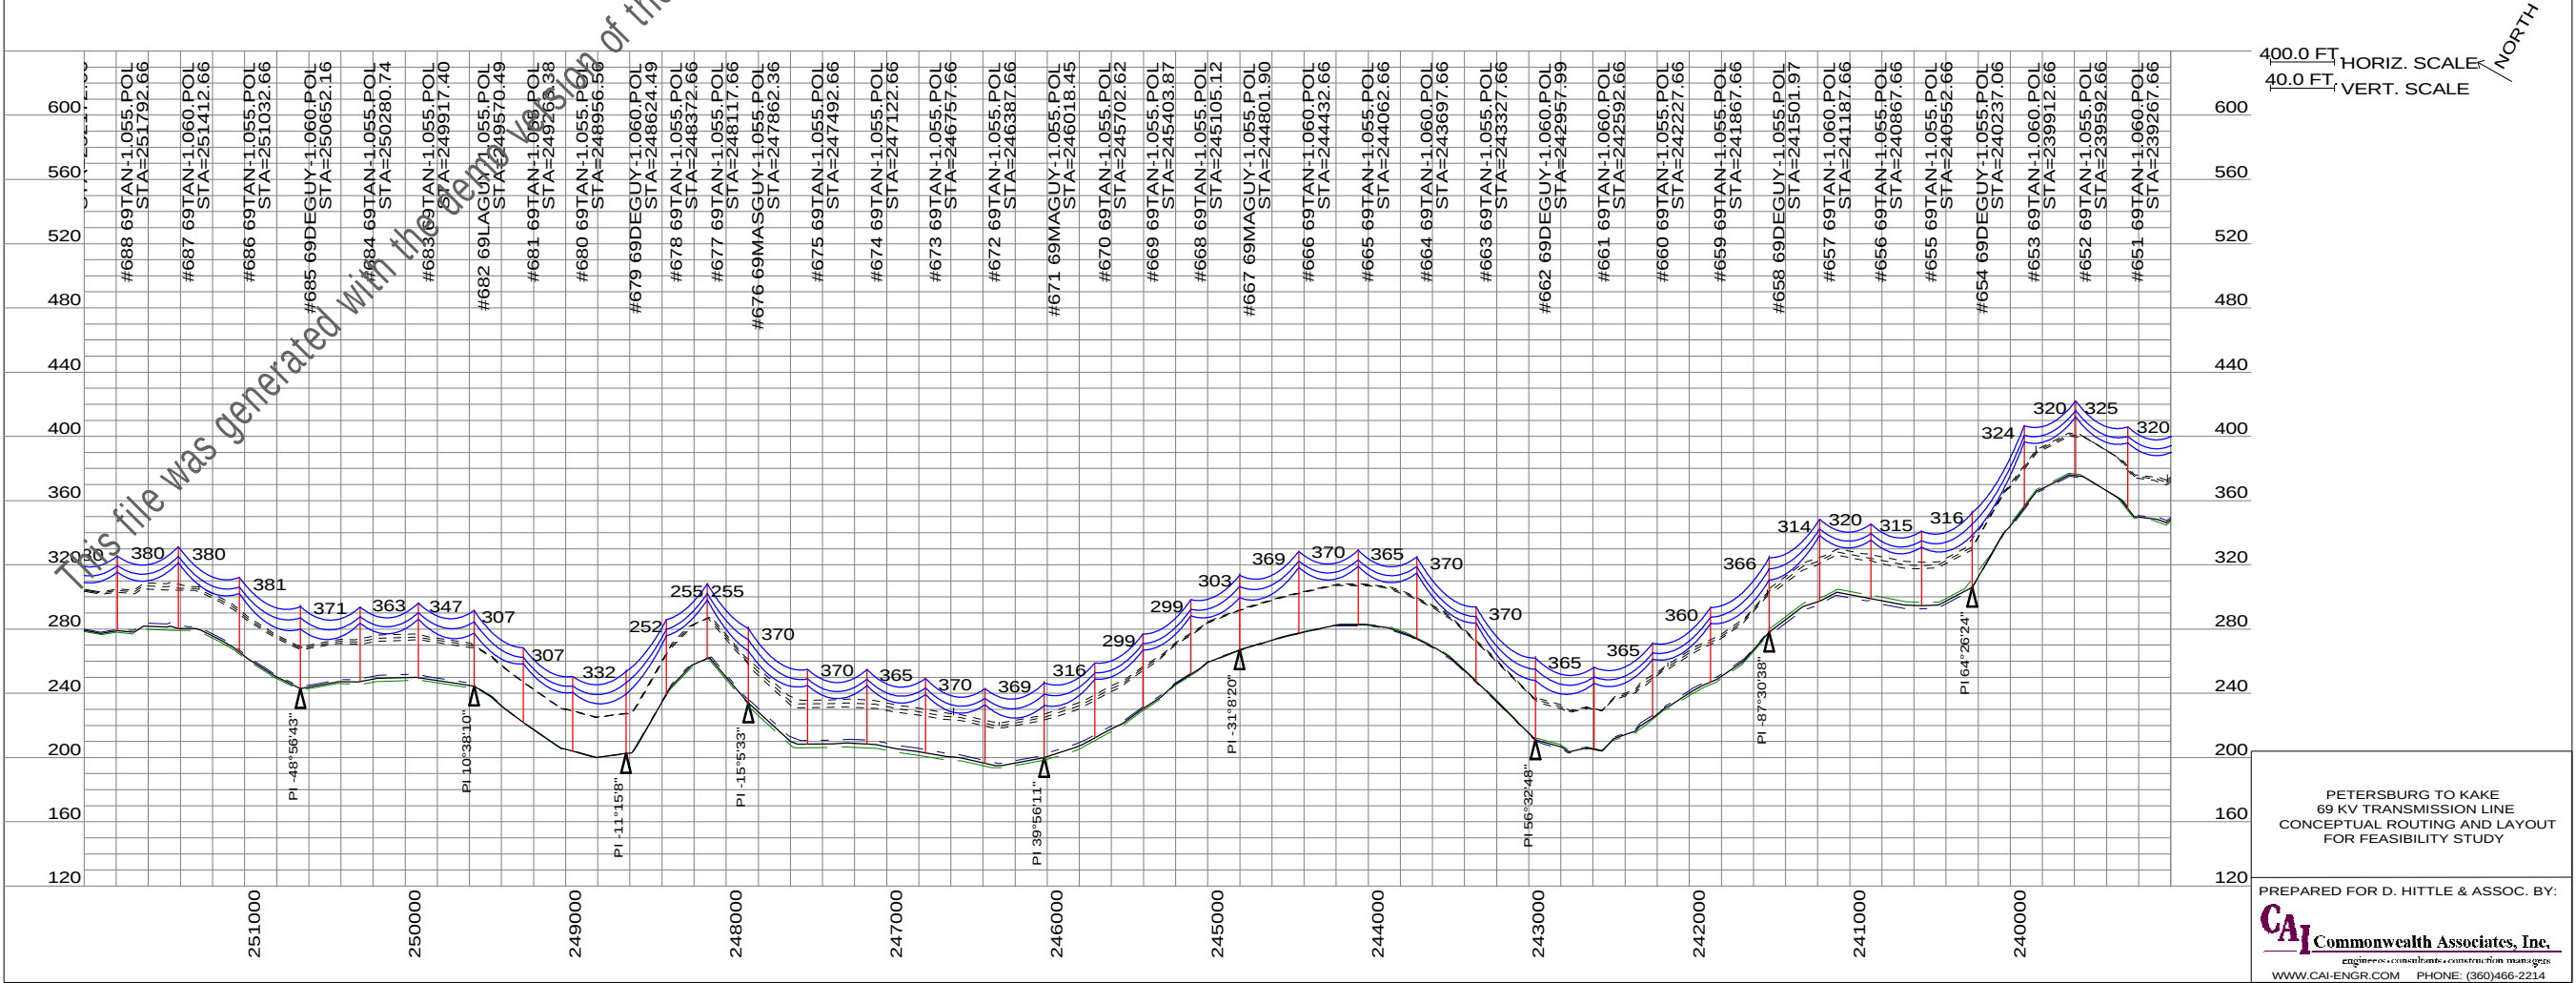
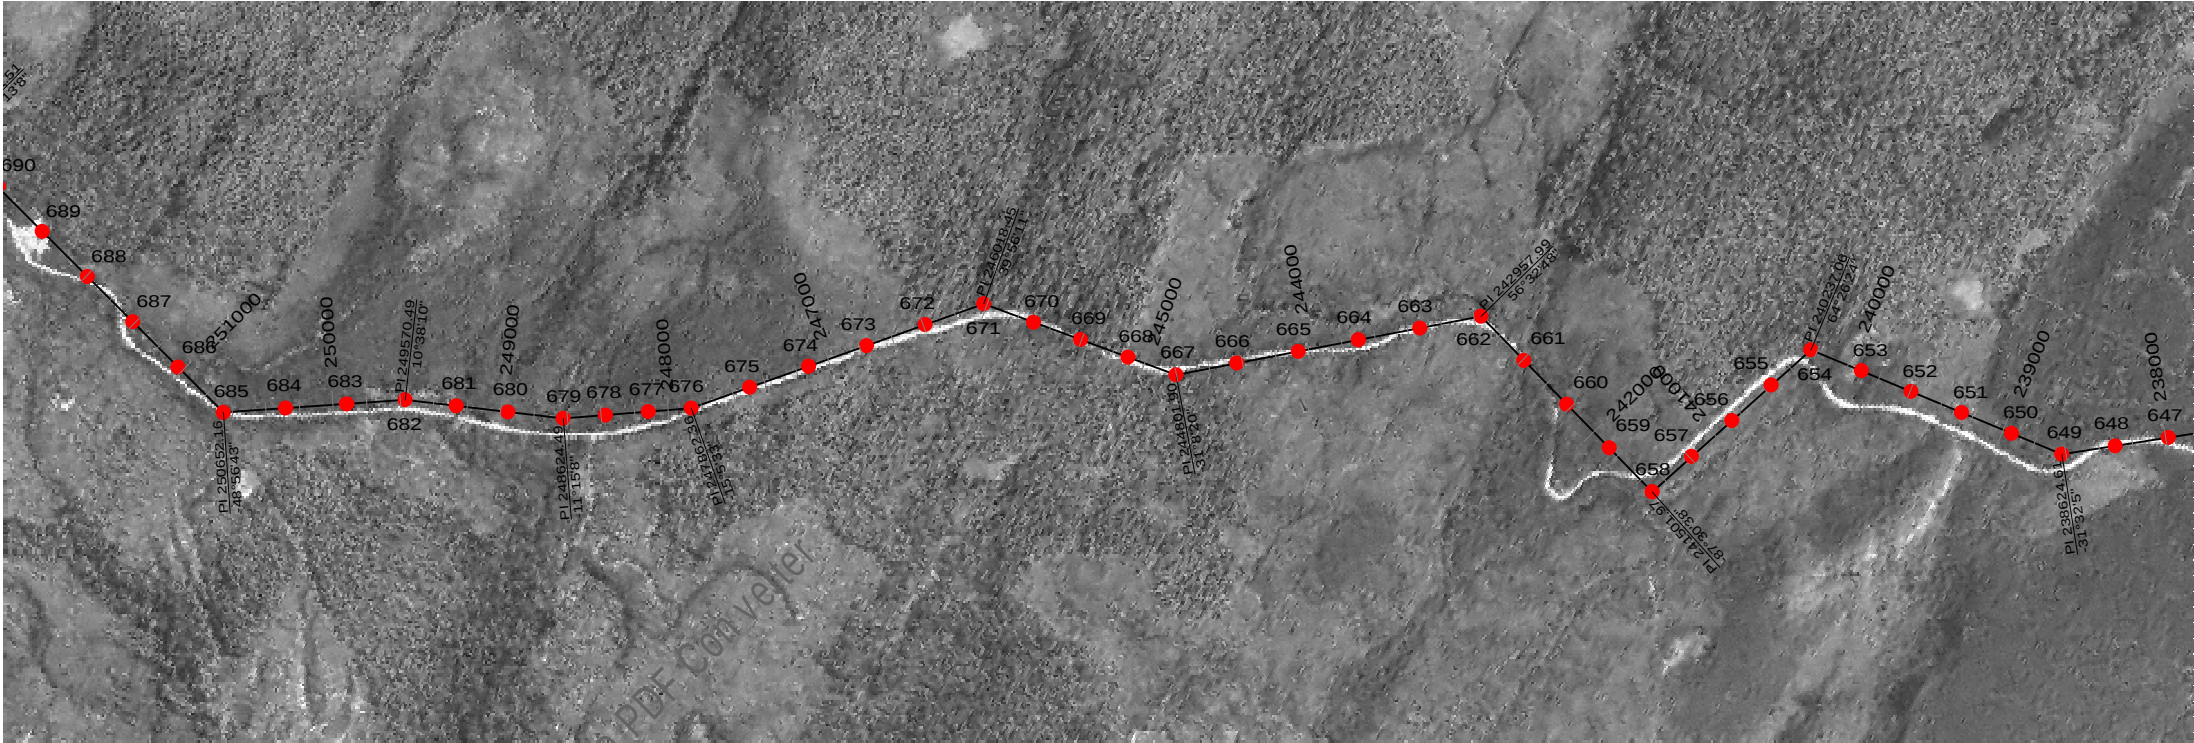


PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY

PREPARED FOR D. HITTLE & ASSOC. BY:

CAI Commonwealth Associates, Inc.
engineers • consultants • construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214


- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

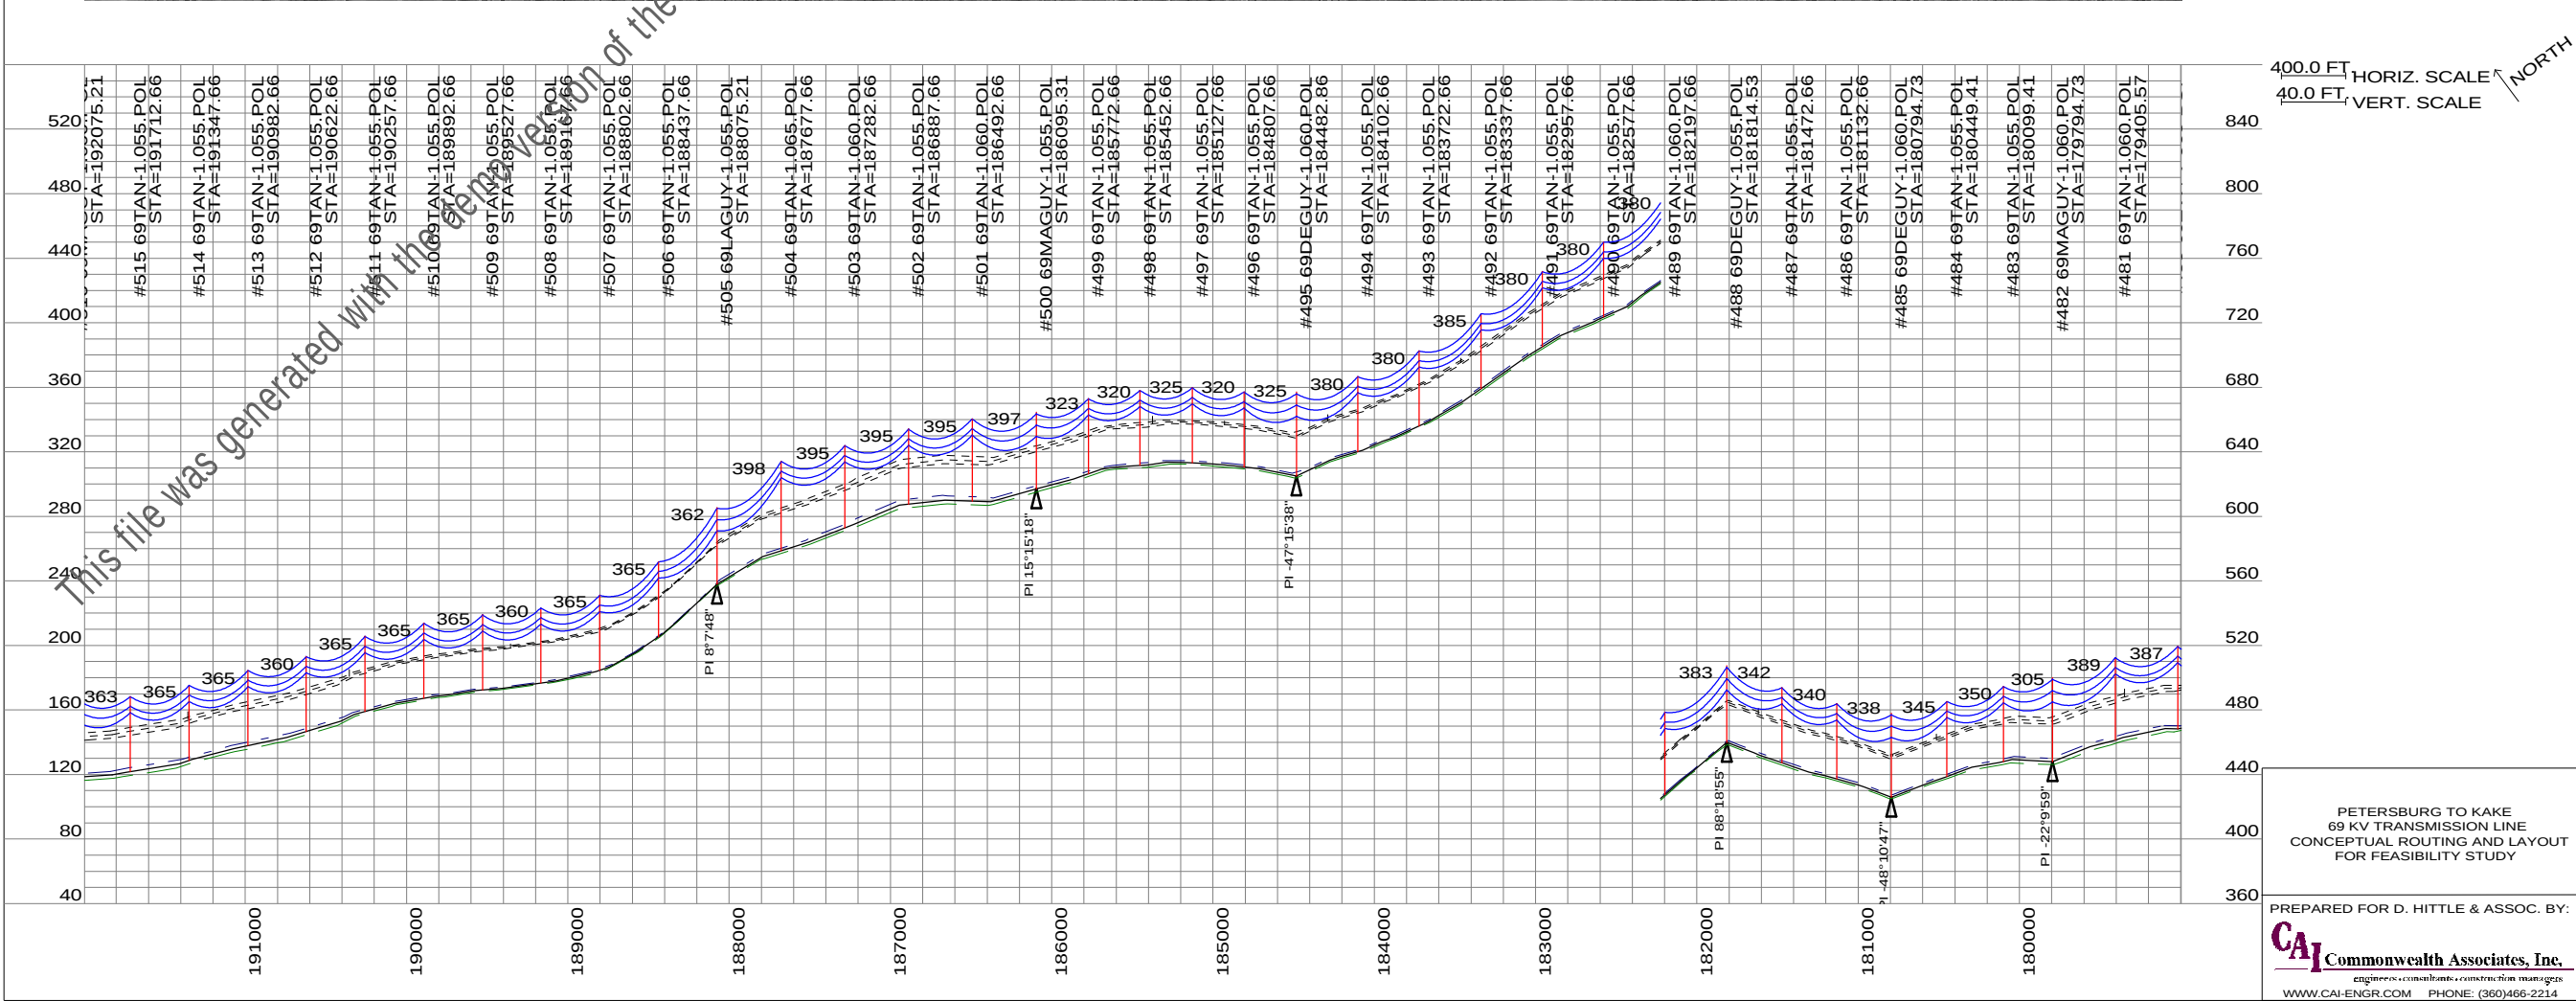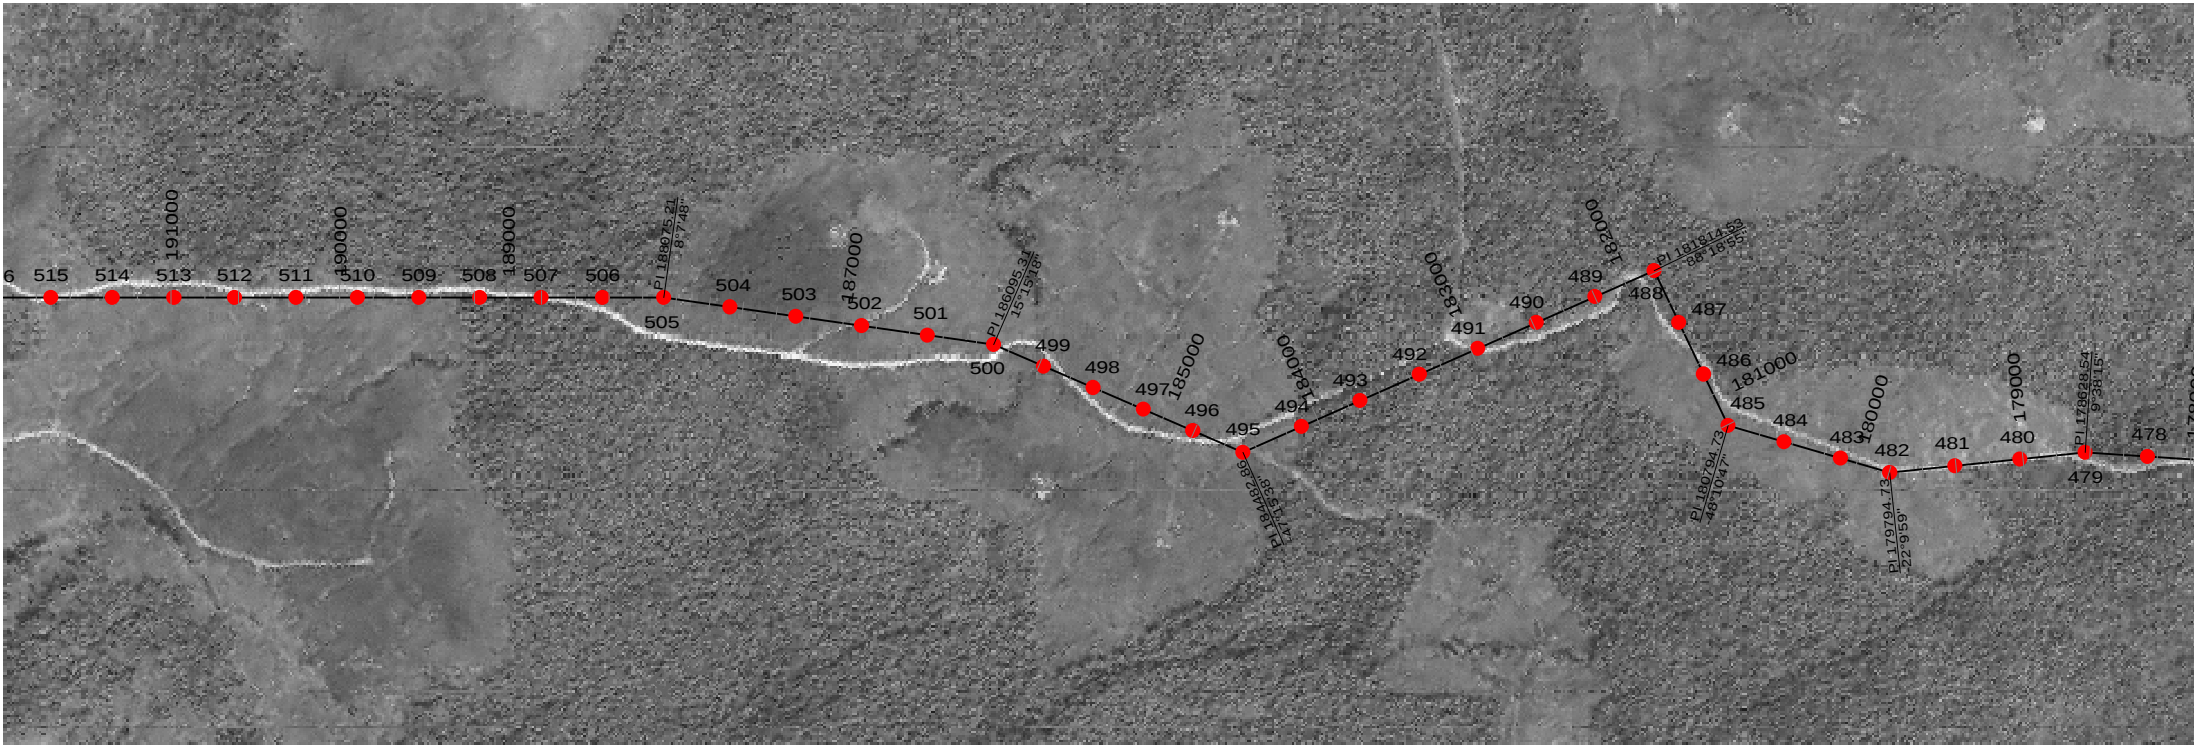


PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY

PREPARED FOR D. HITTLE & ASSOC. BY:

CAI Commonwealth Associates, Inc.
engineers • consultants • construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214

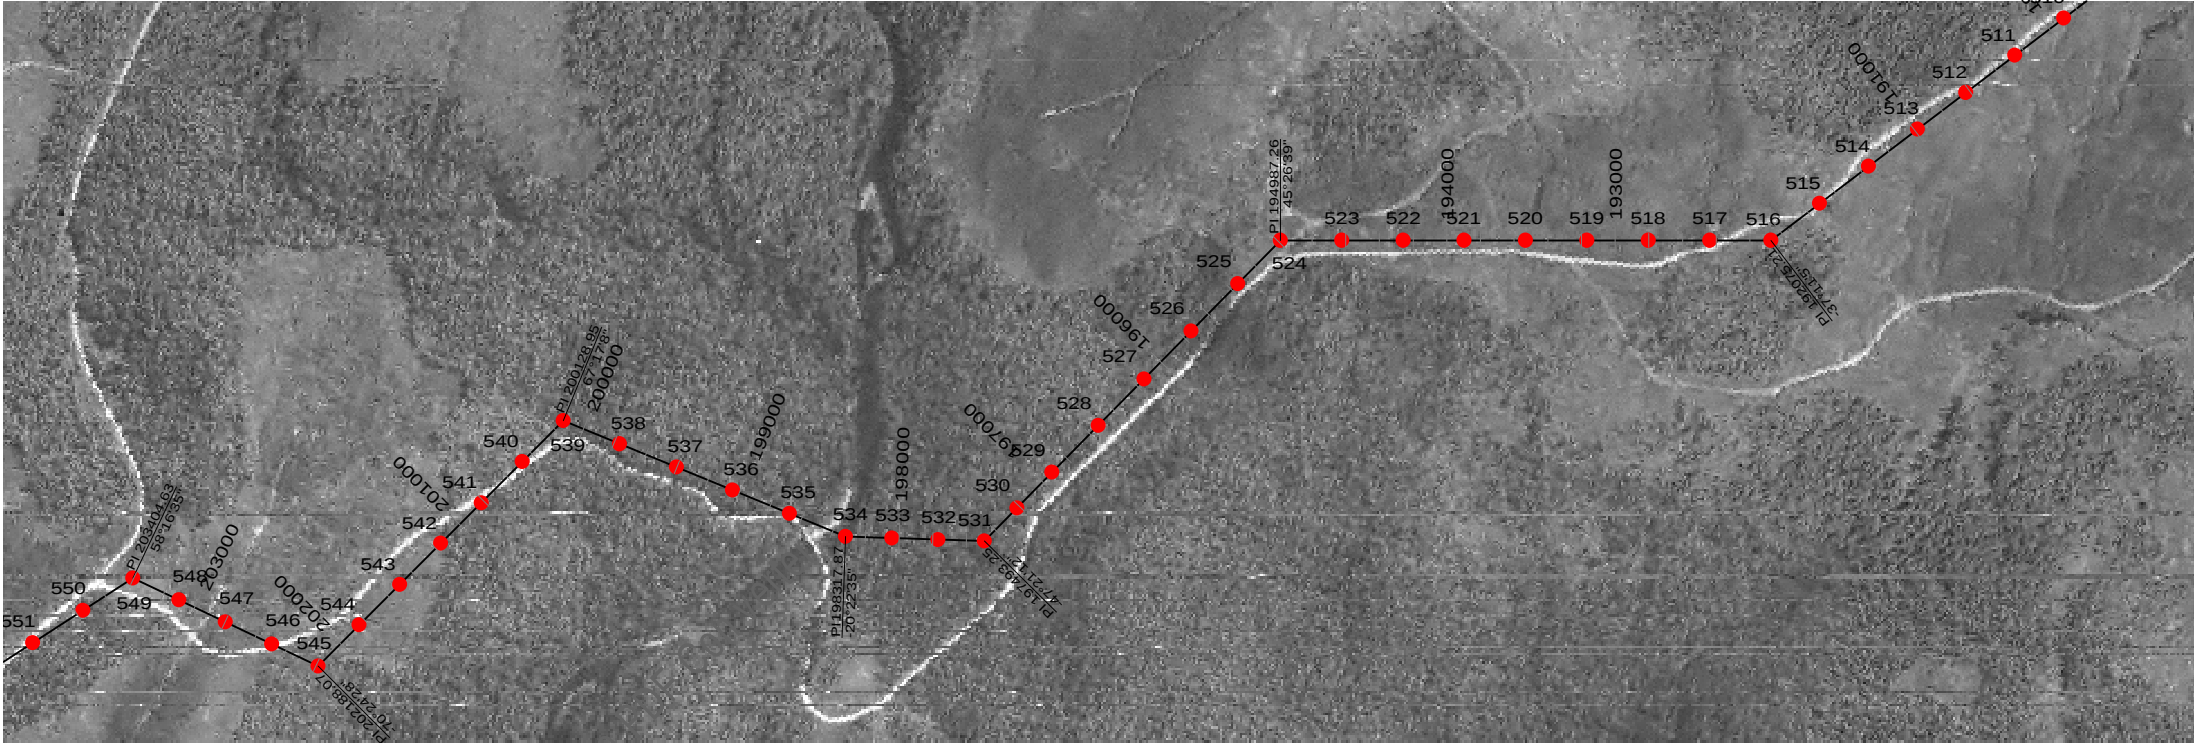

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

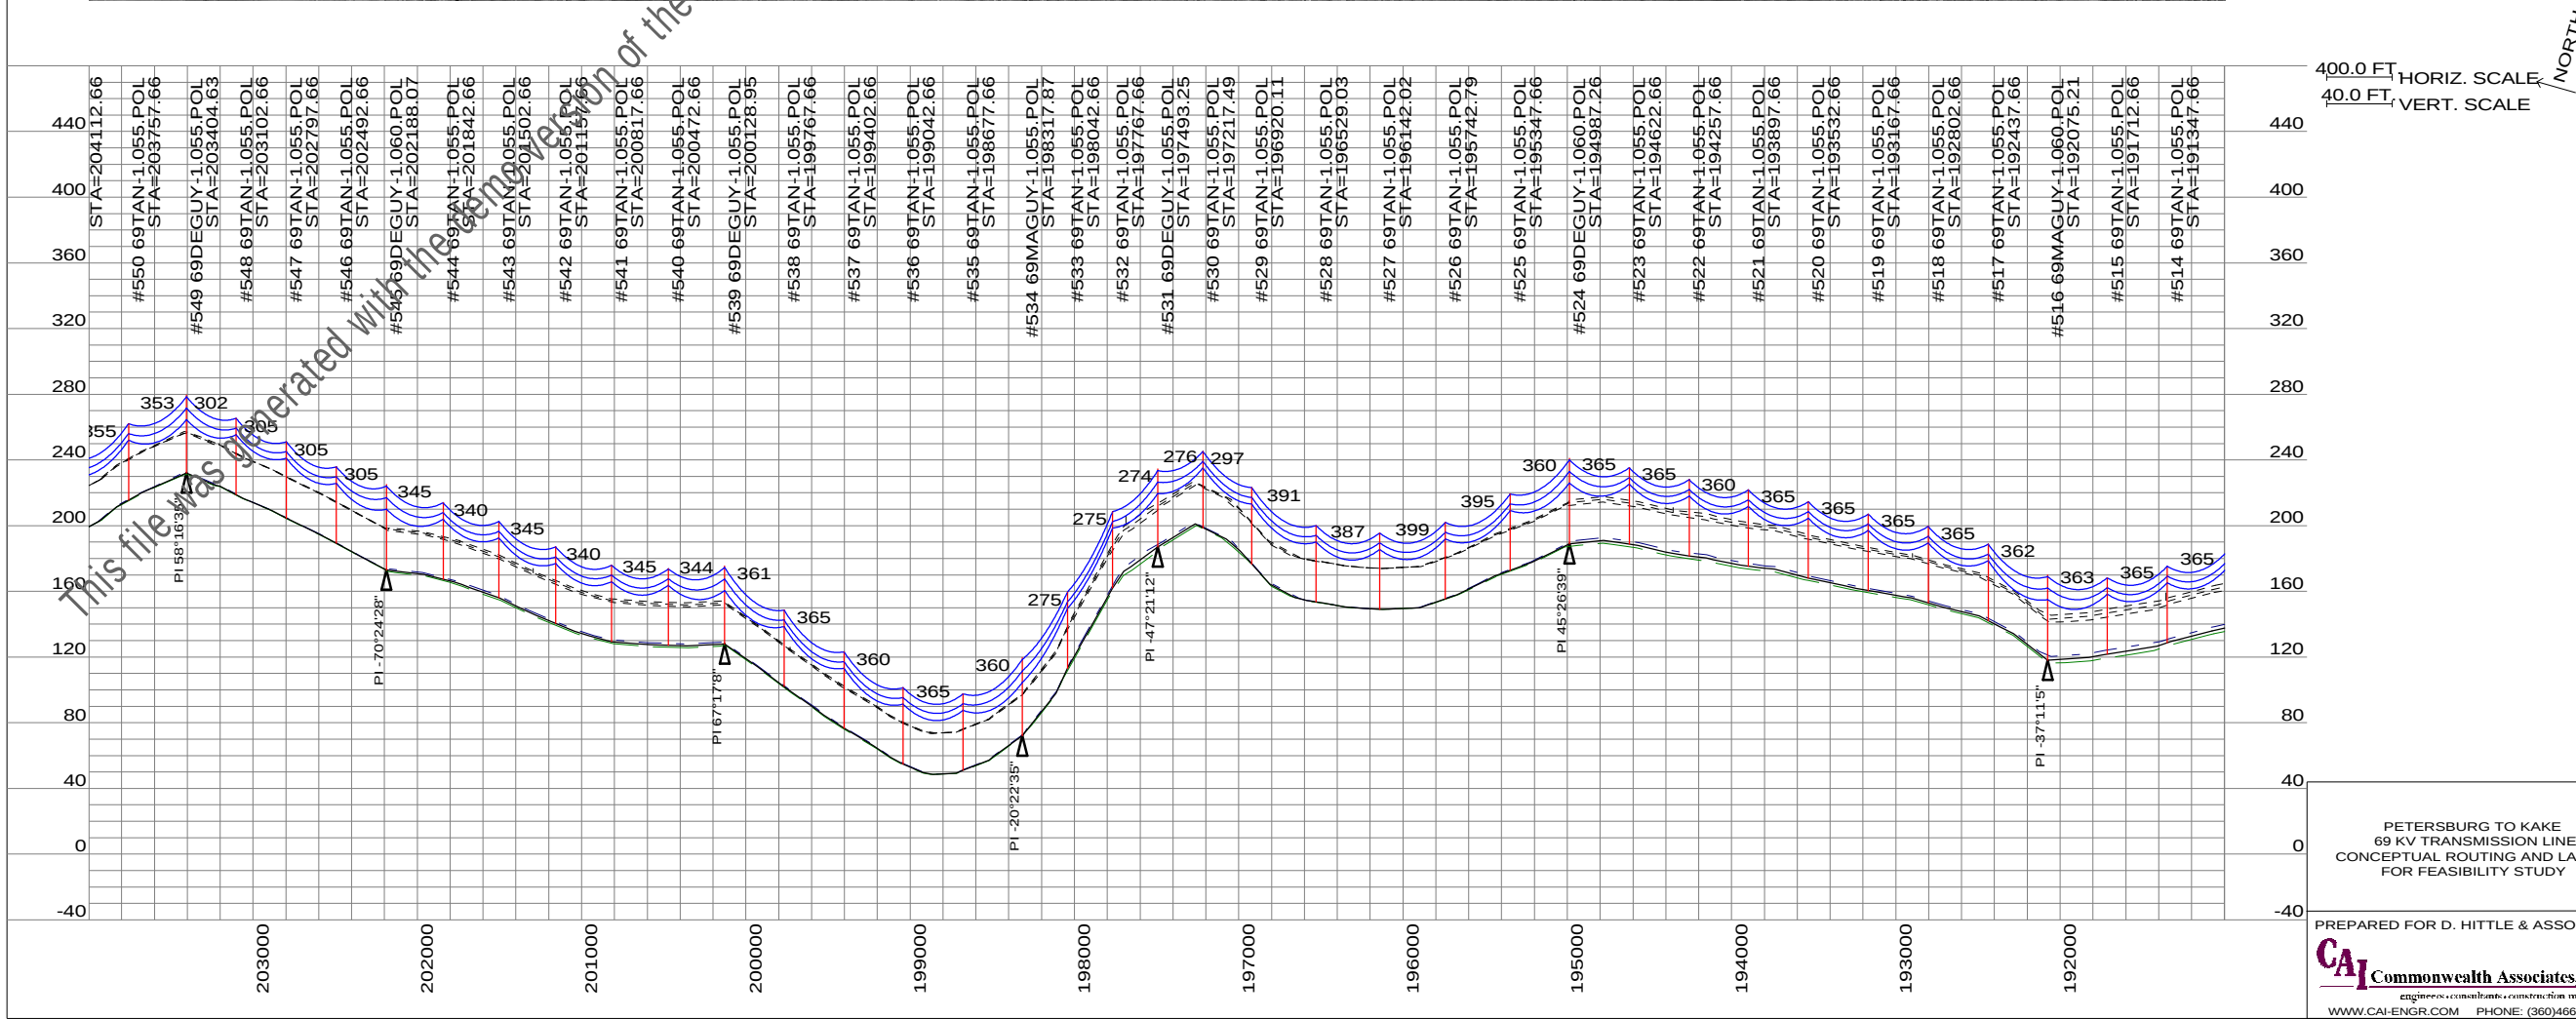

PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY



PREPARED FOR D. HITTLE & ASSOC. BY:


CAI Commonwealth Associates, Inc.
engineers • consultants • construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214

3/27/2023
PAGE 1/23


GENERAL NOTES:


1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
2. DASHED LINE IN PROFILE DENOTES 25" CLEARANCE LINE.

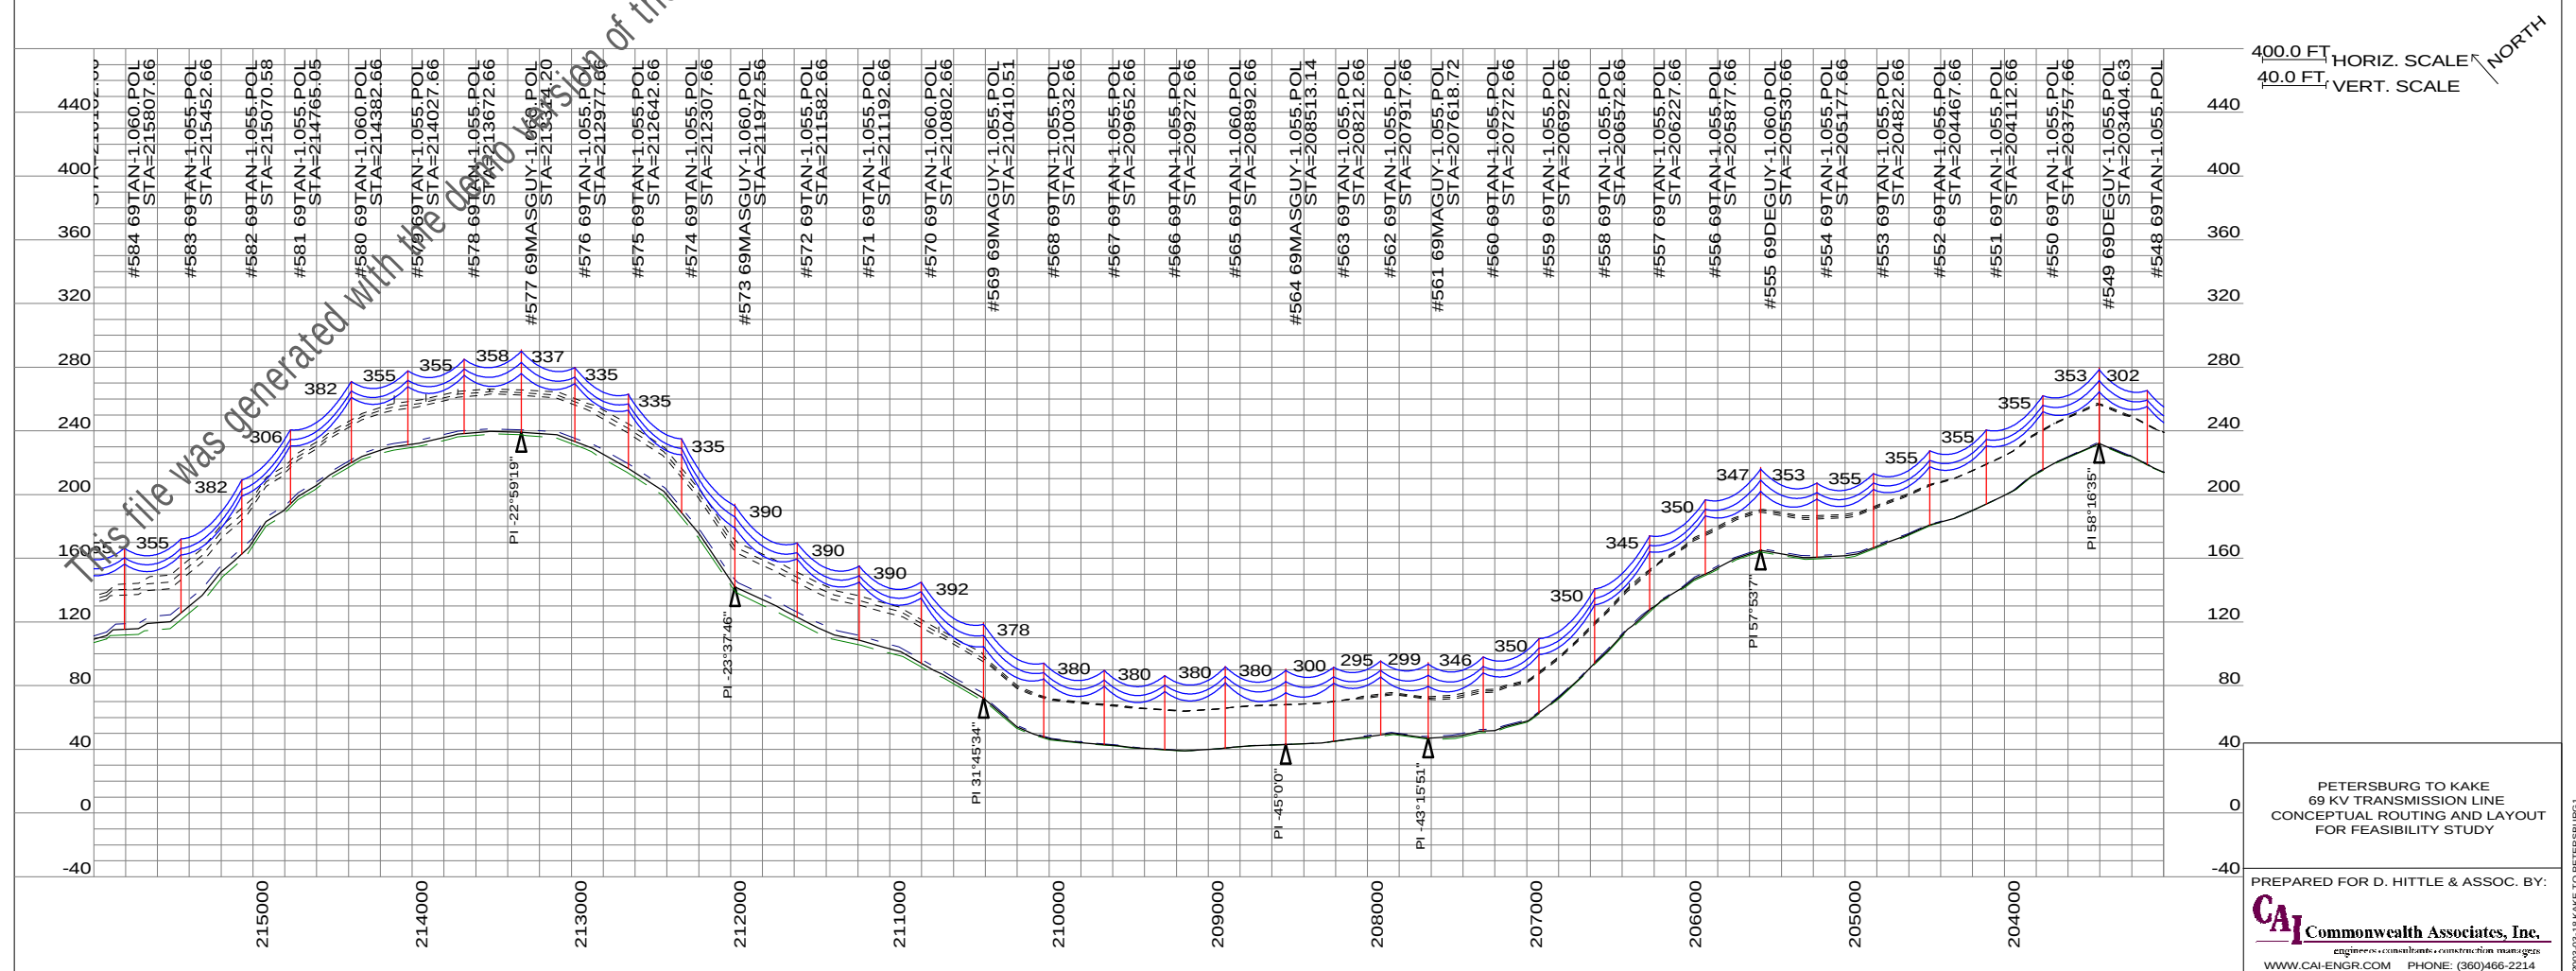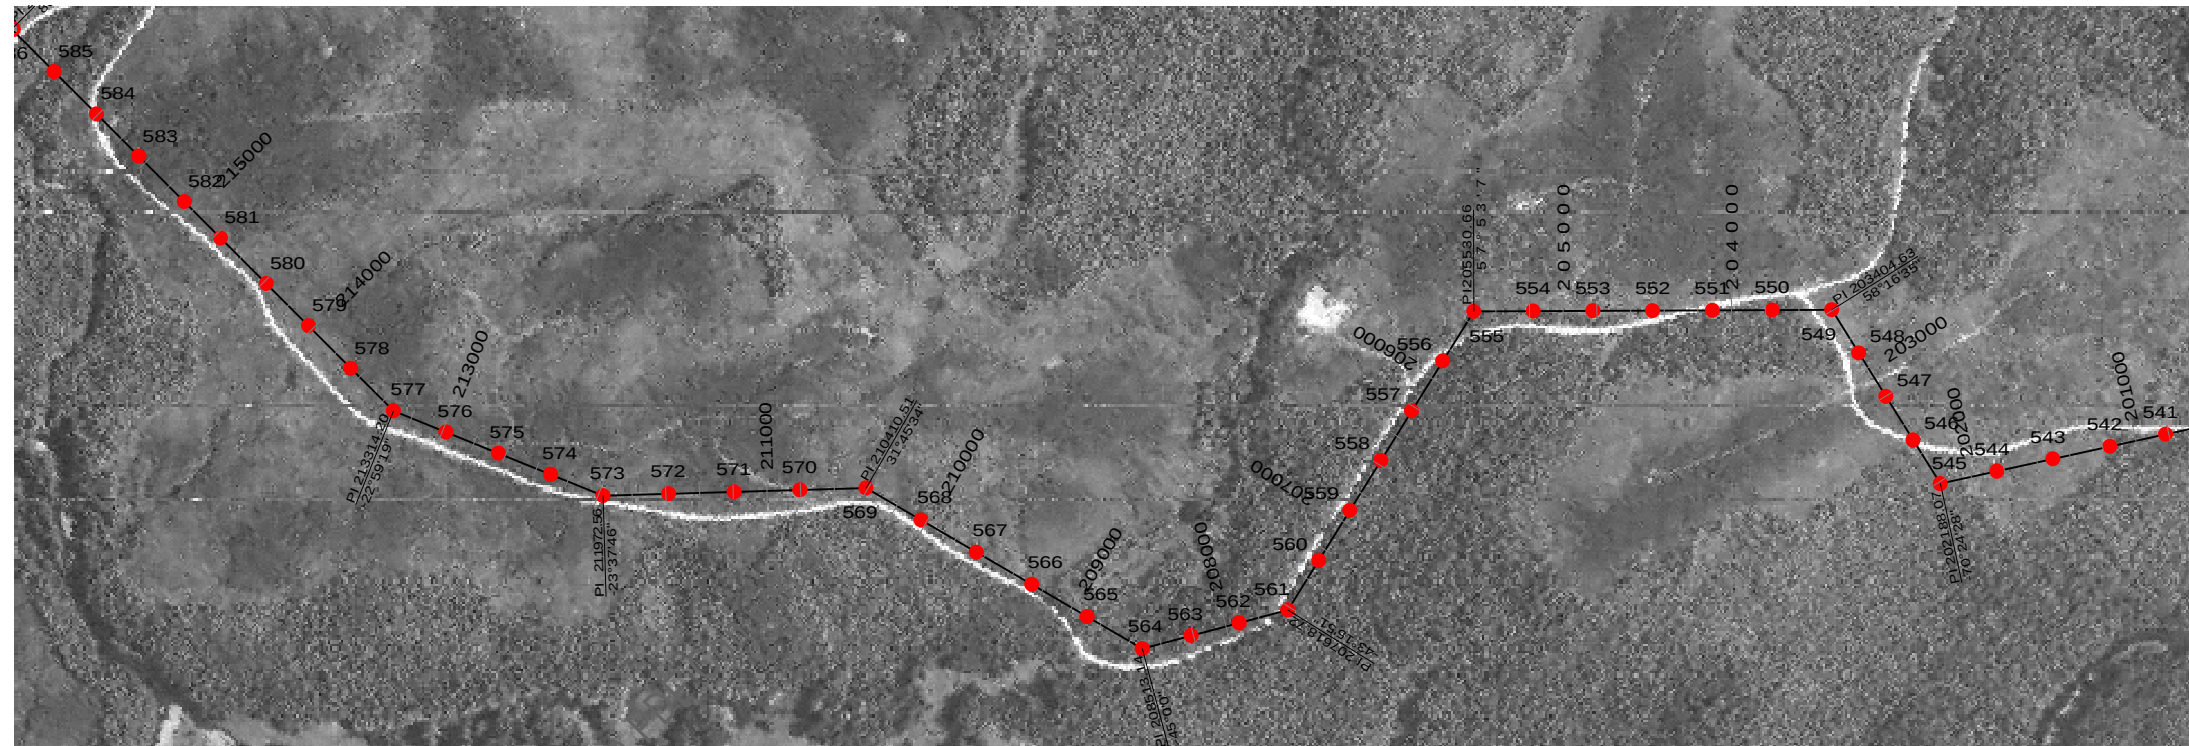

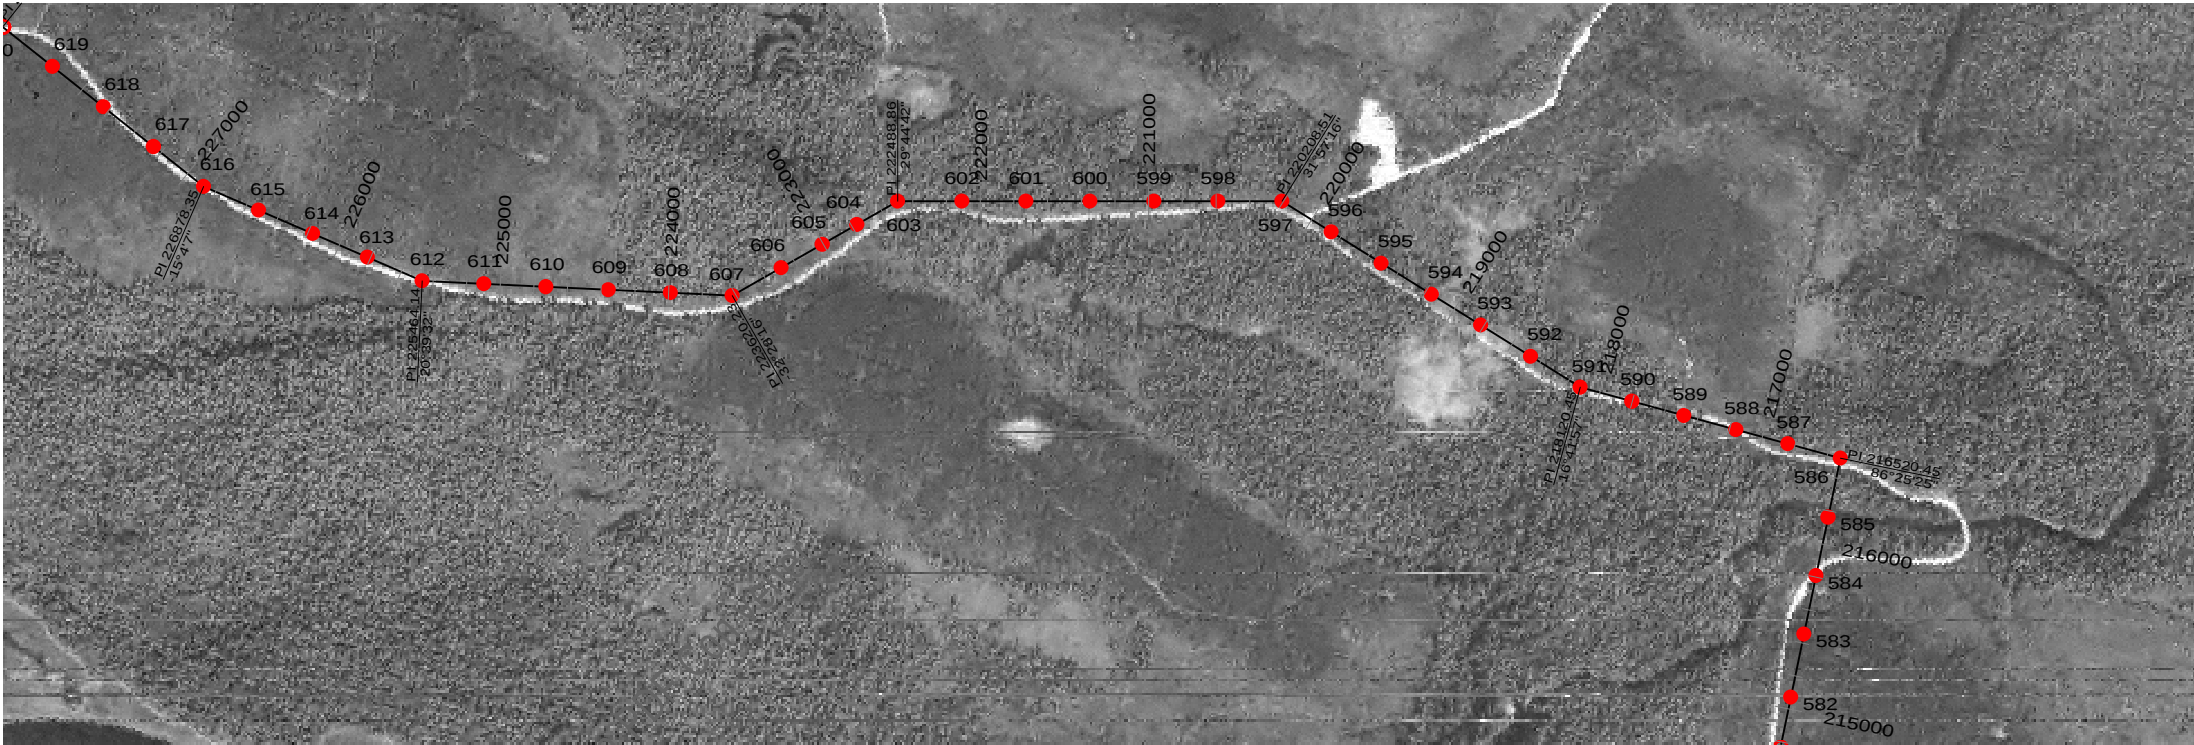


- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

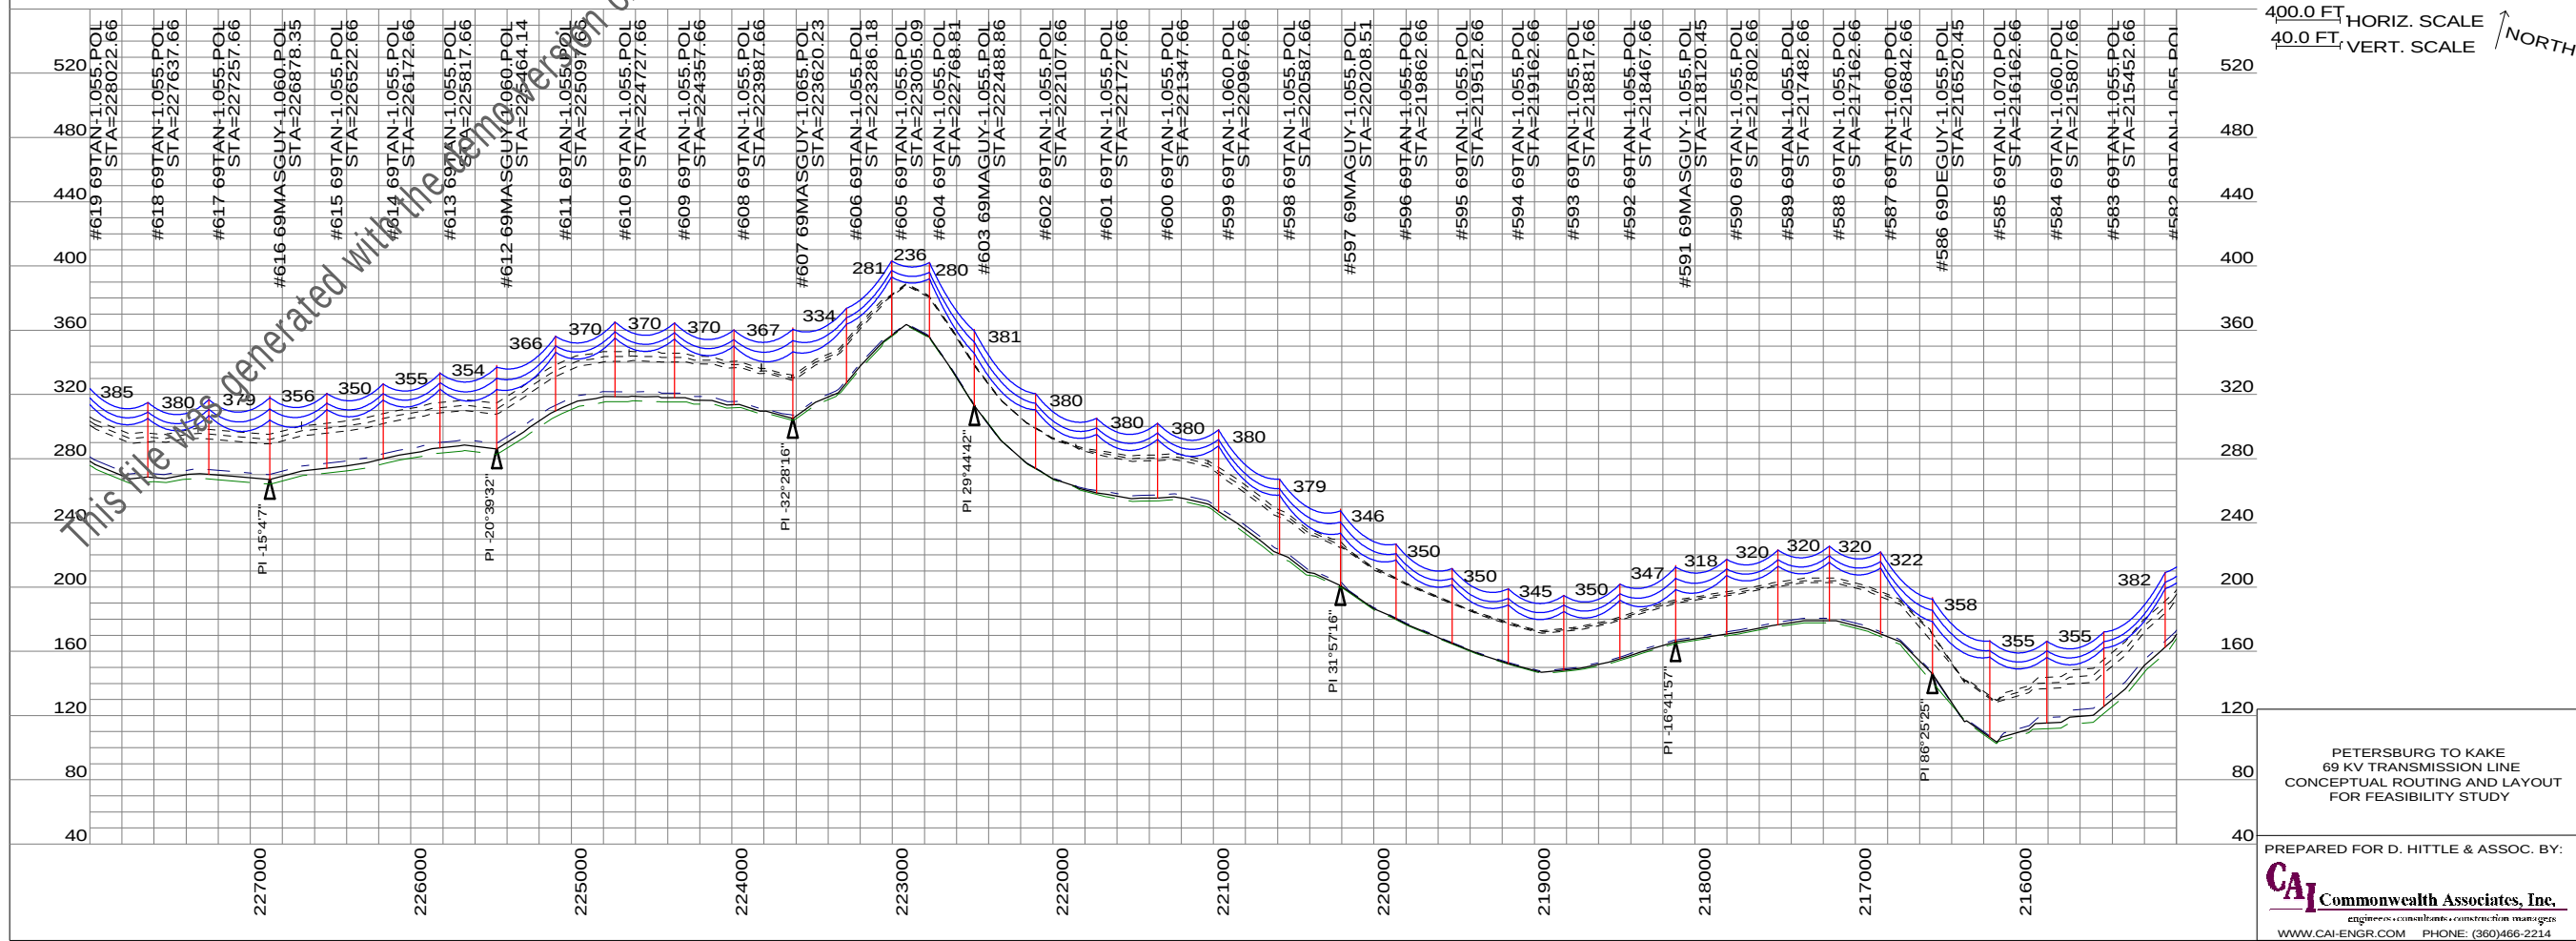

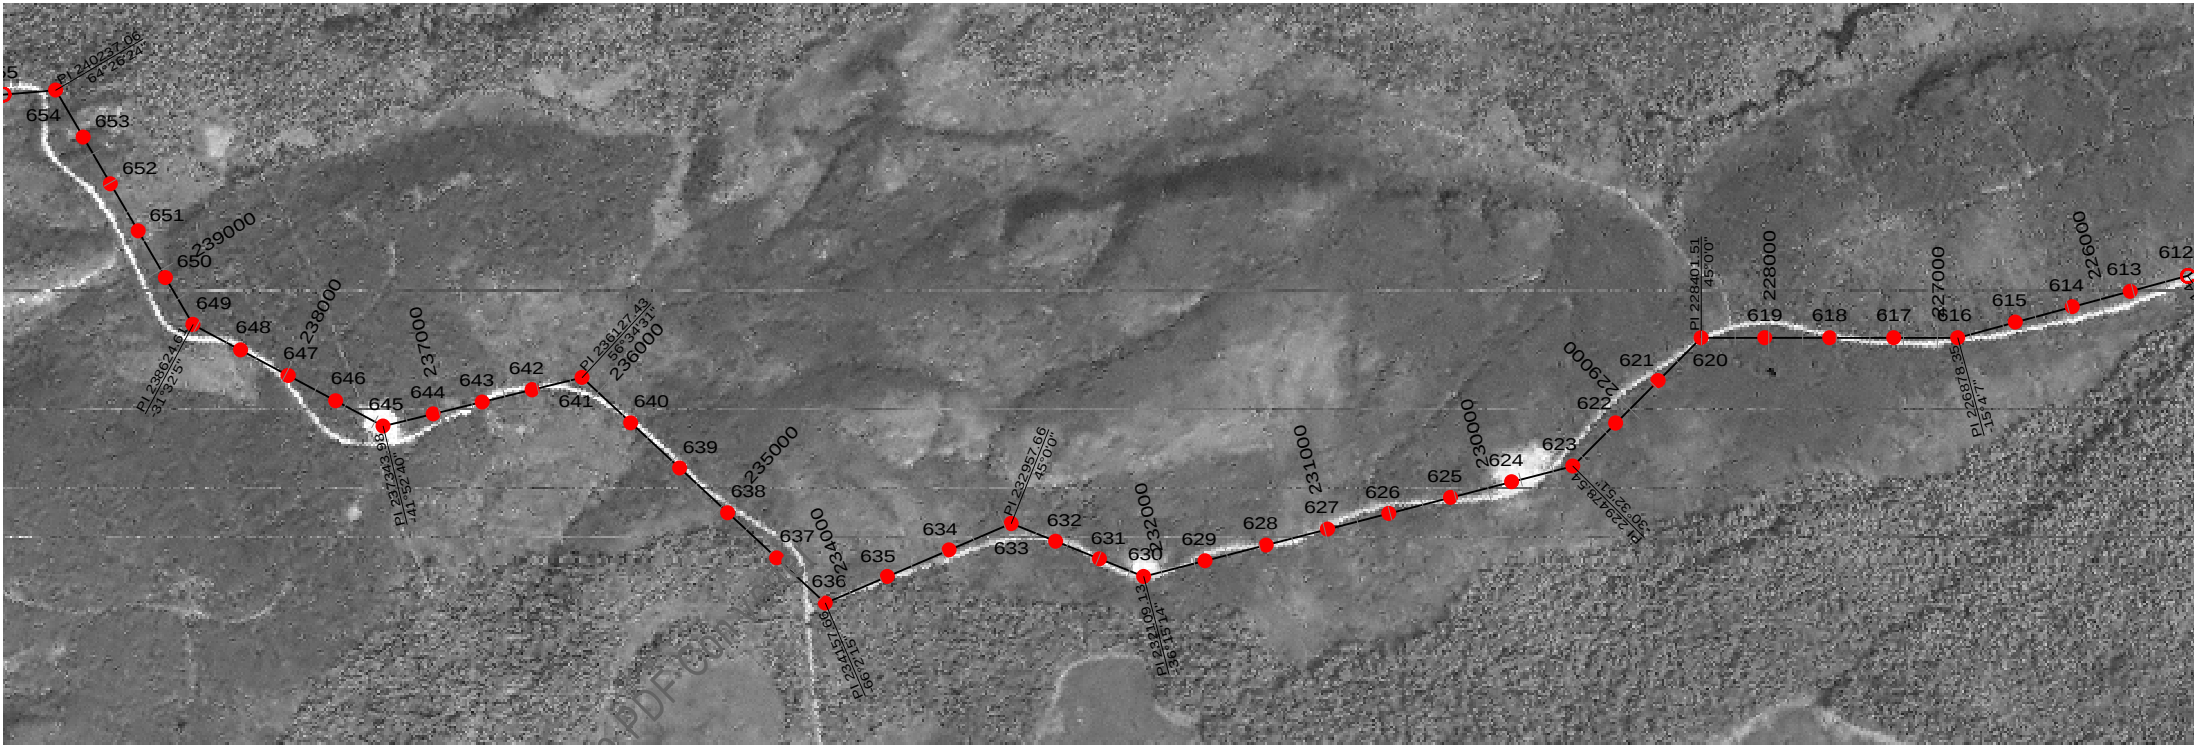

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

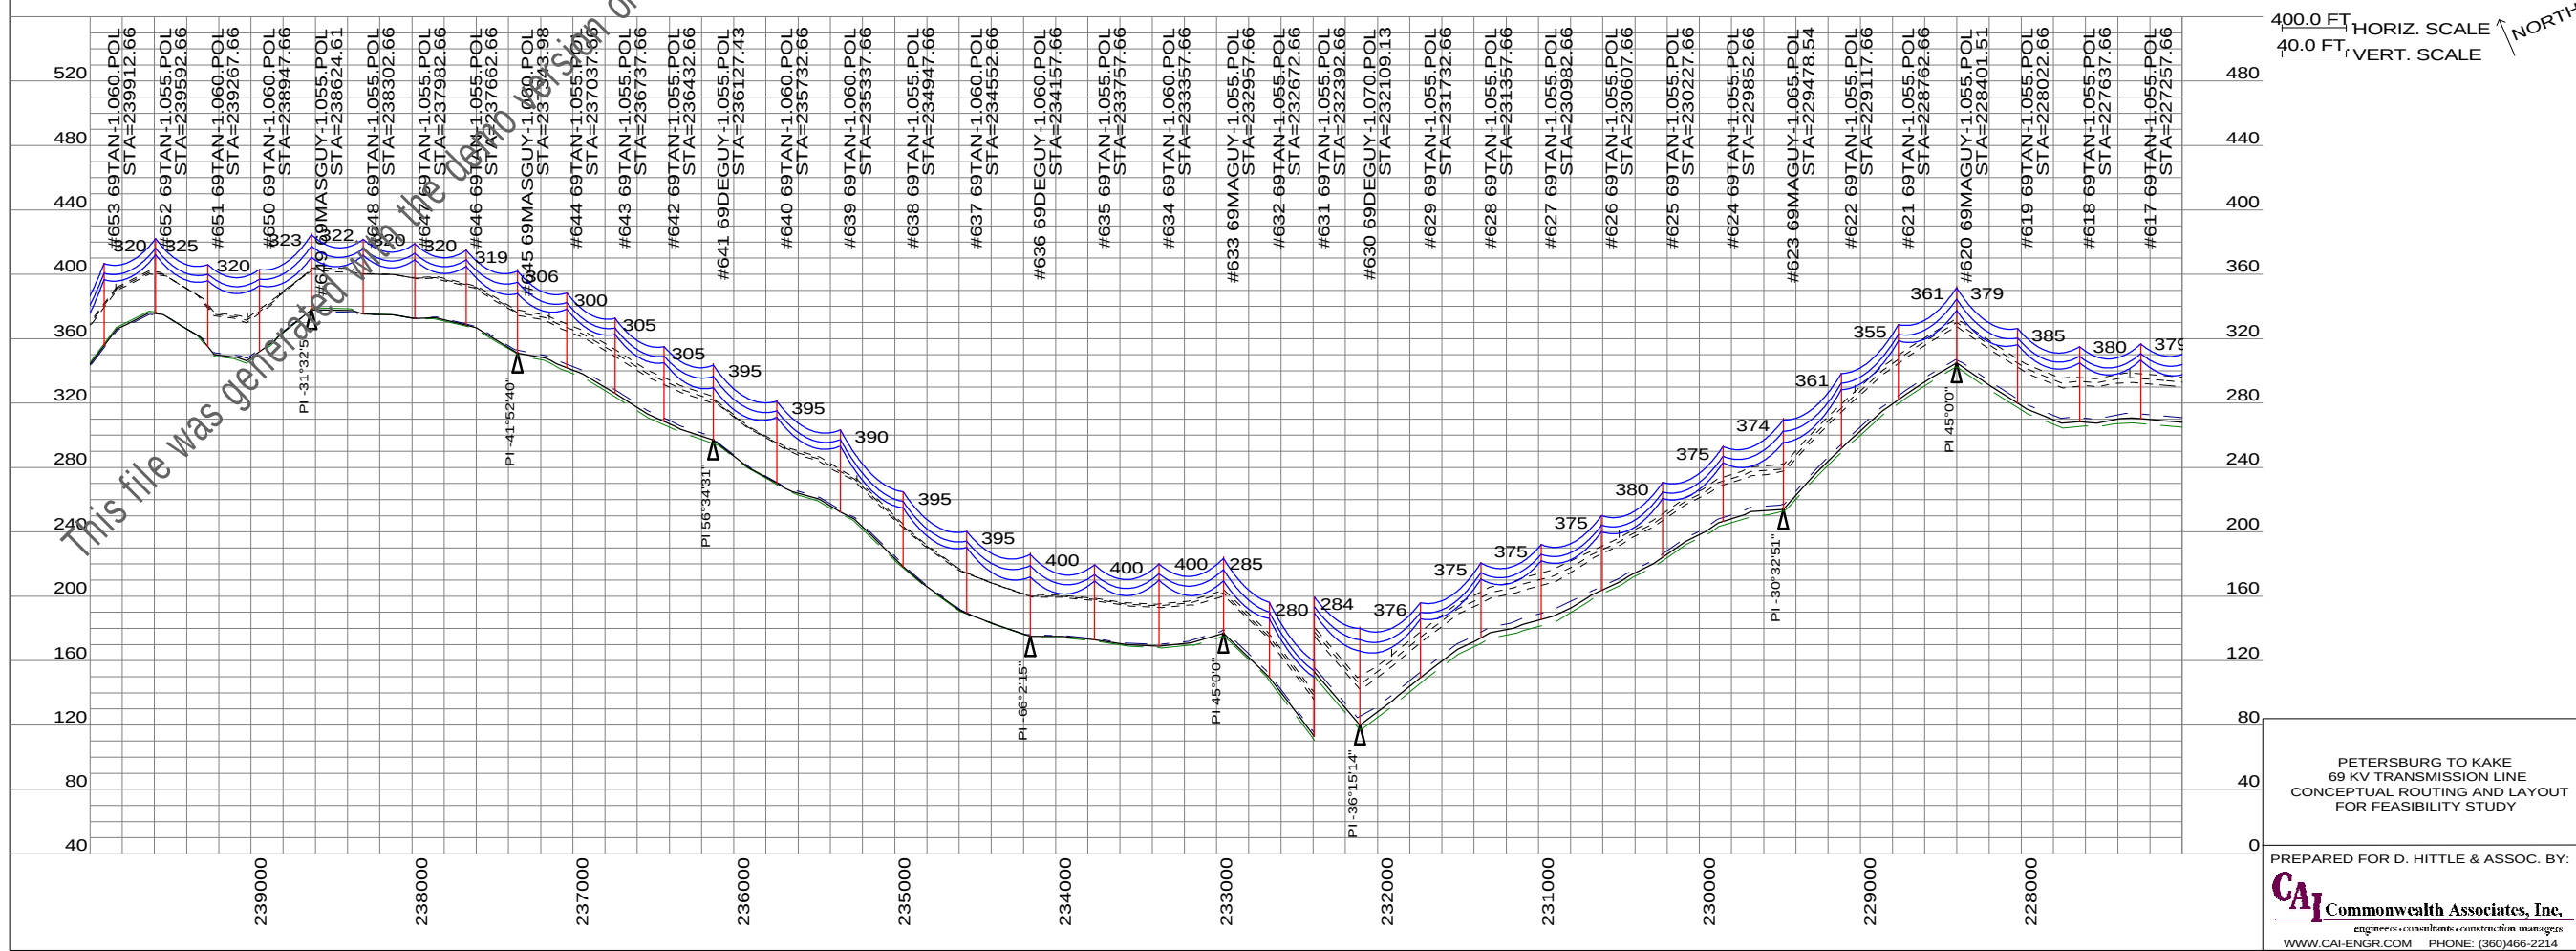

PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY



PREPARED FOR D. HITTLE & ASSOC. BY:

CAI Commonwealth Associates, Inc.
engineers, consultants, construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214



3/27/2023
PAGE 4/23

GENERAL NOTES:

1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

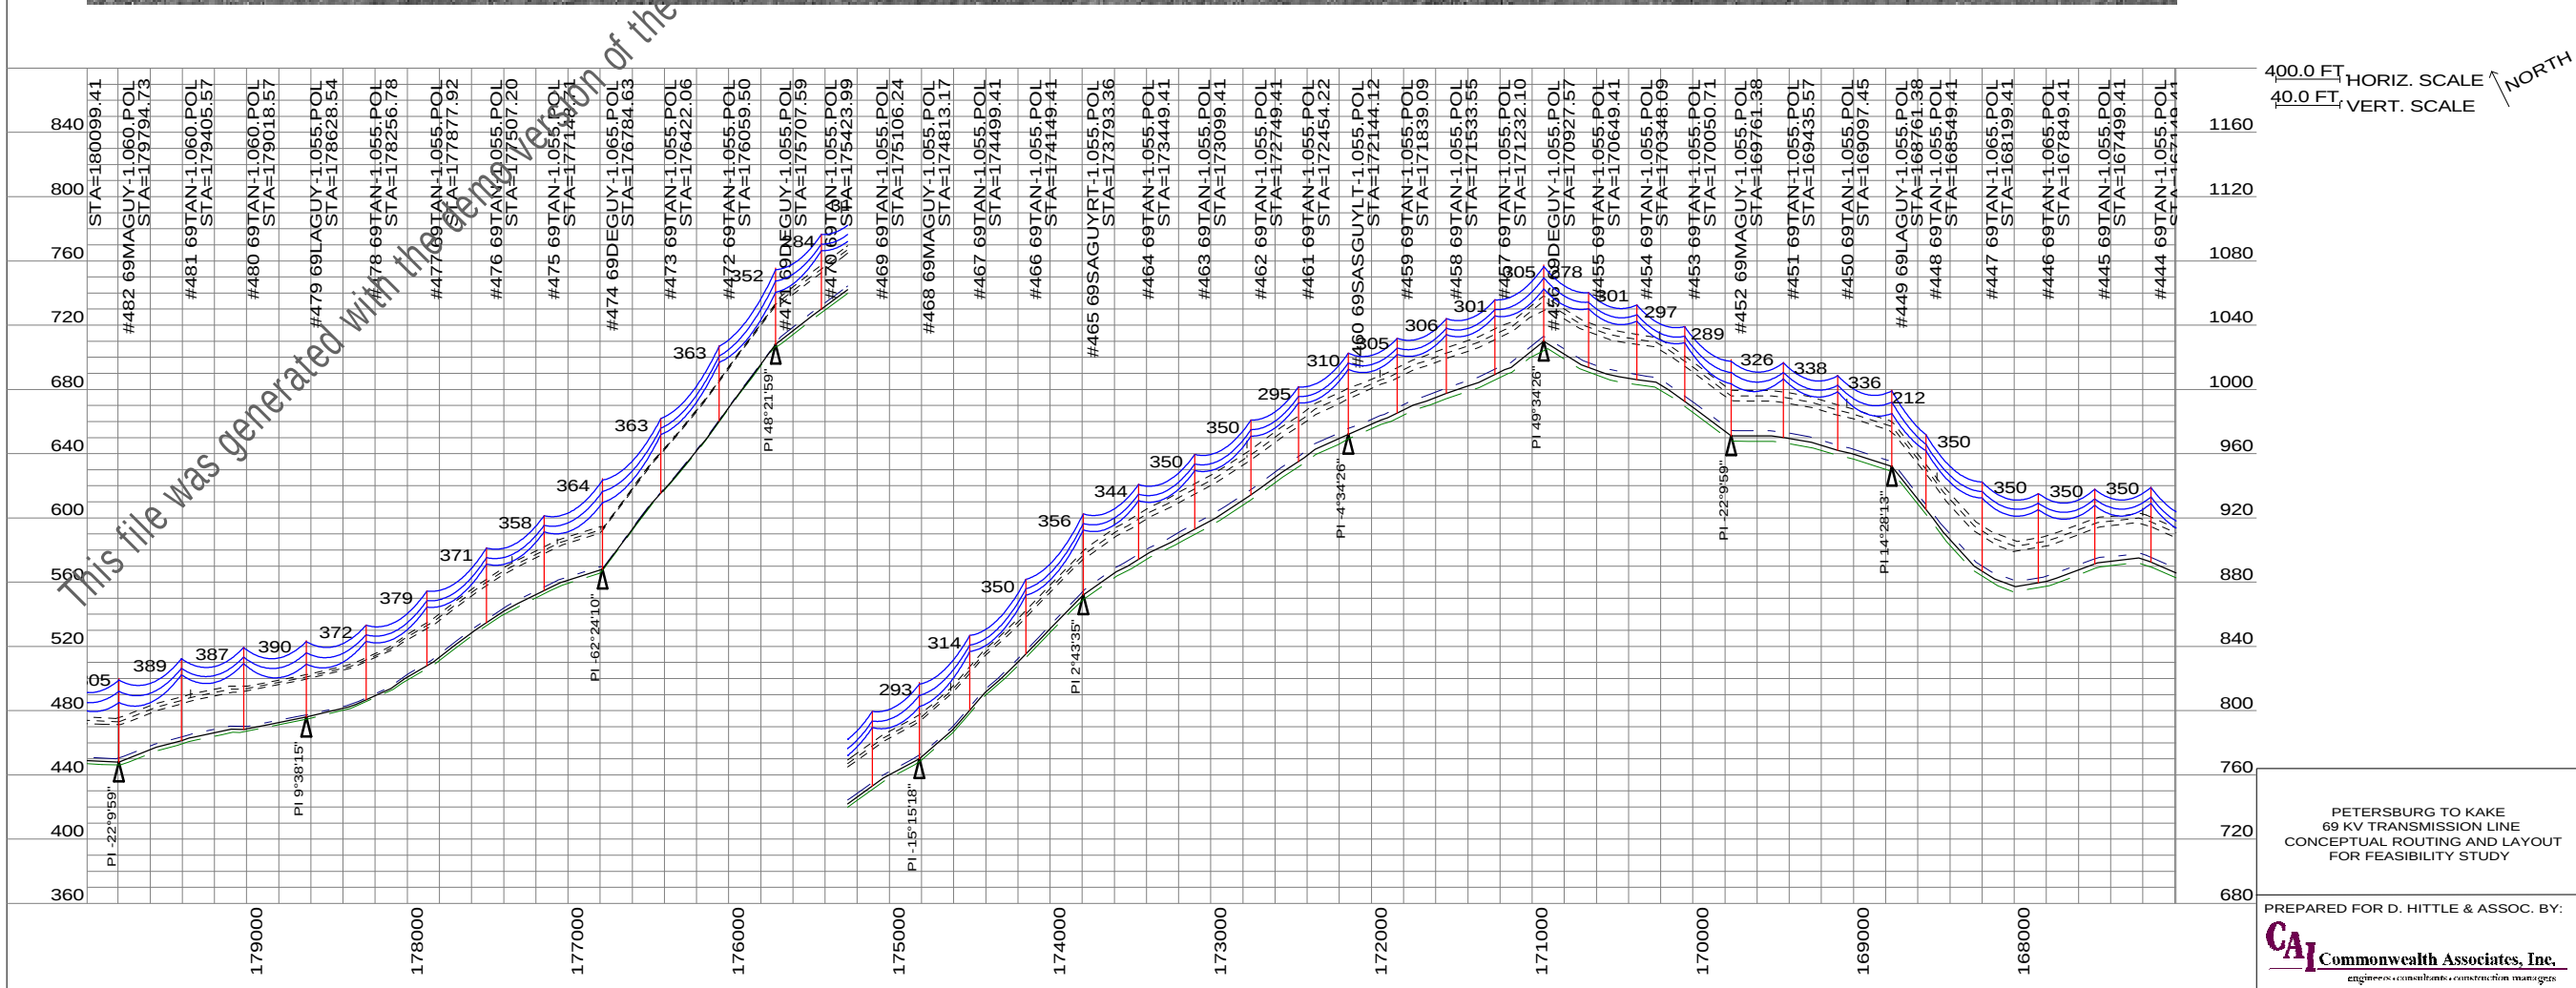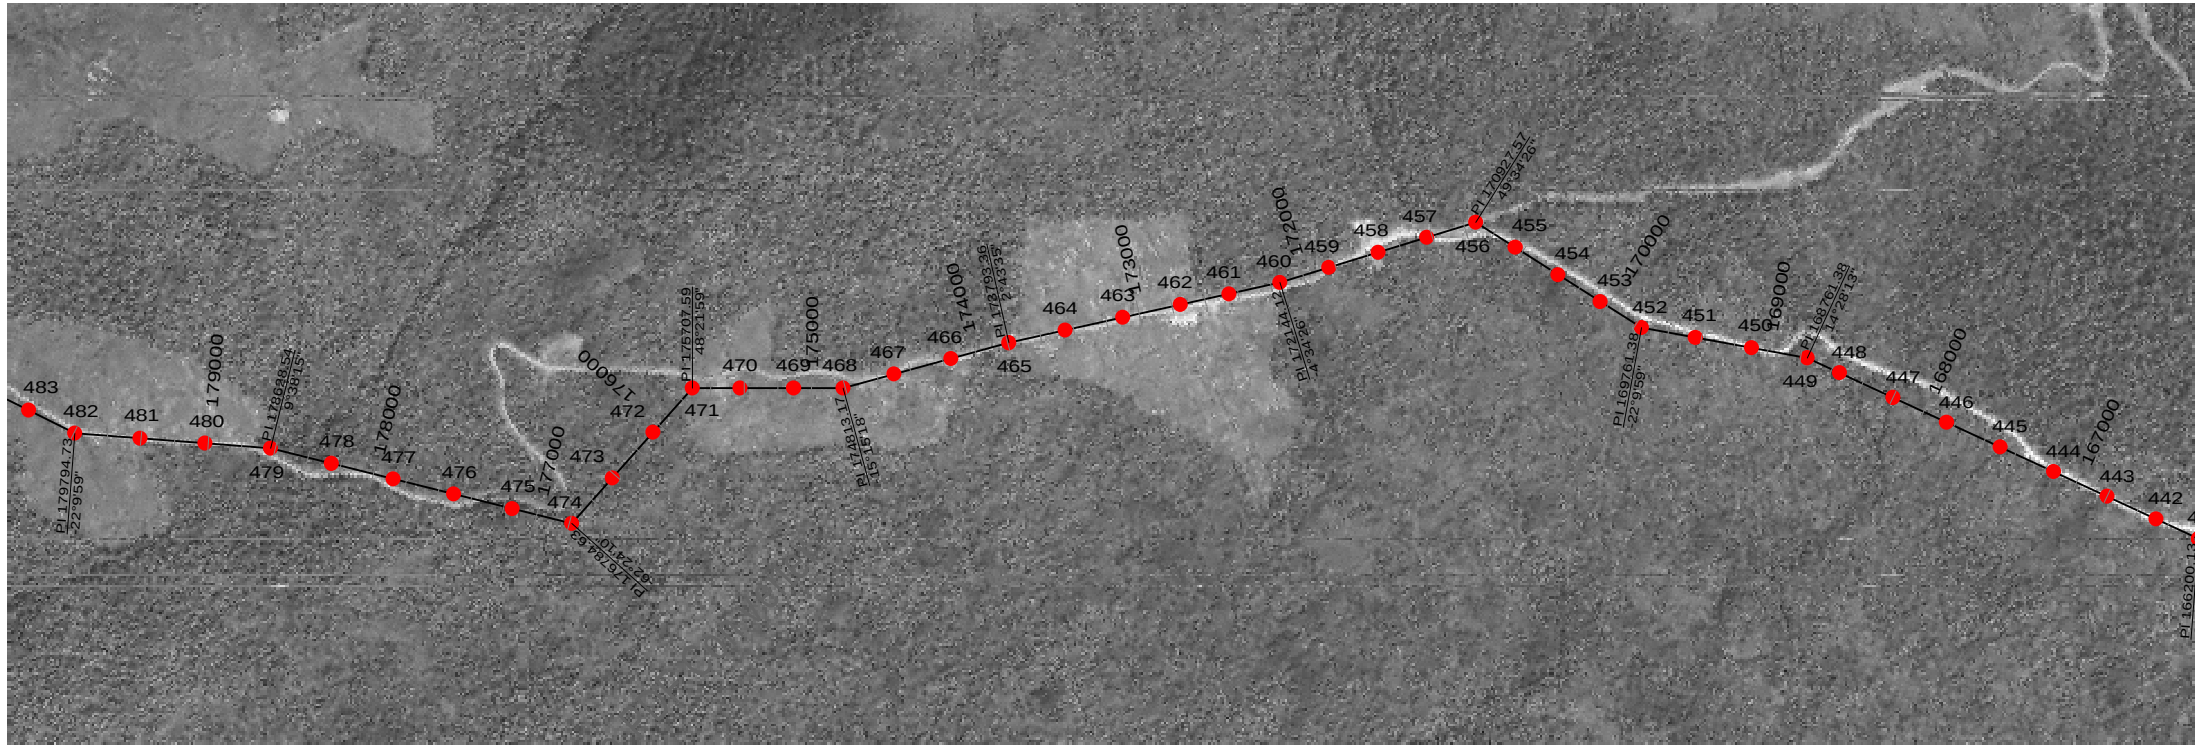



- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

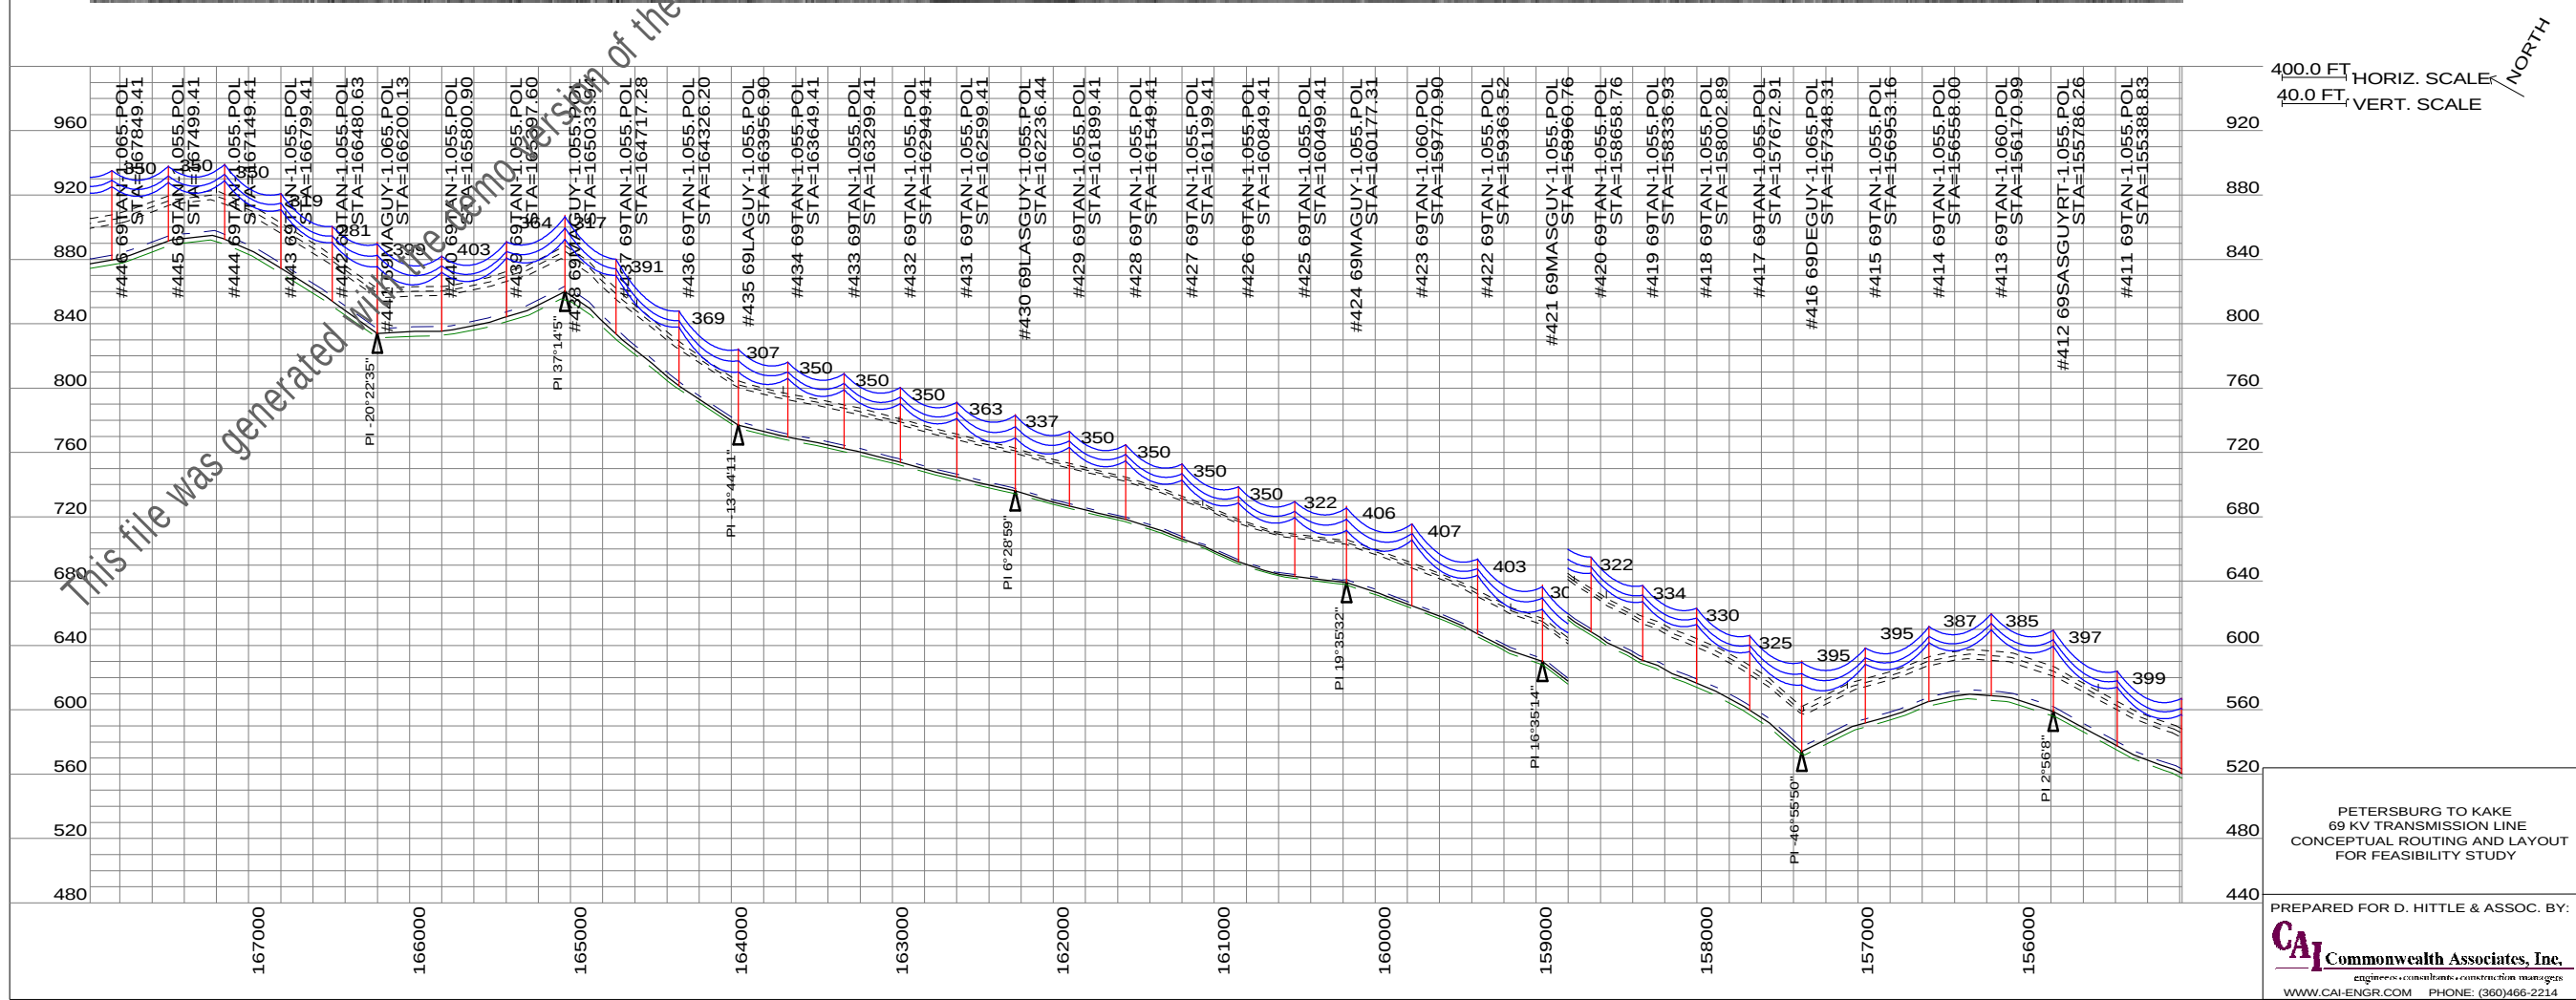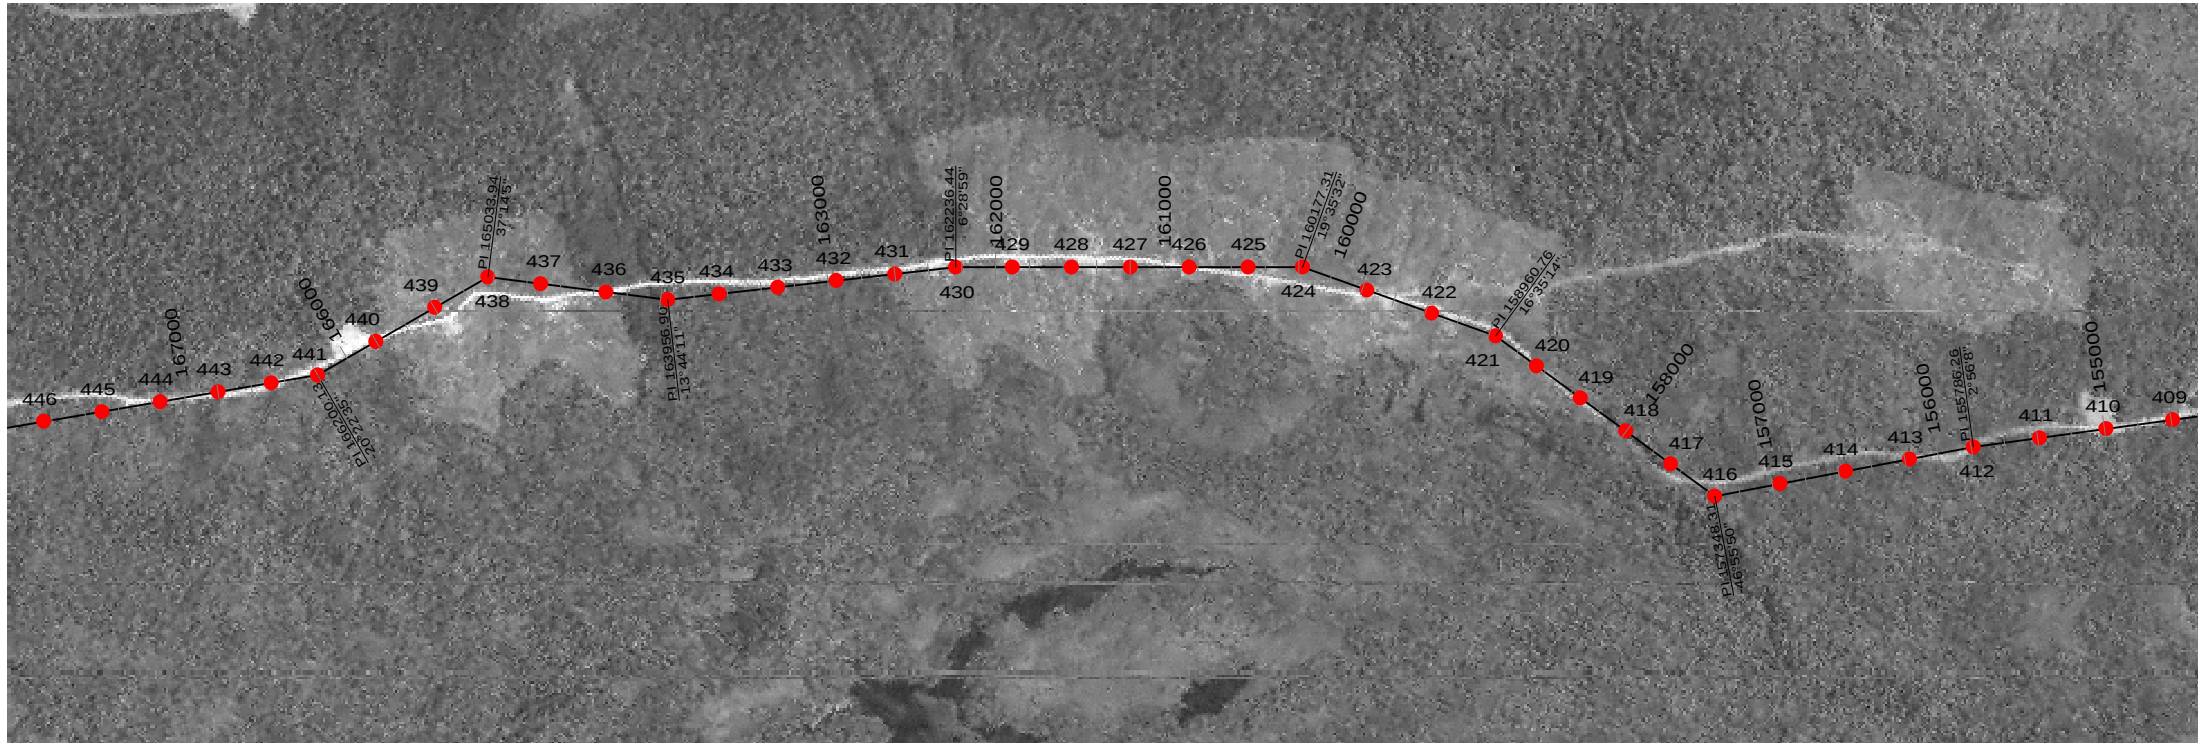





- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

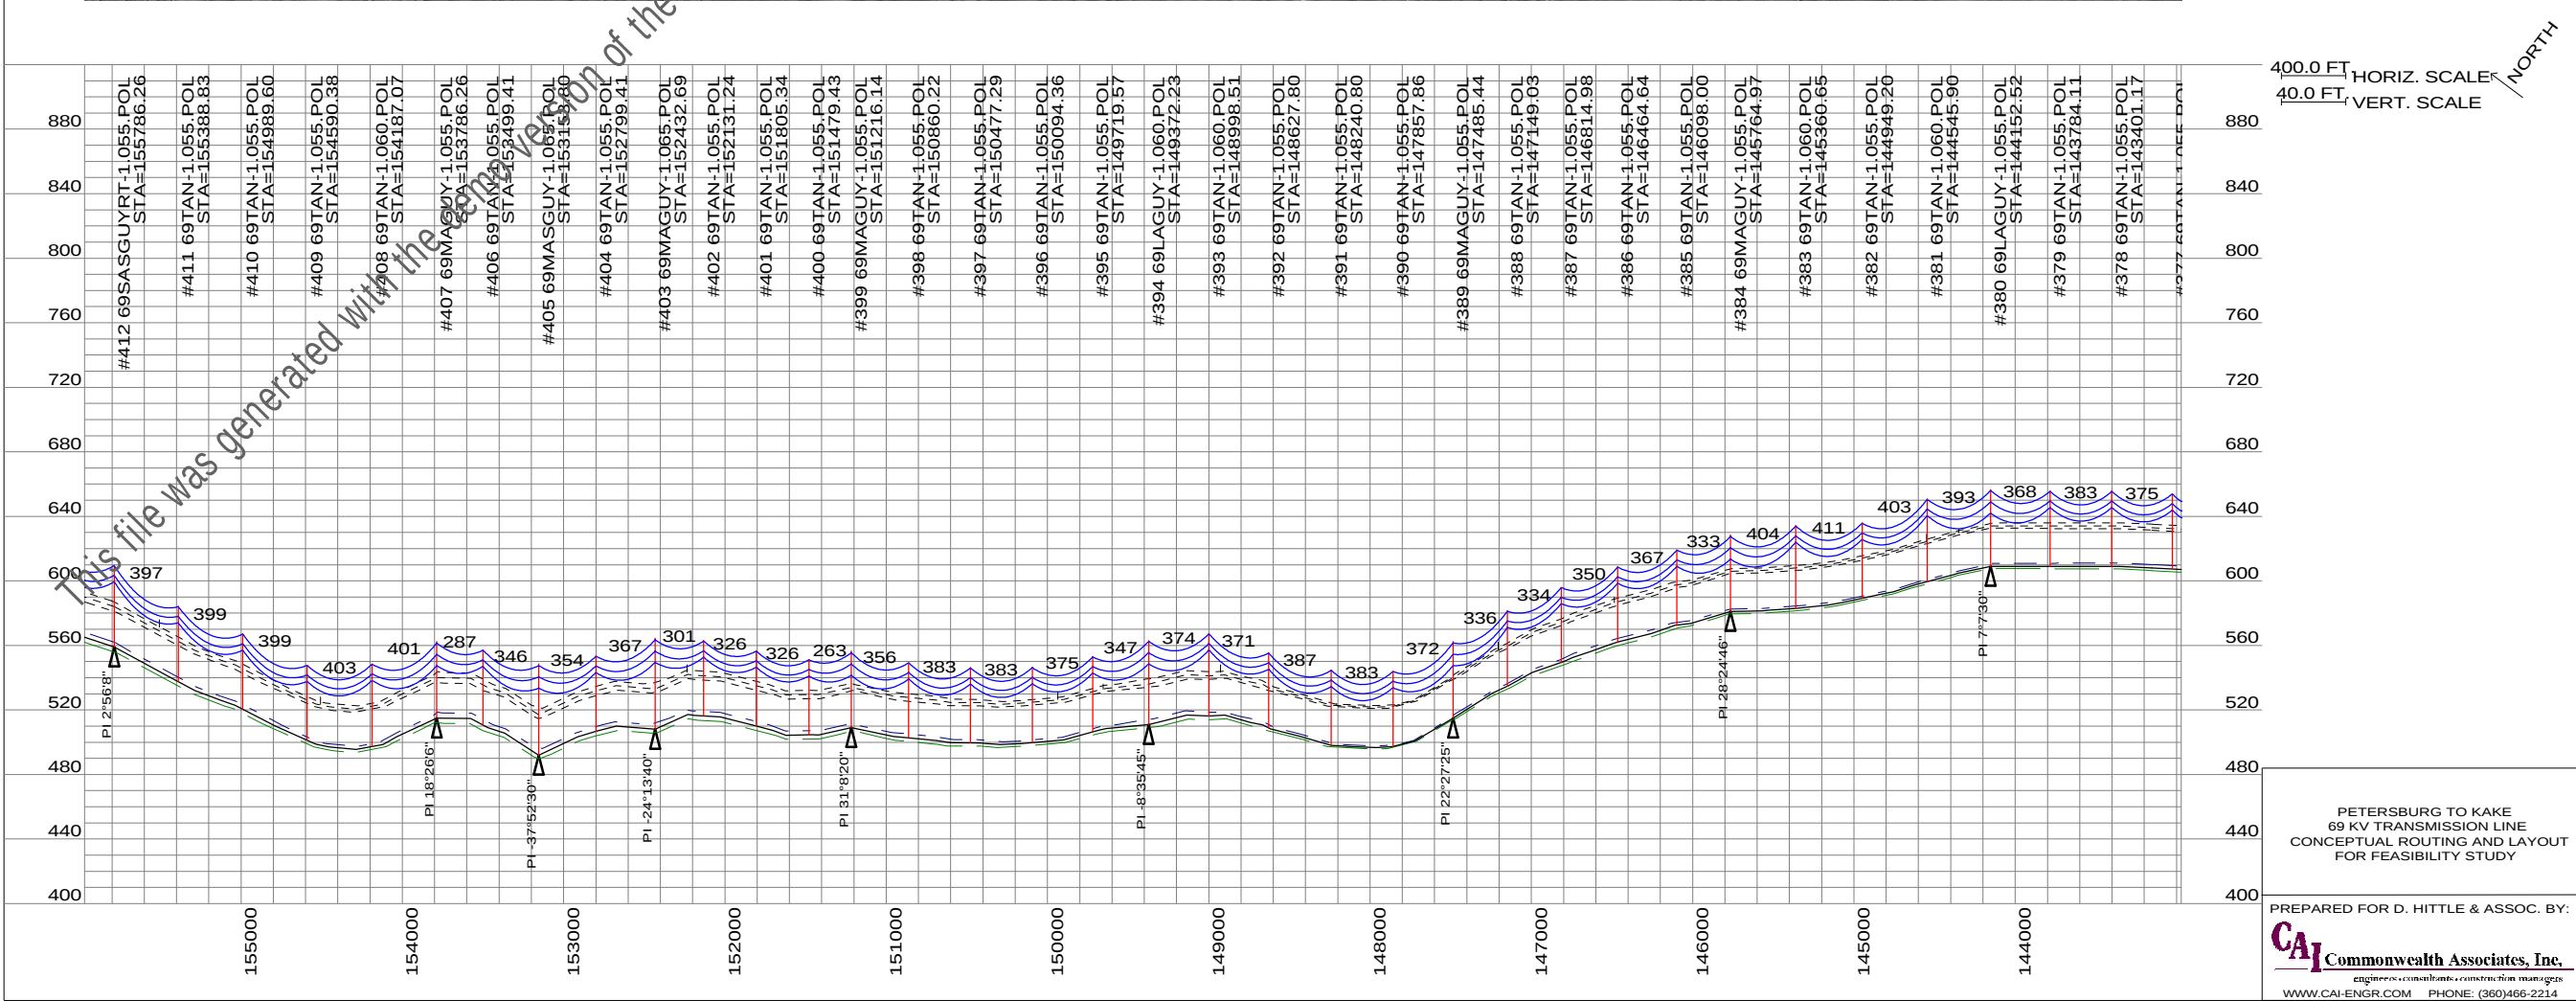

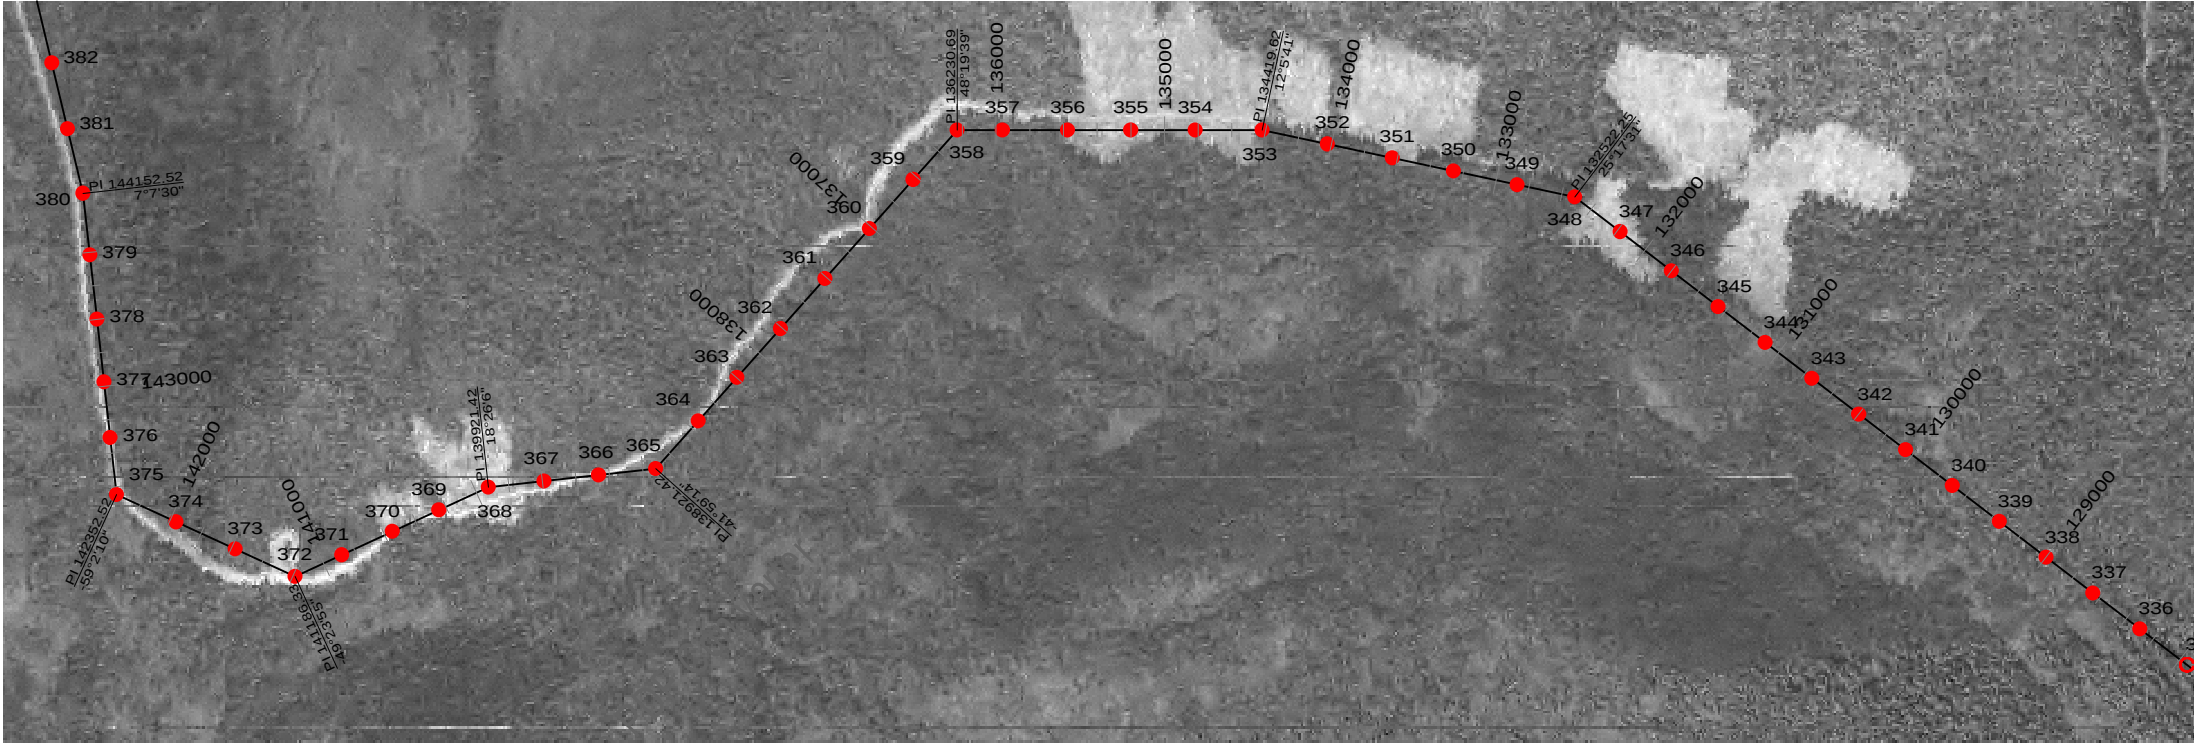


- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.


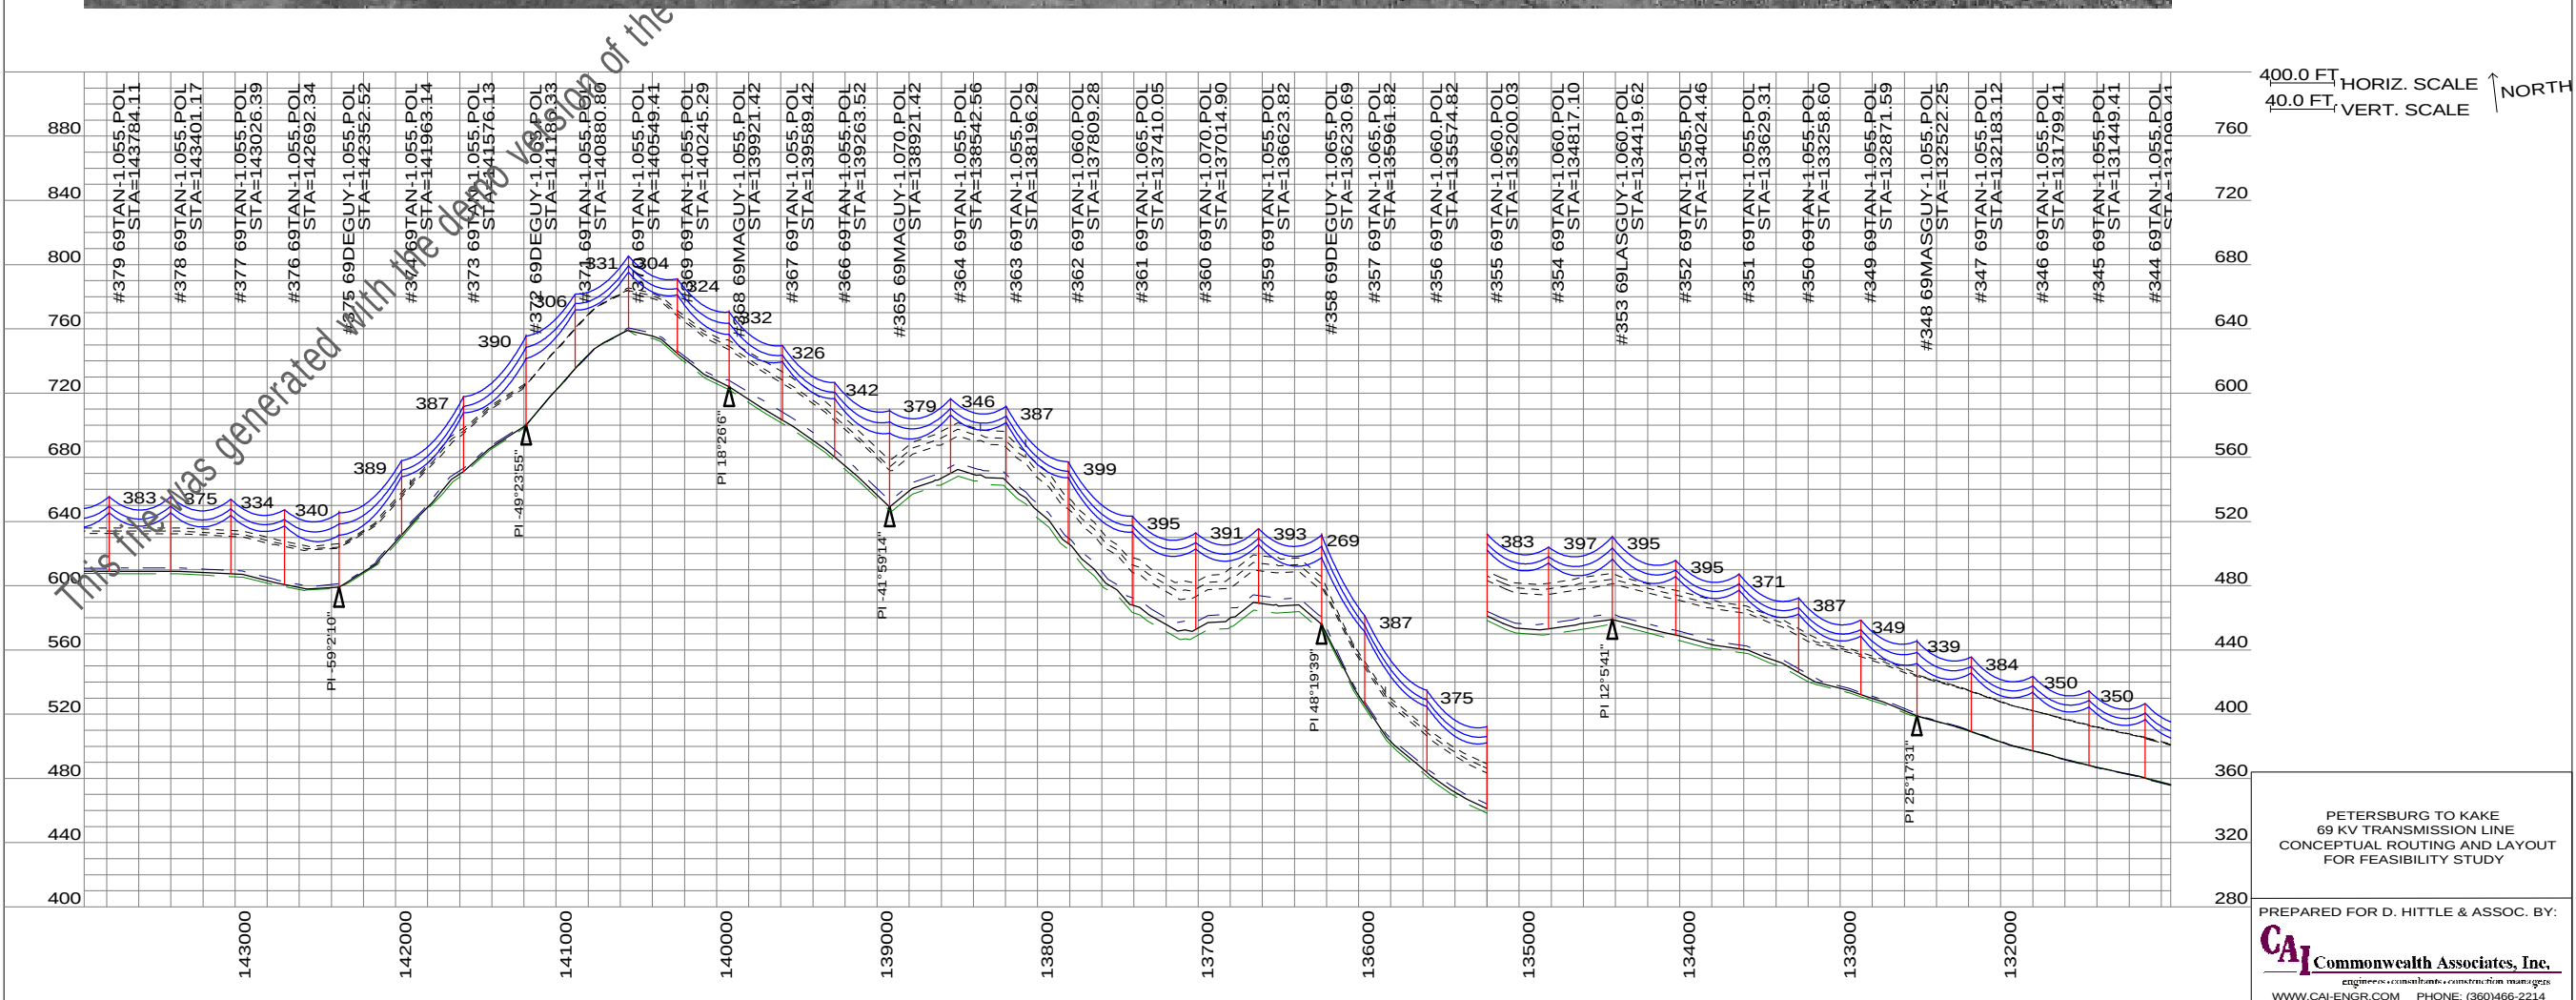


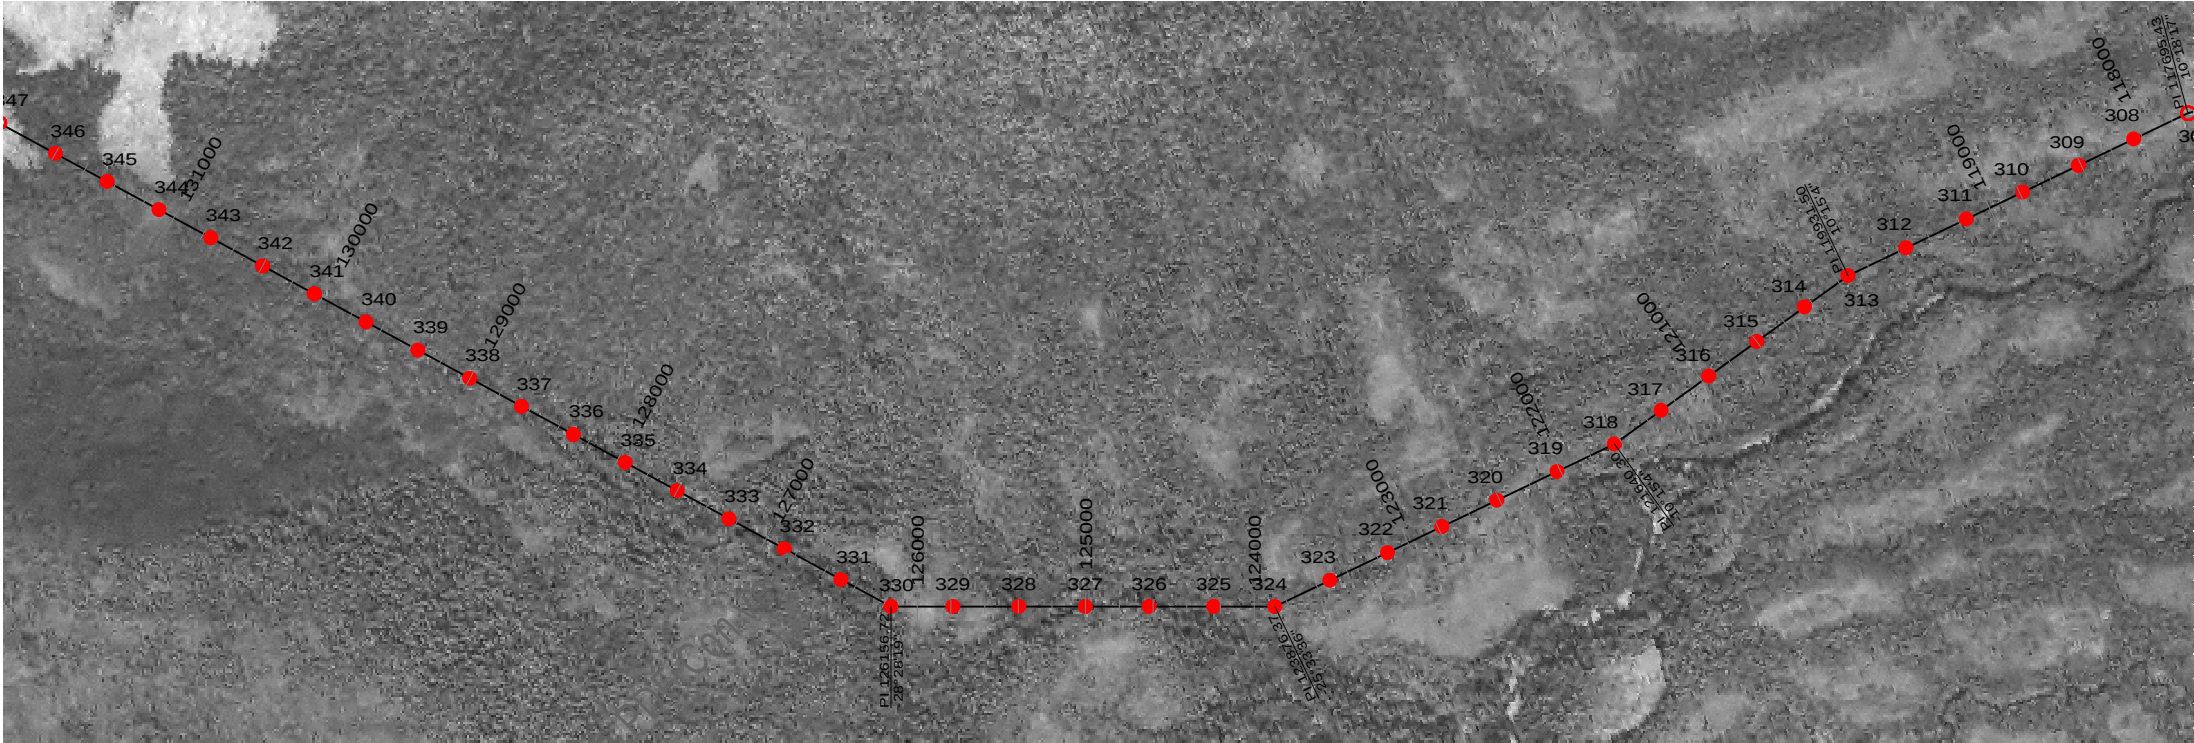

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

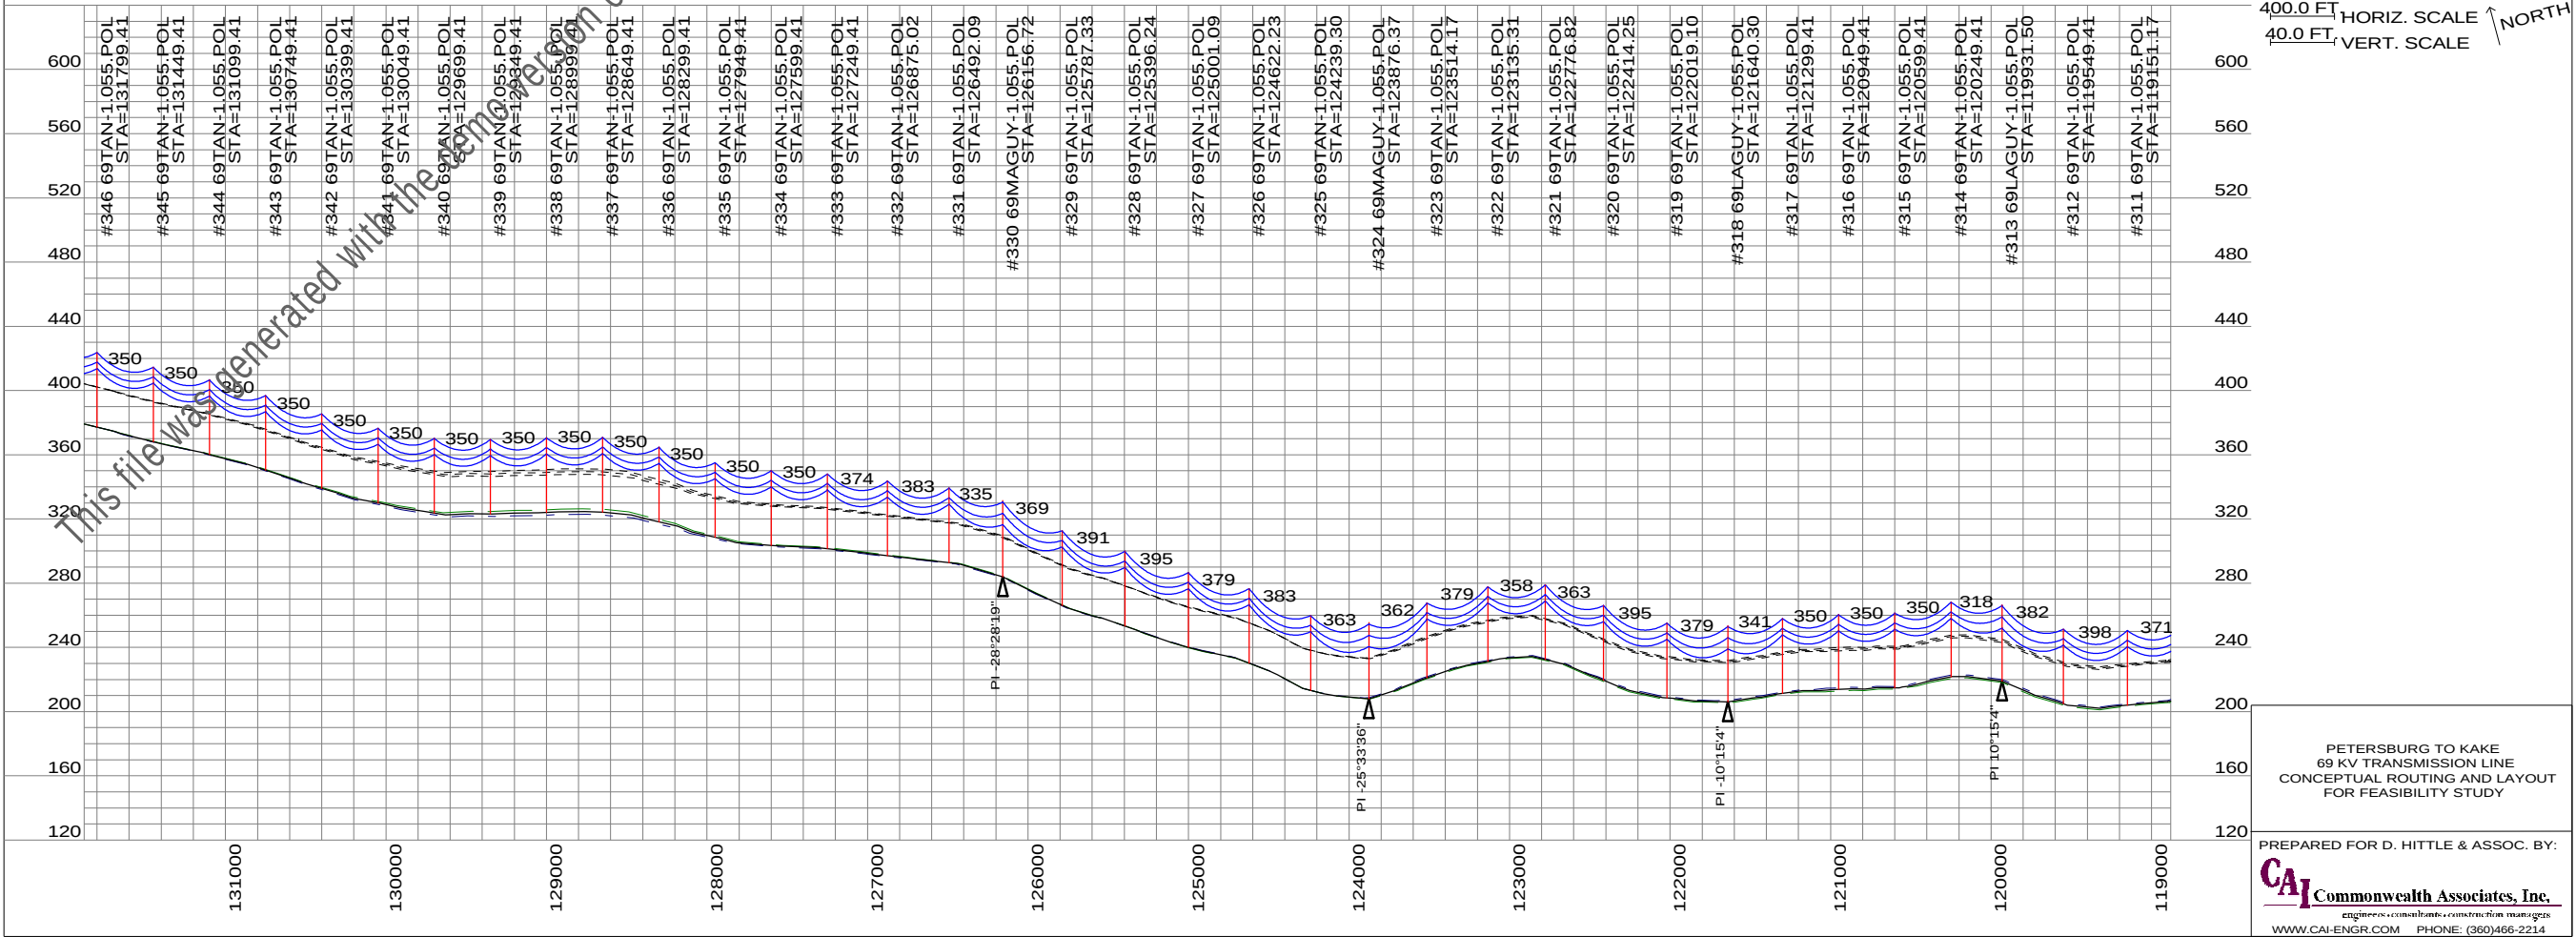

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

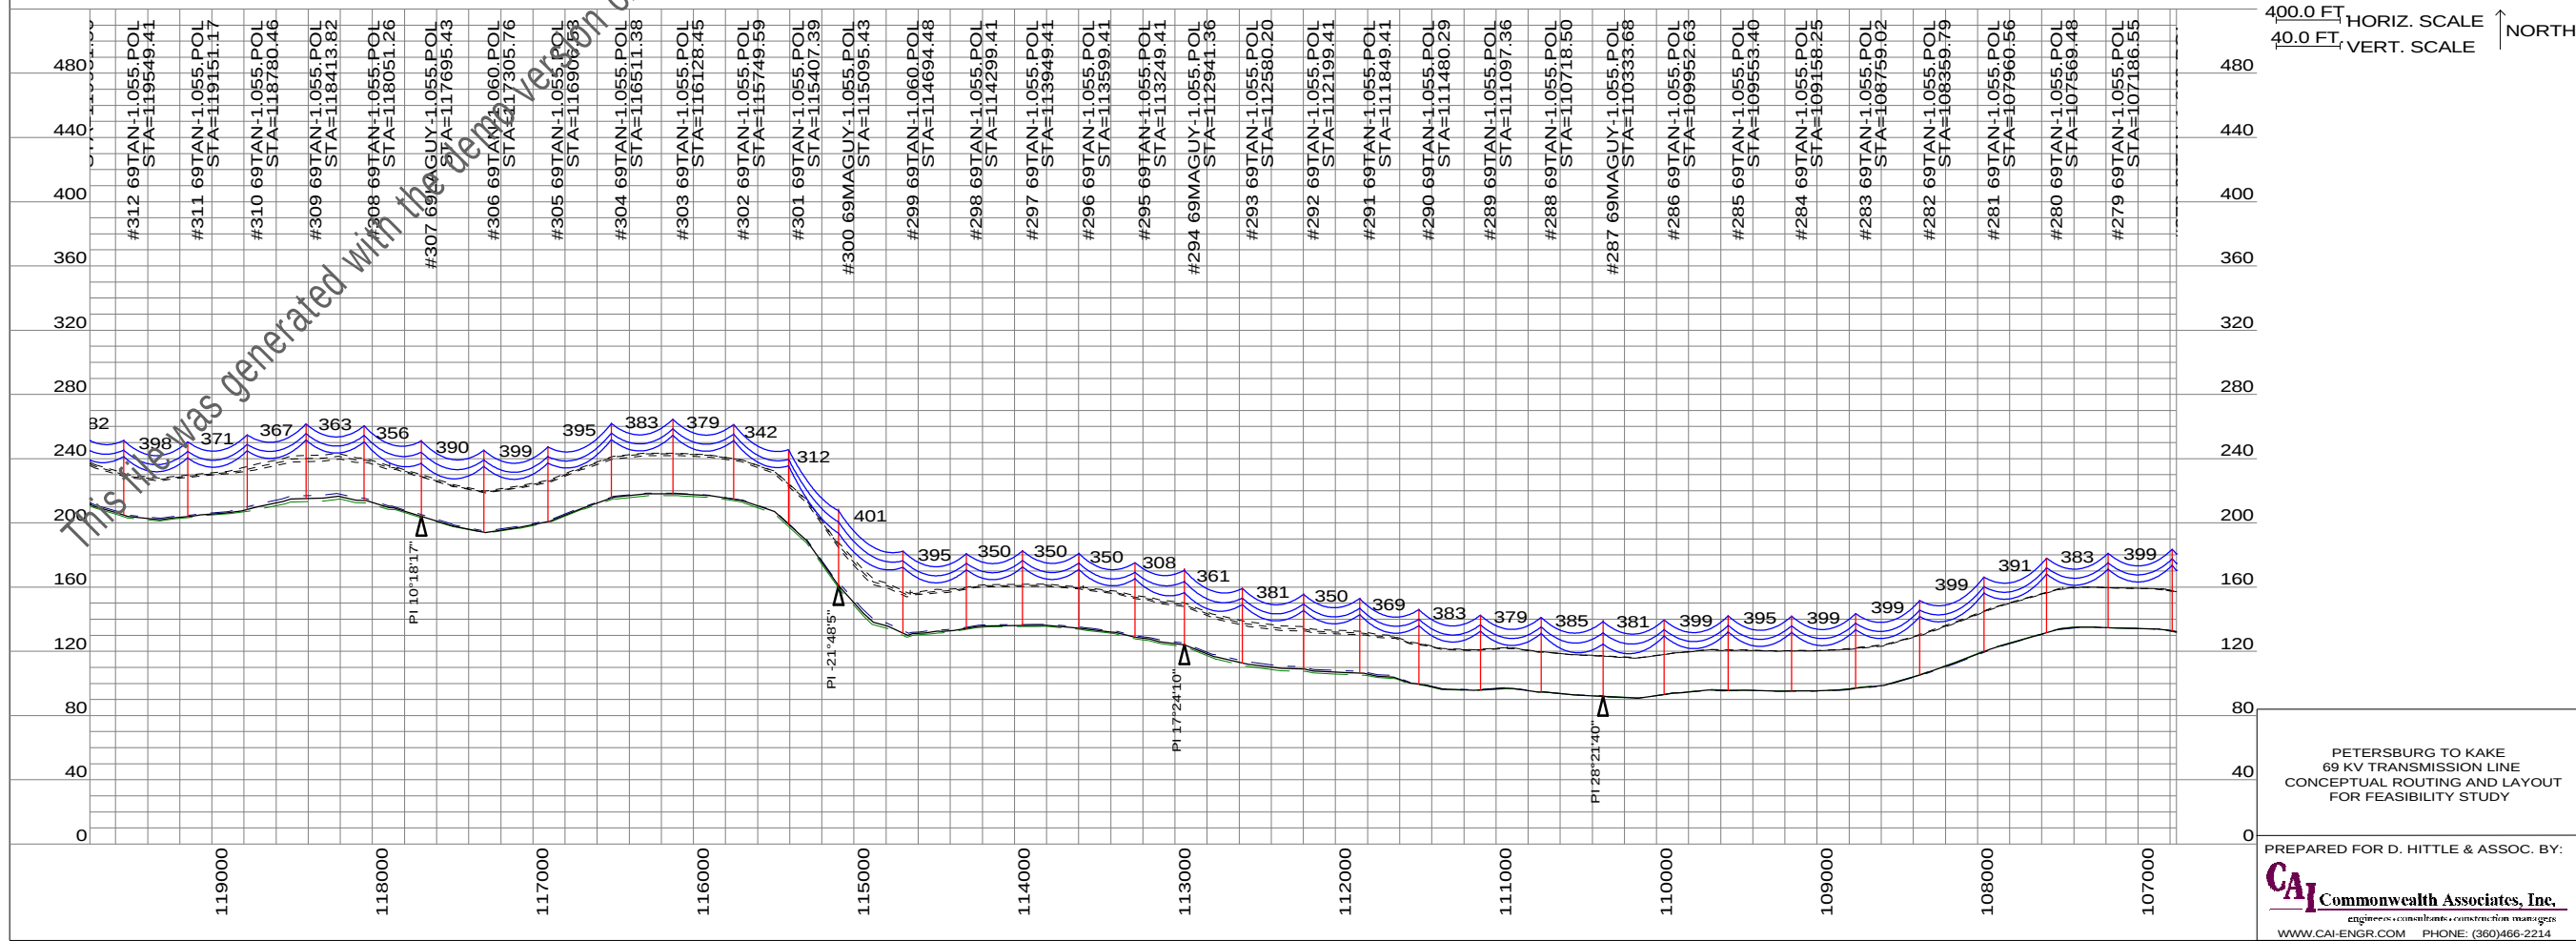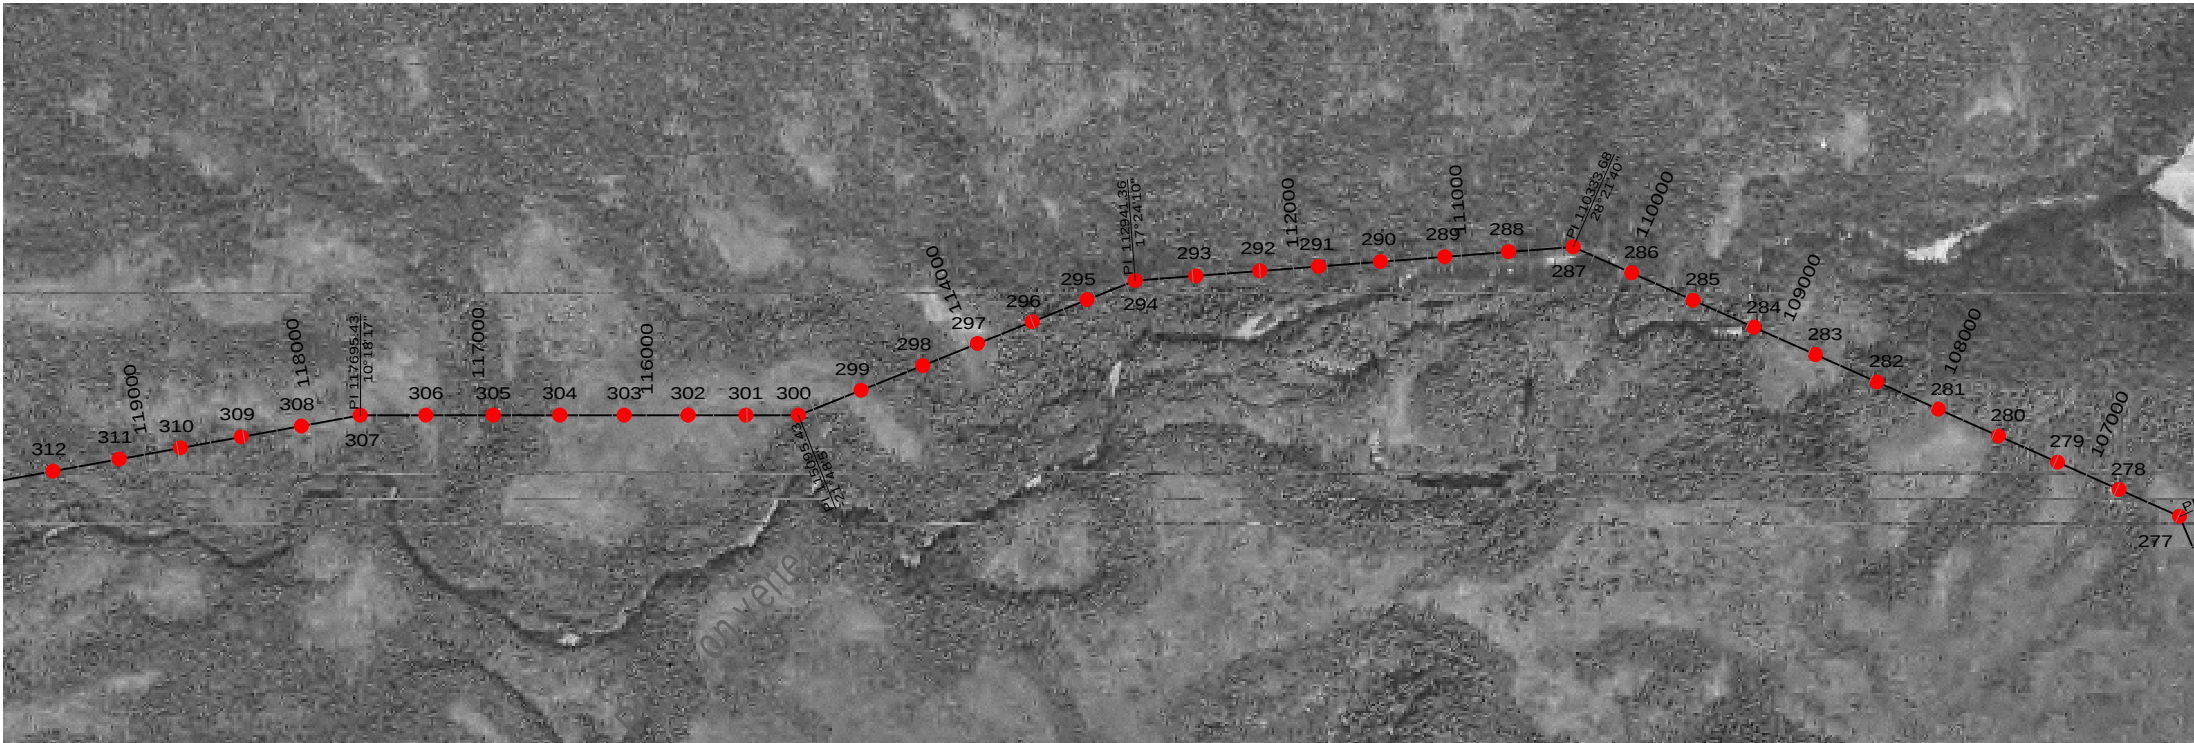


PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY


PREPARED FOR D. HITTLE & ASSOC. BY:


CAI Commonwealth Associates, Inc.
engineers • consultants • construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214

3/20/2023 10:18 AM KAKE TO PETERSBURG1
3/27/2023
PAGE 14/23

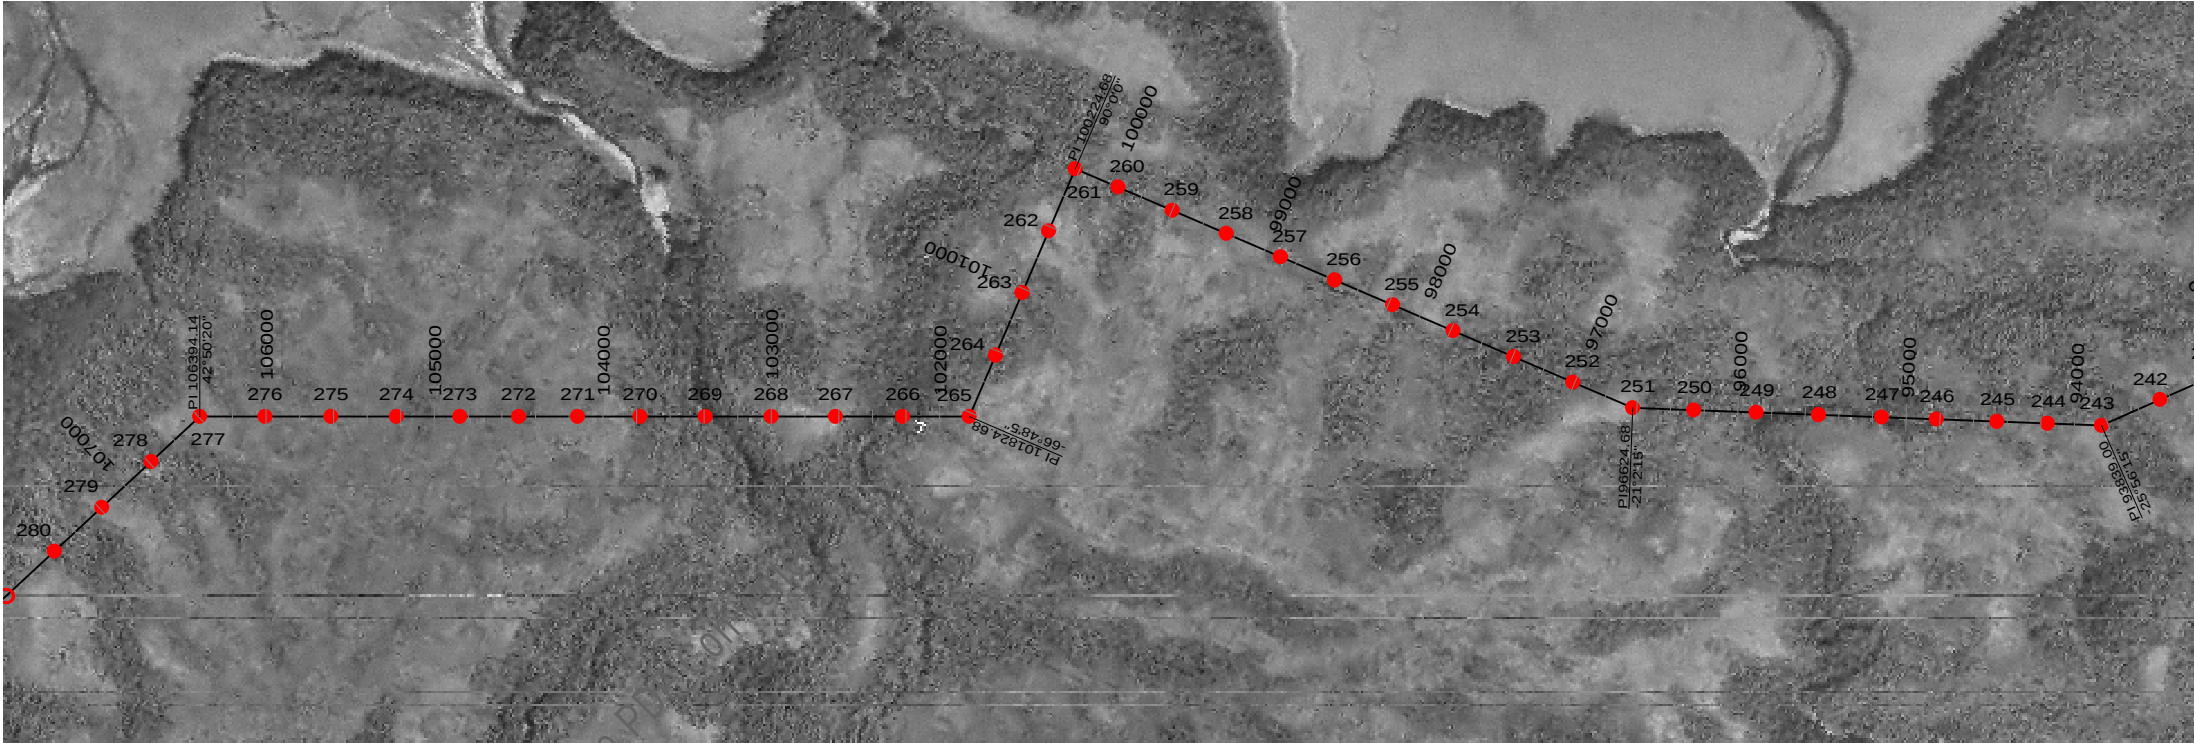



- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

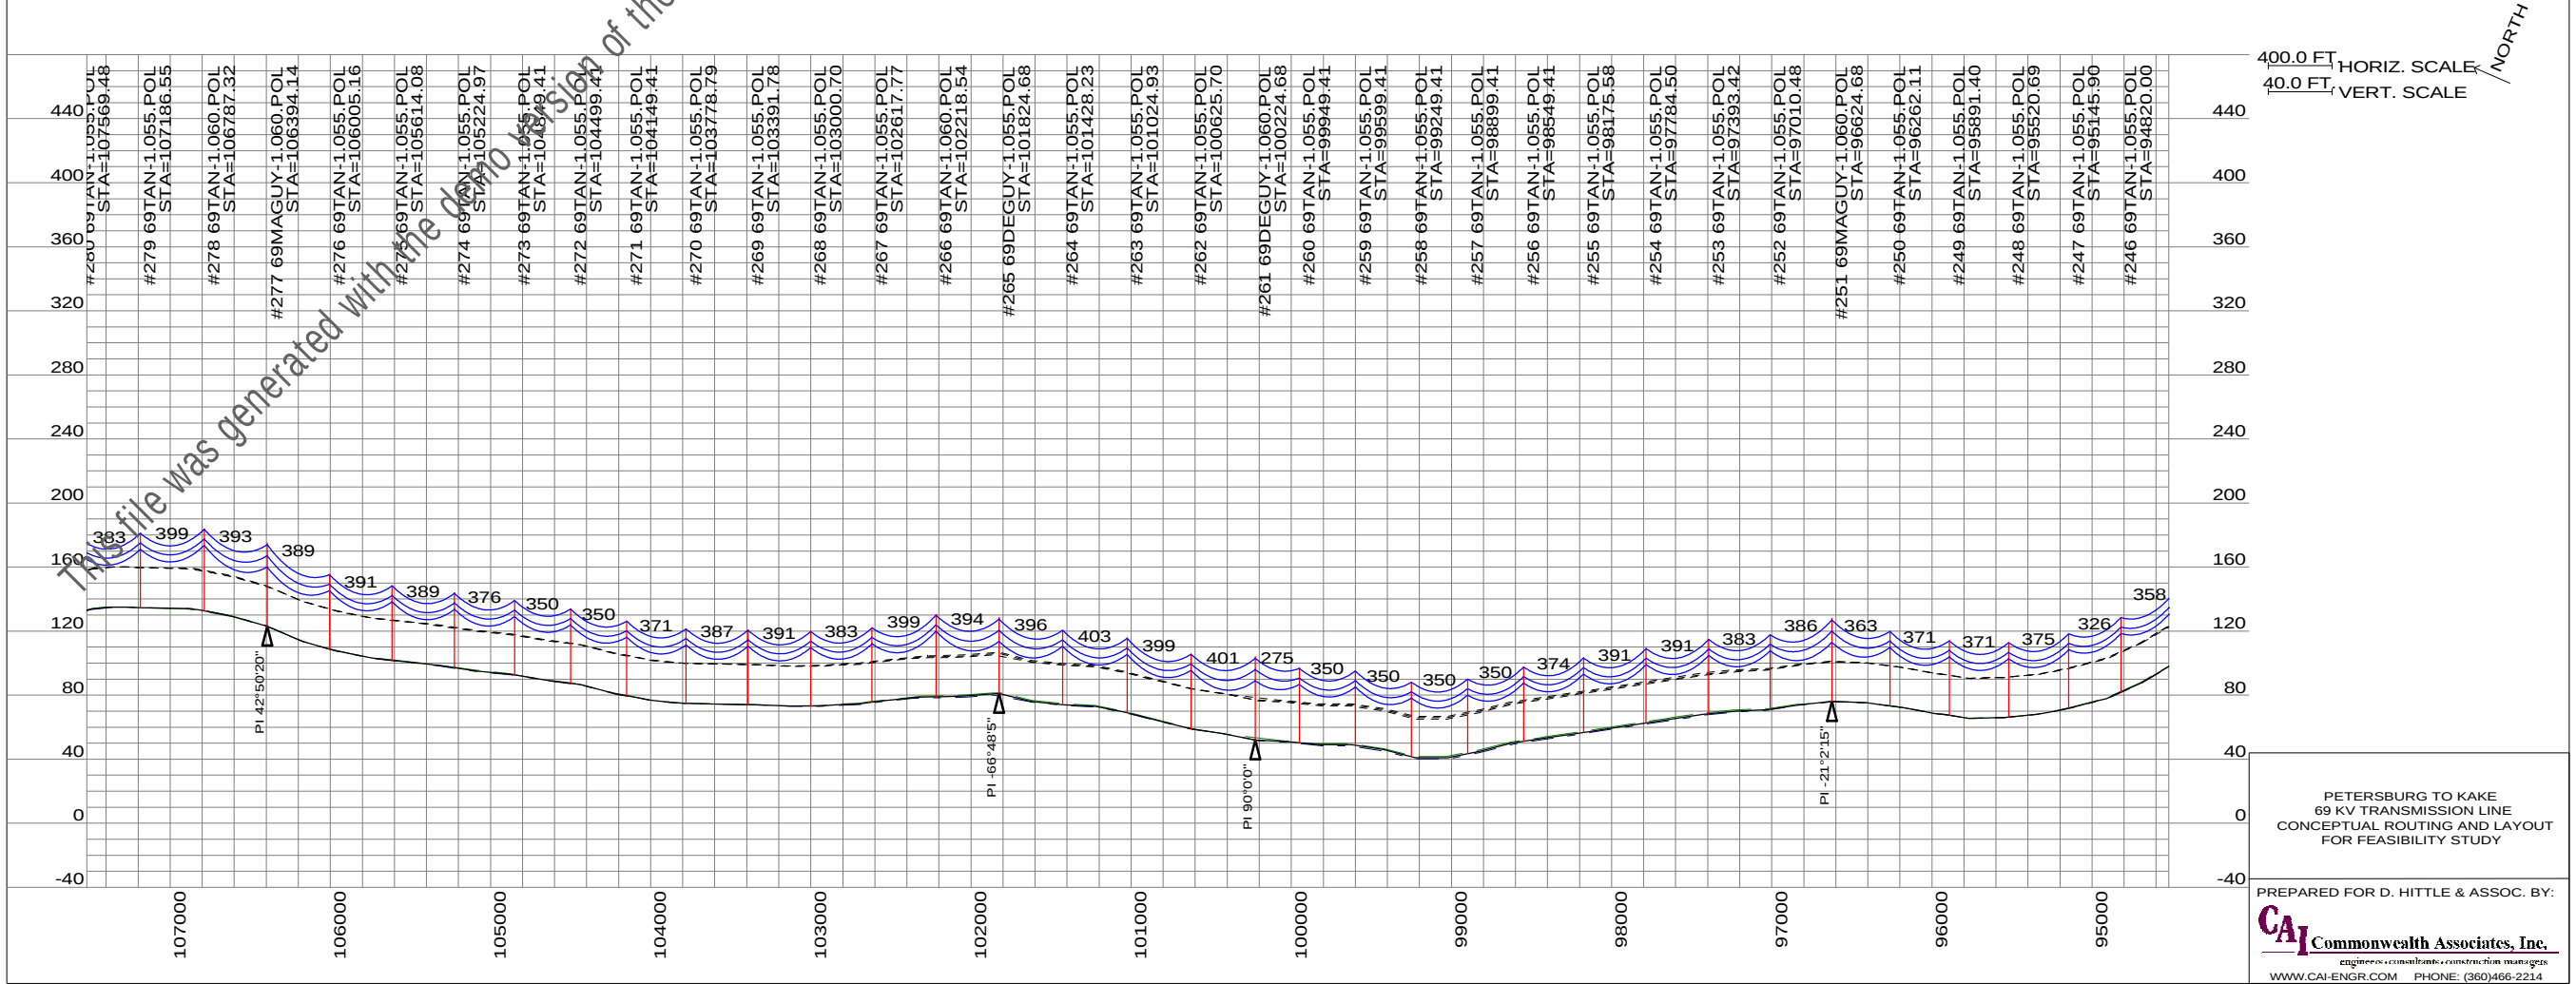

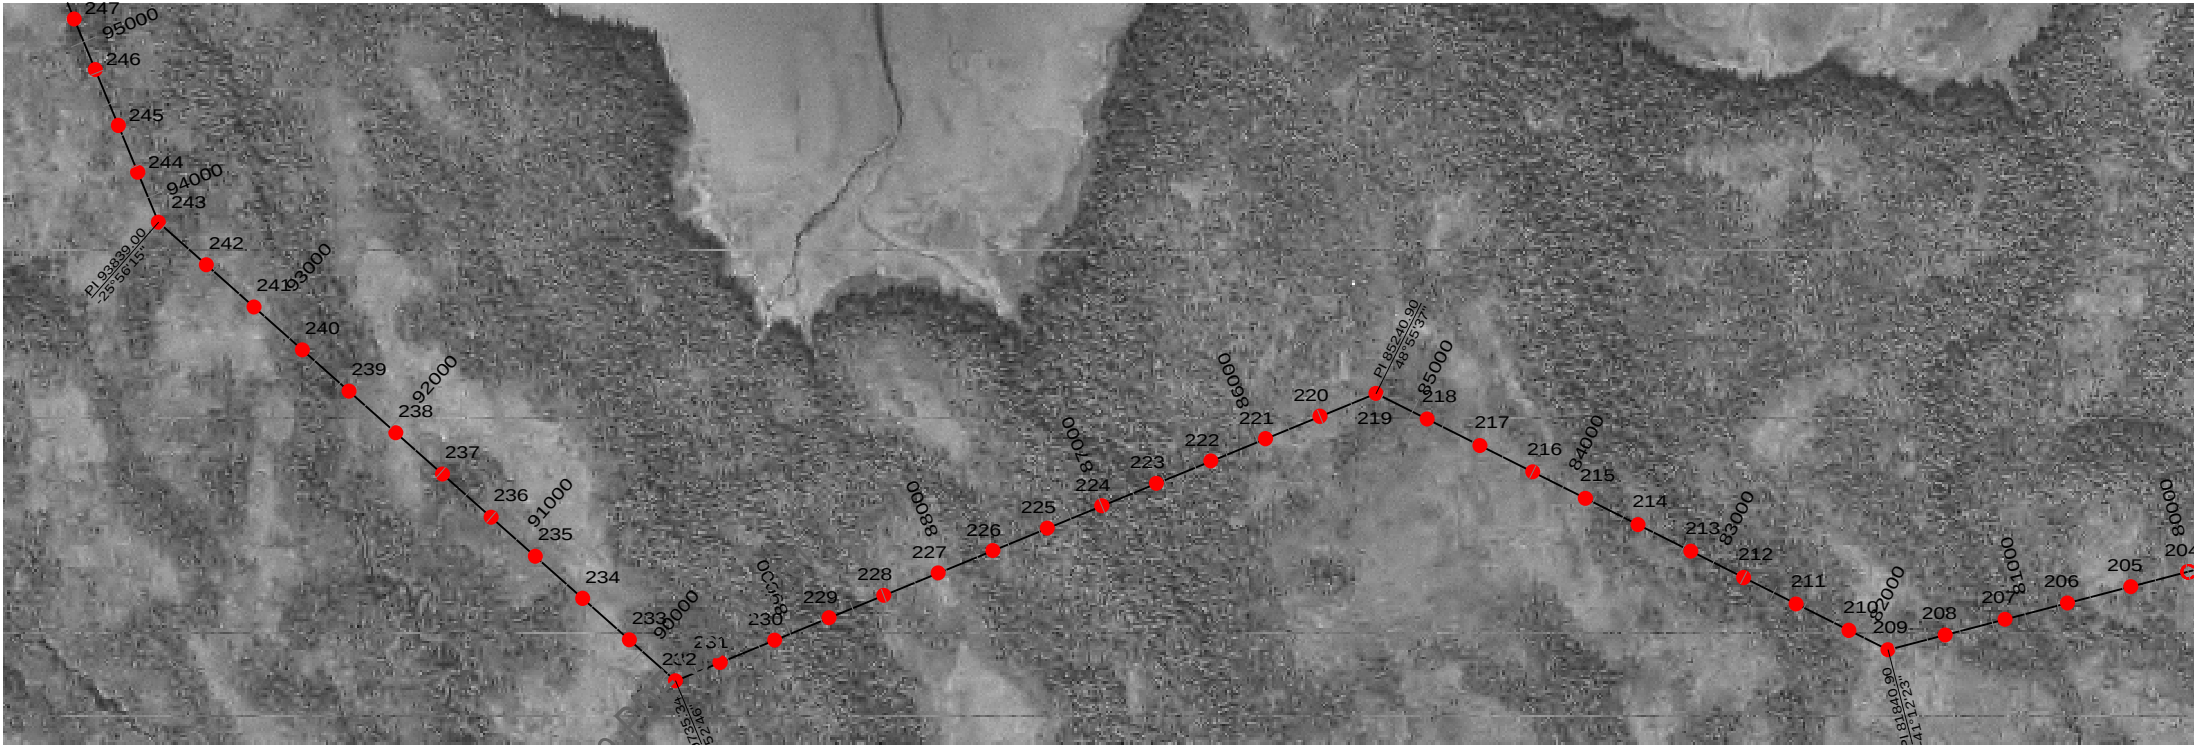


- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

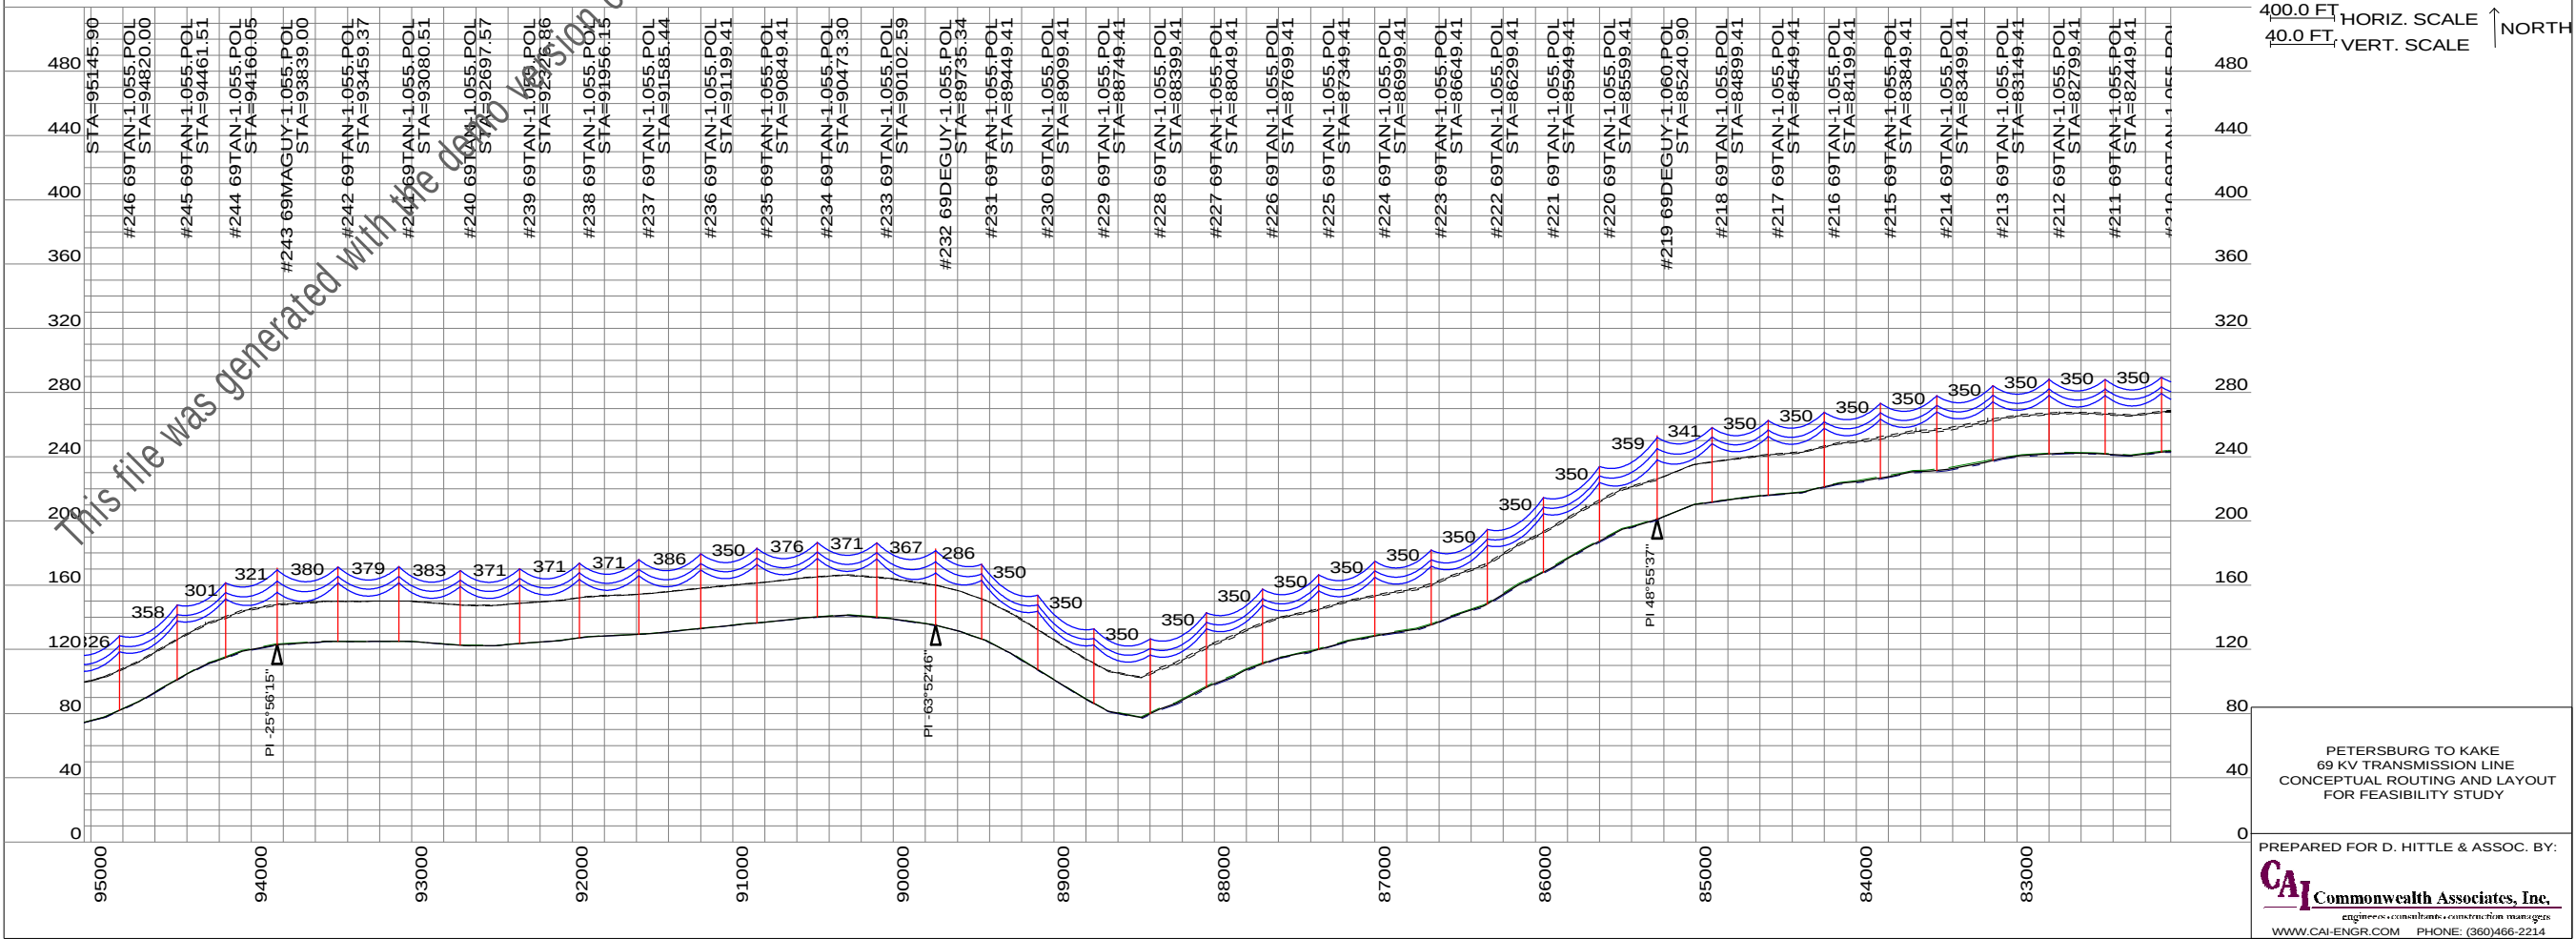


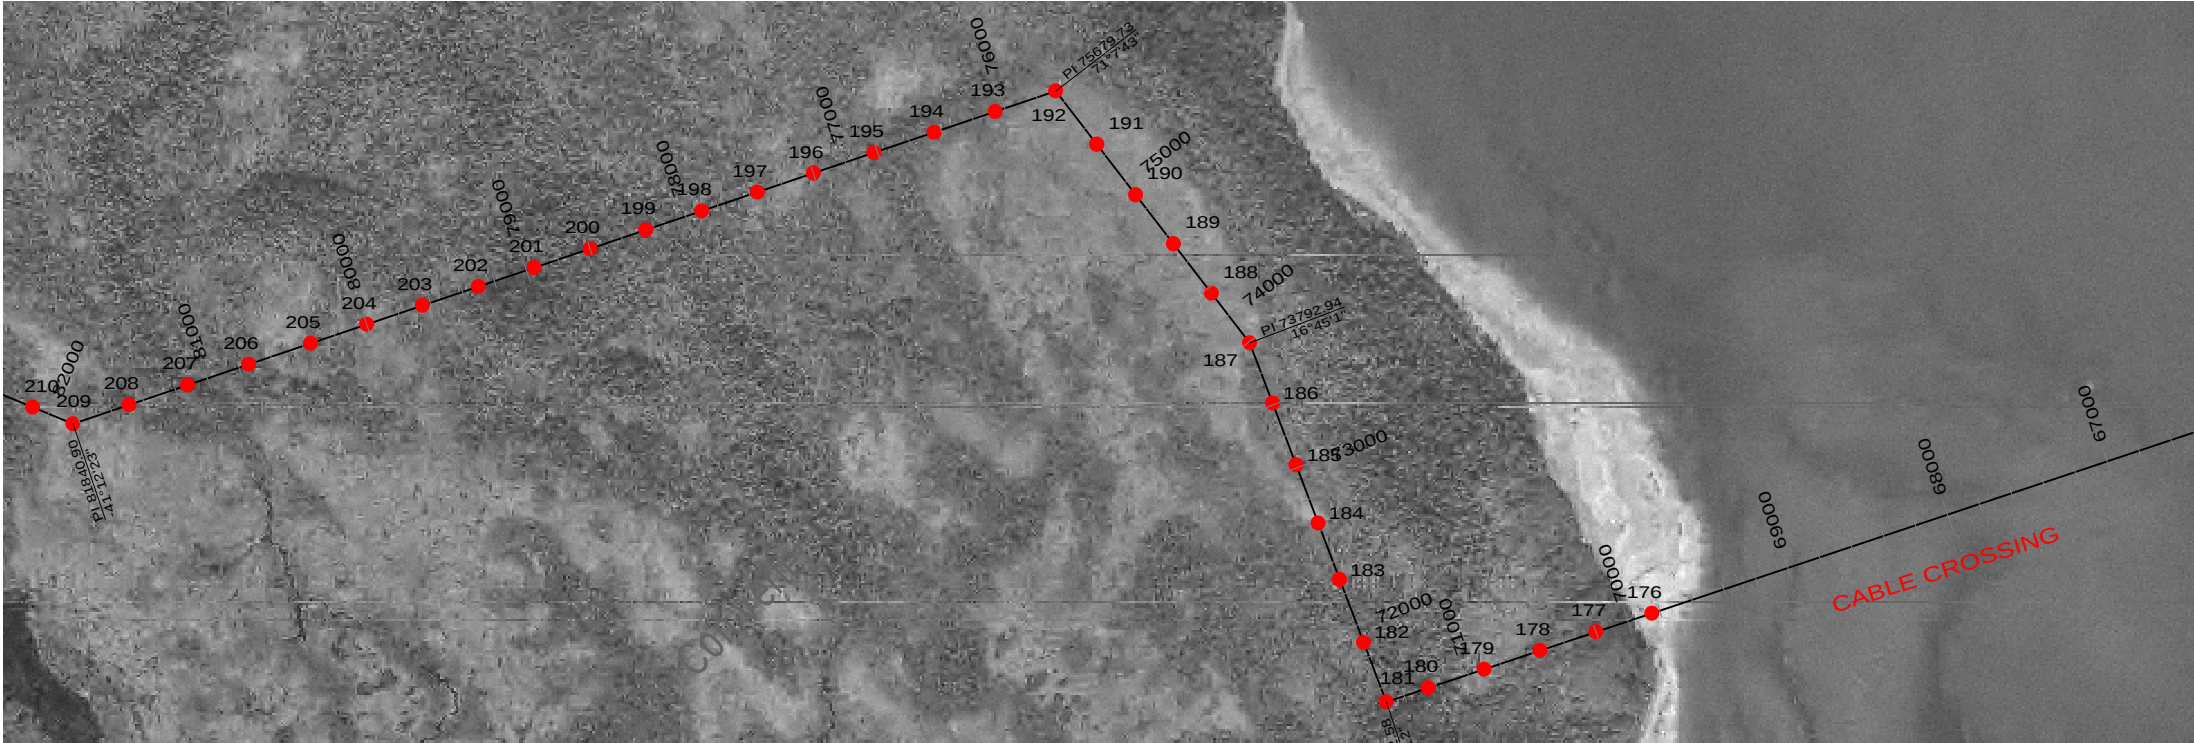


- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.


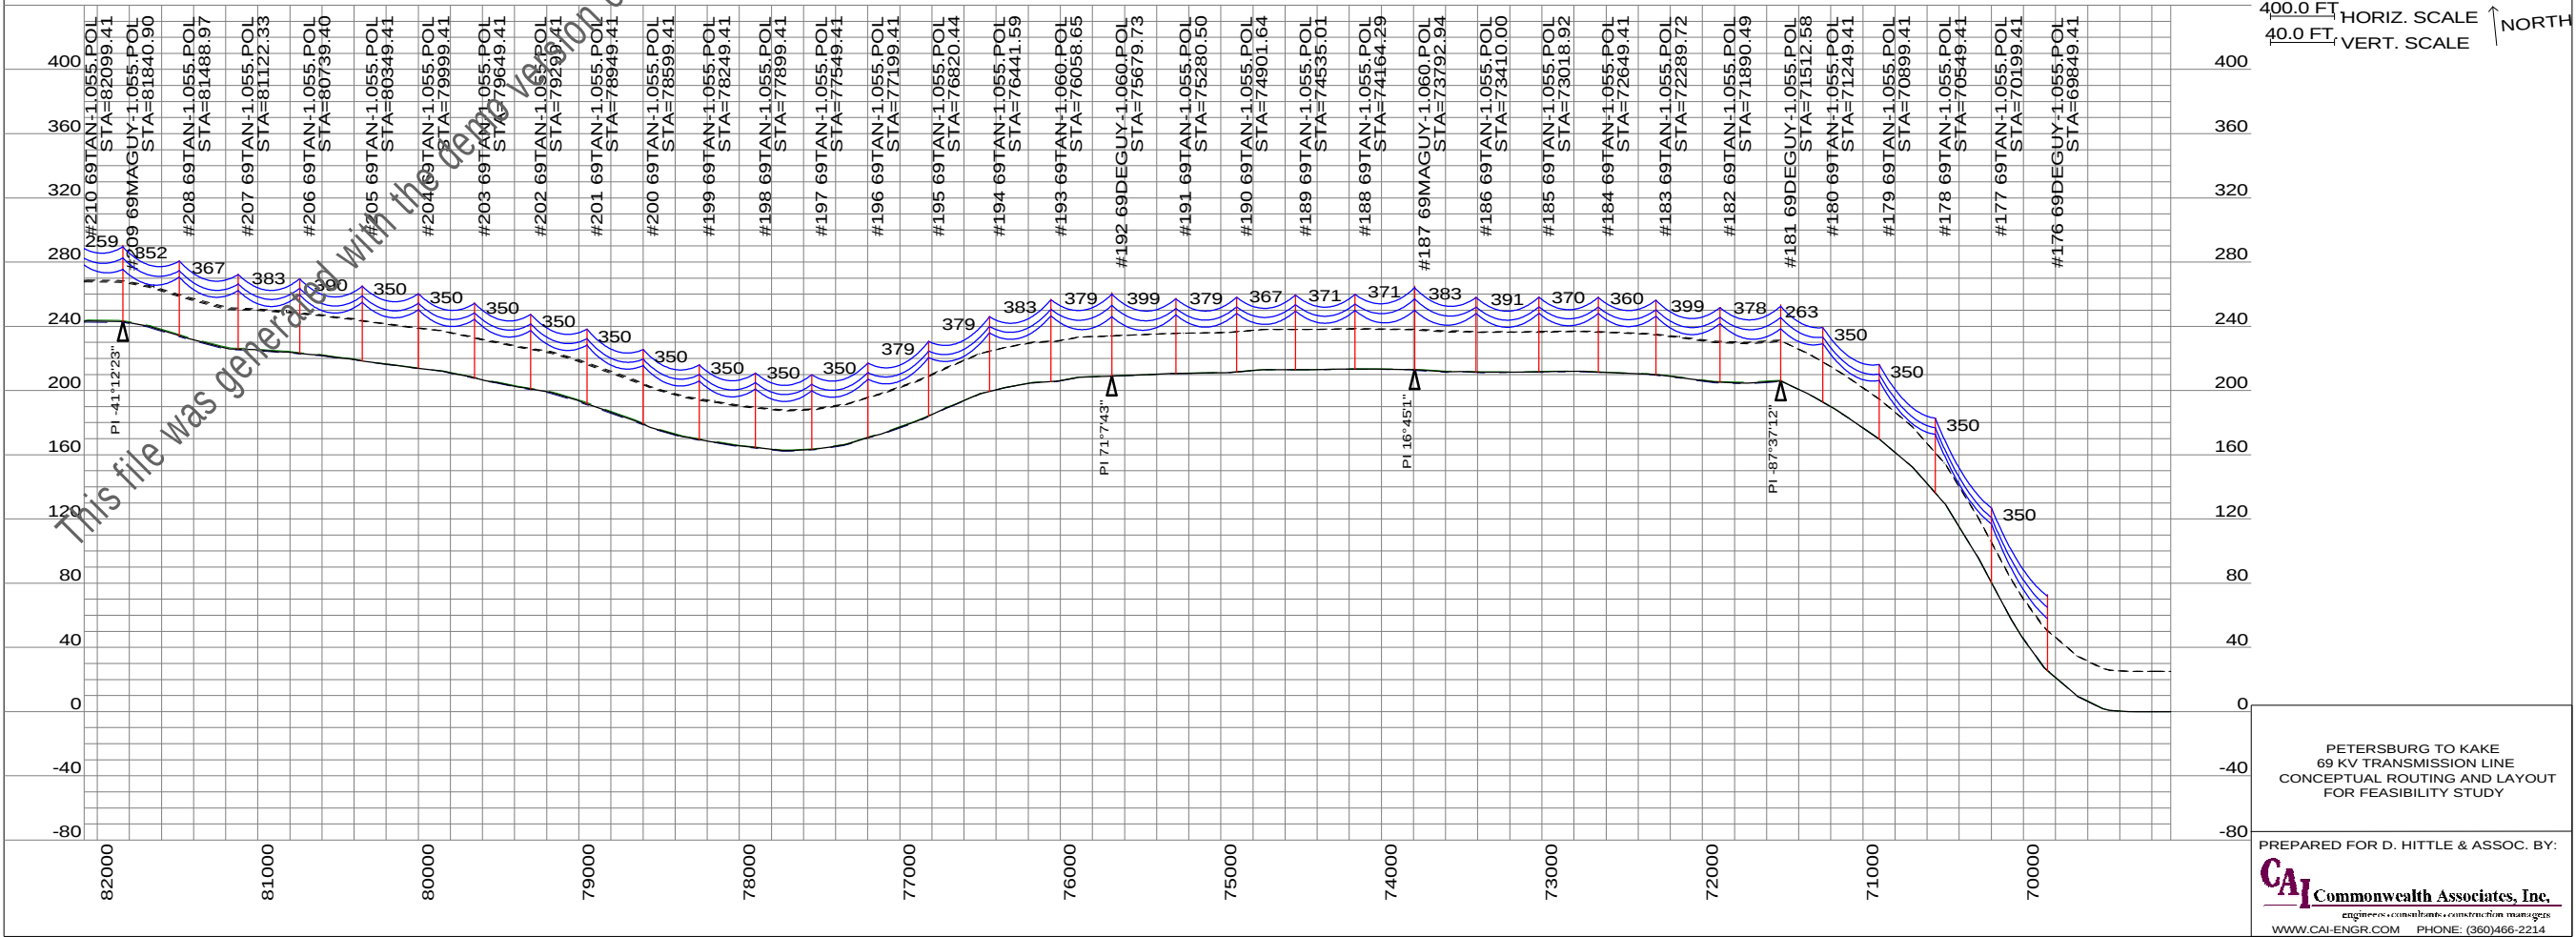


GENERAL NOTES:

1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
2. DASHED LINE IN PROFILE DENOTES 25" CLEARANCE LINE.

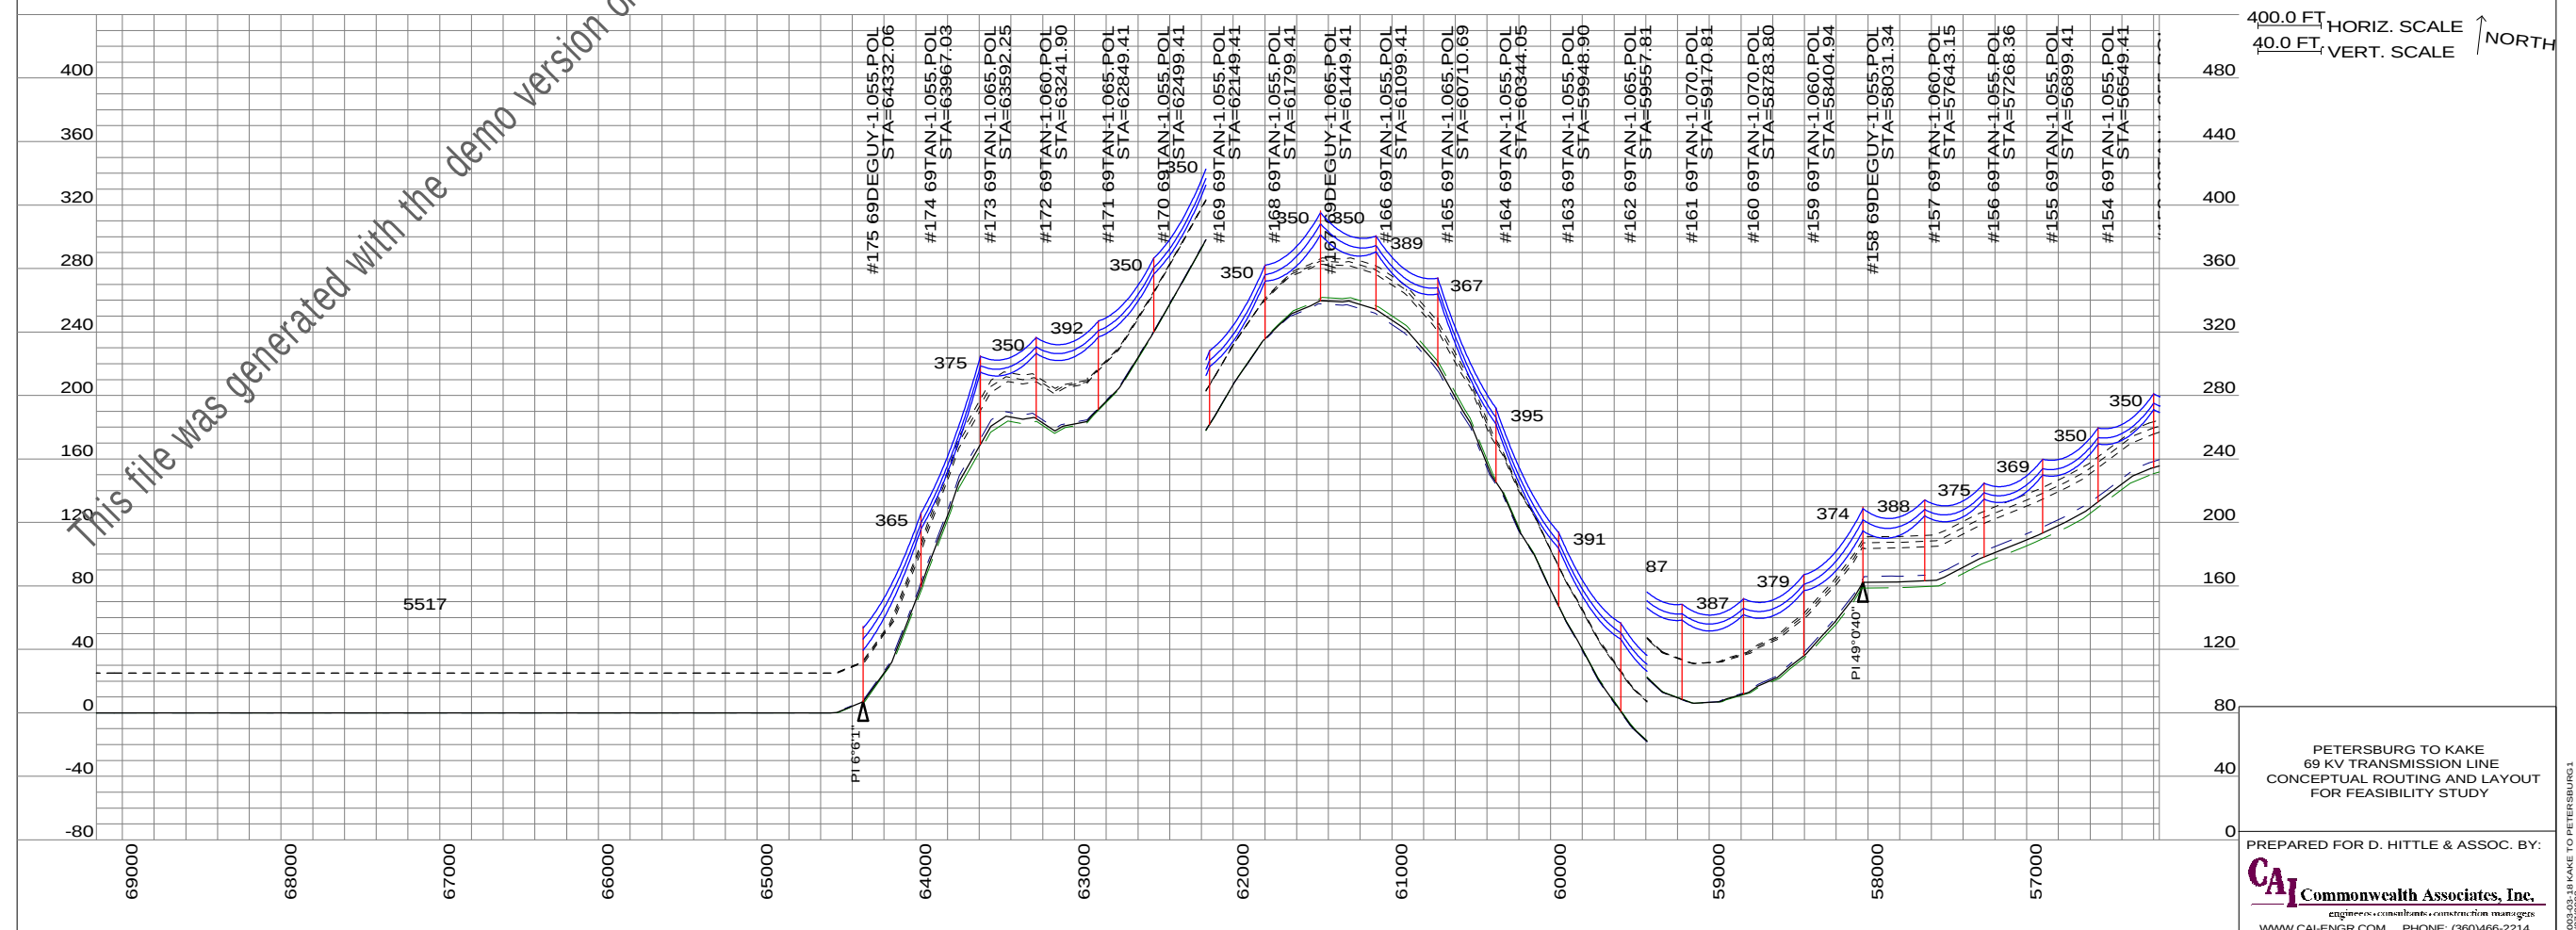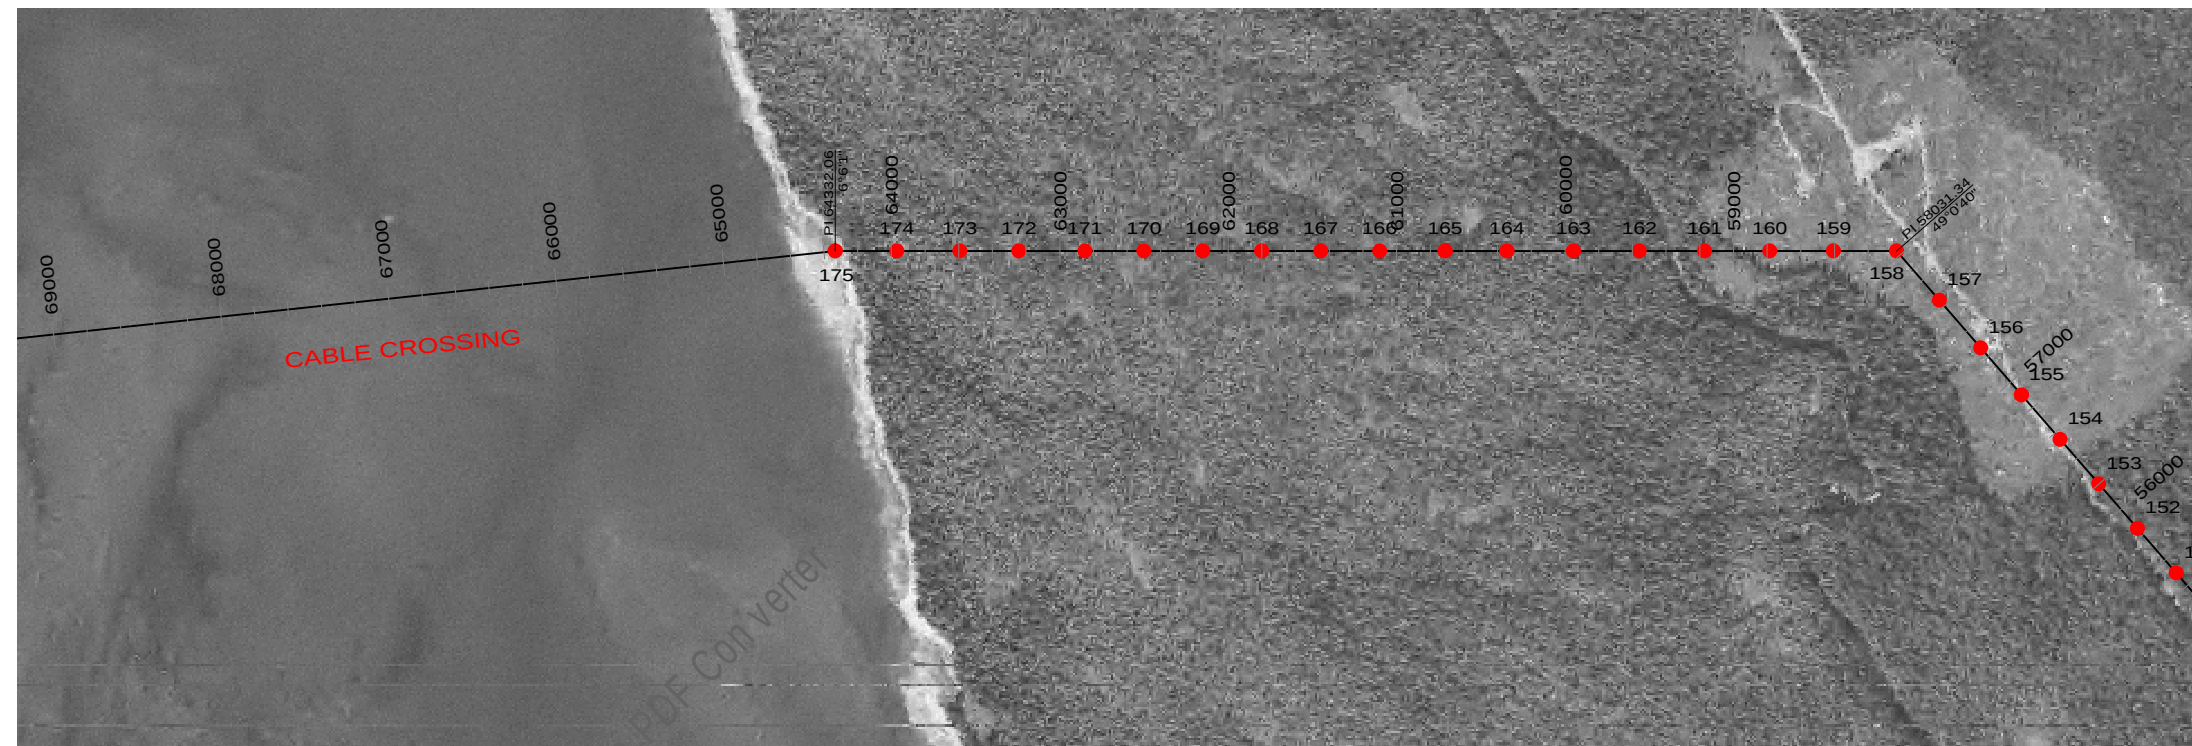

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

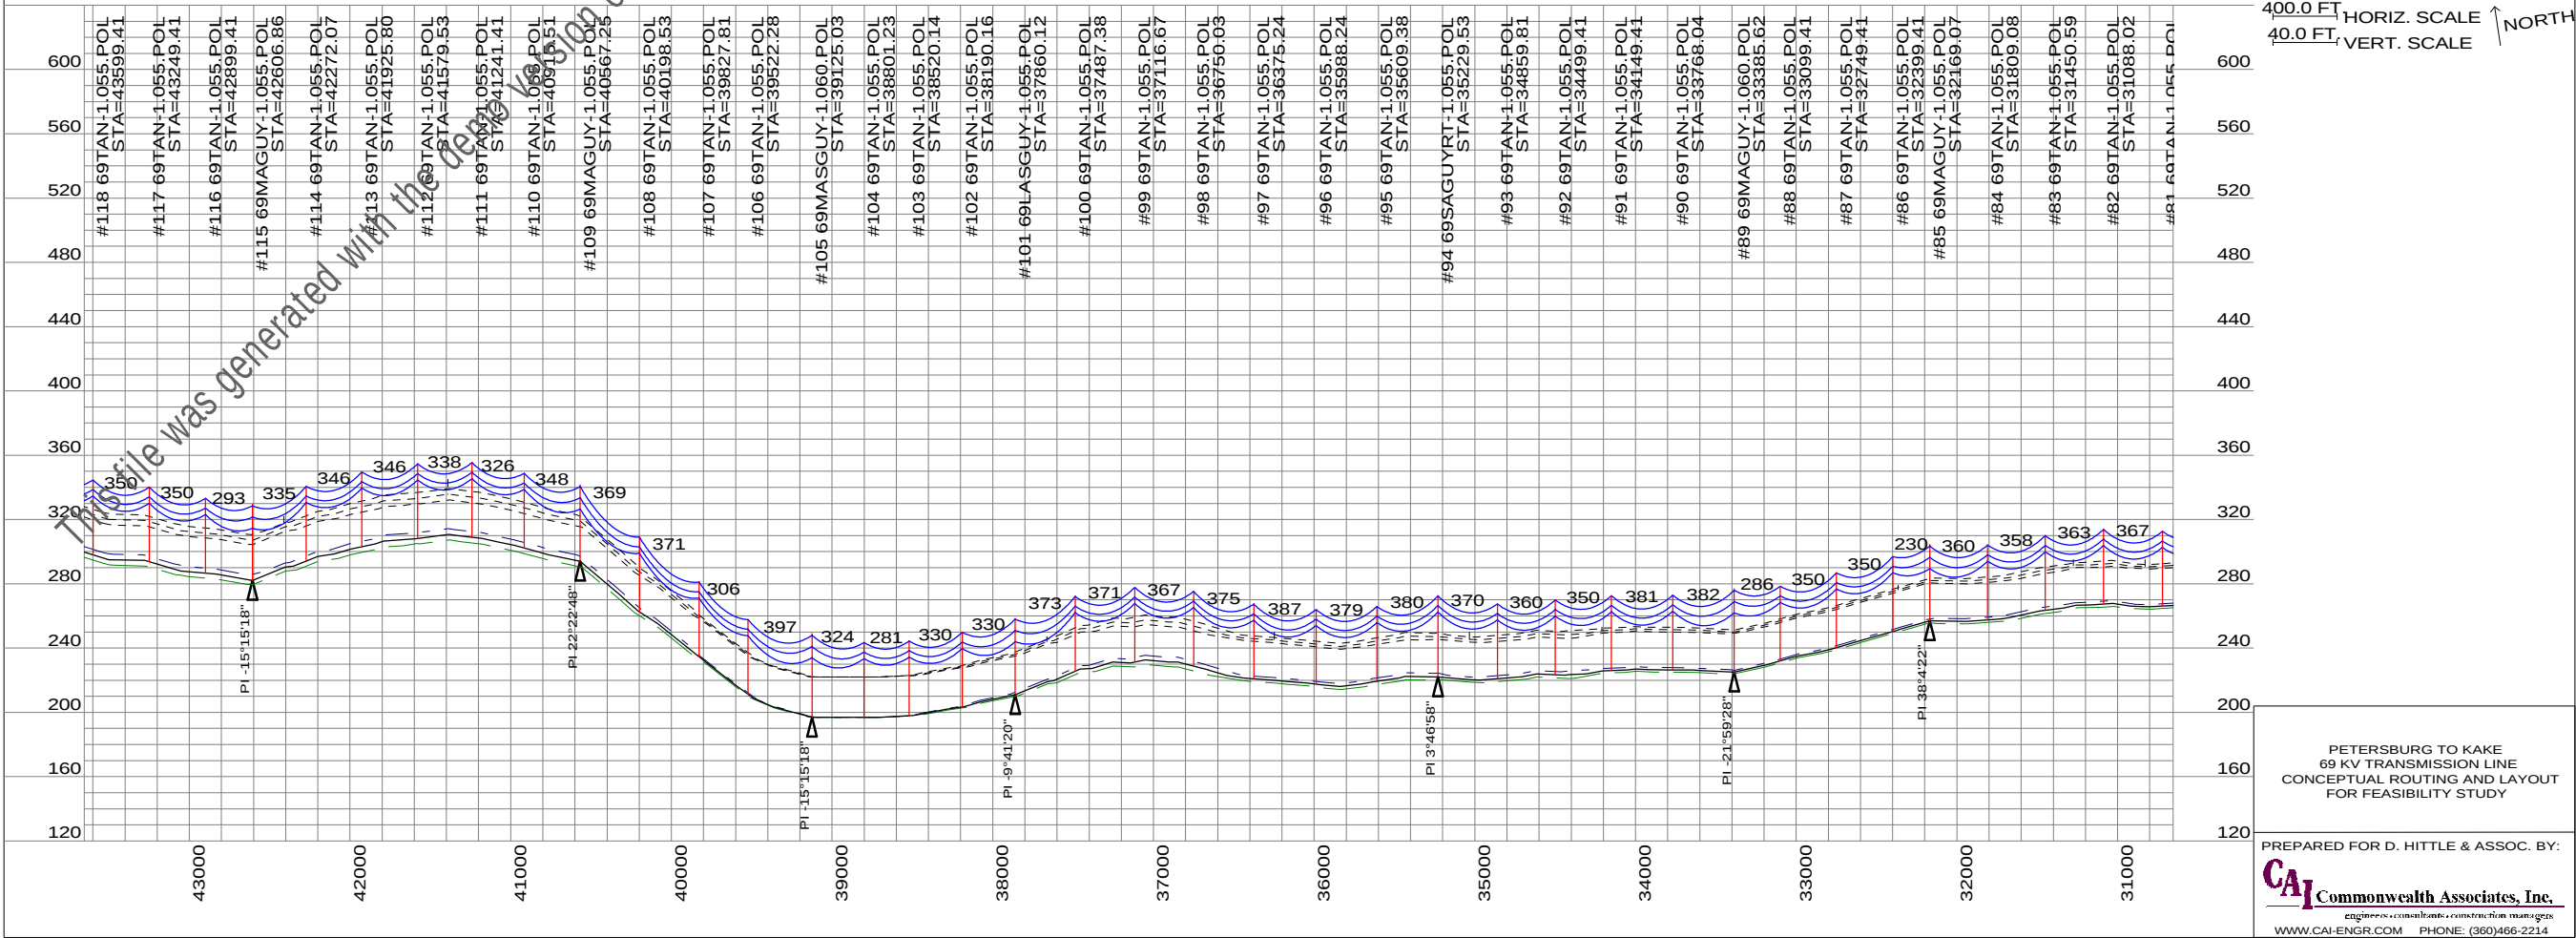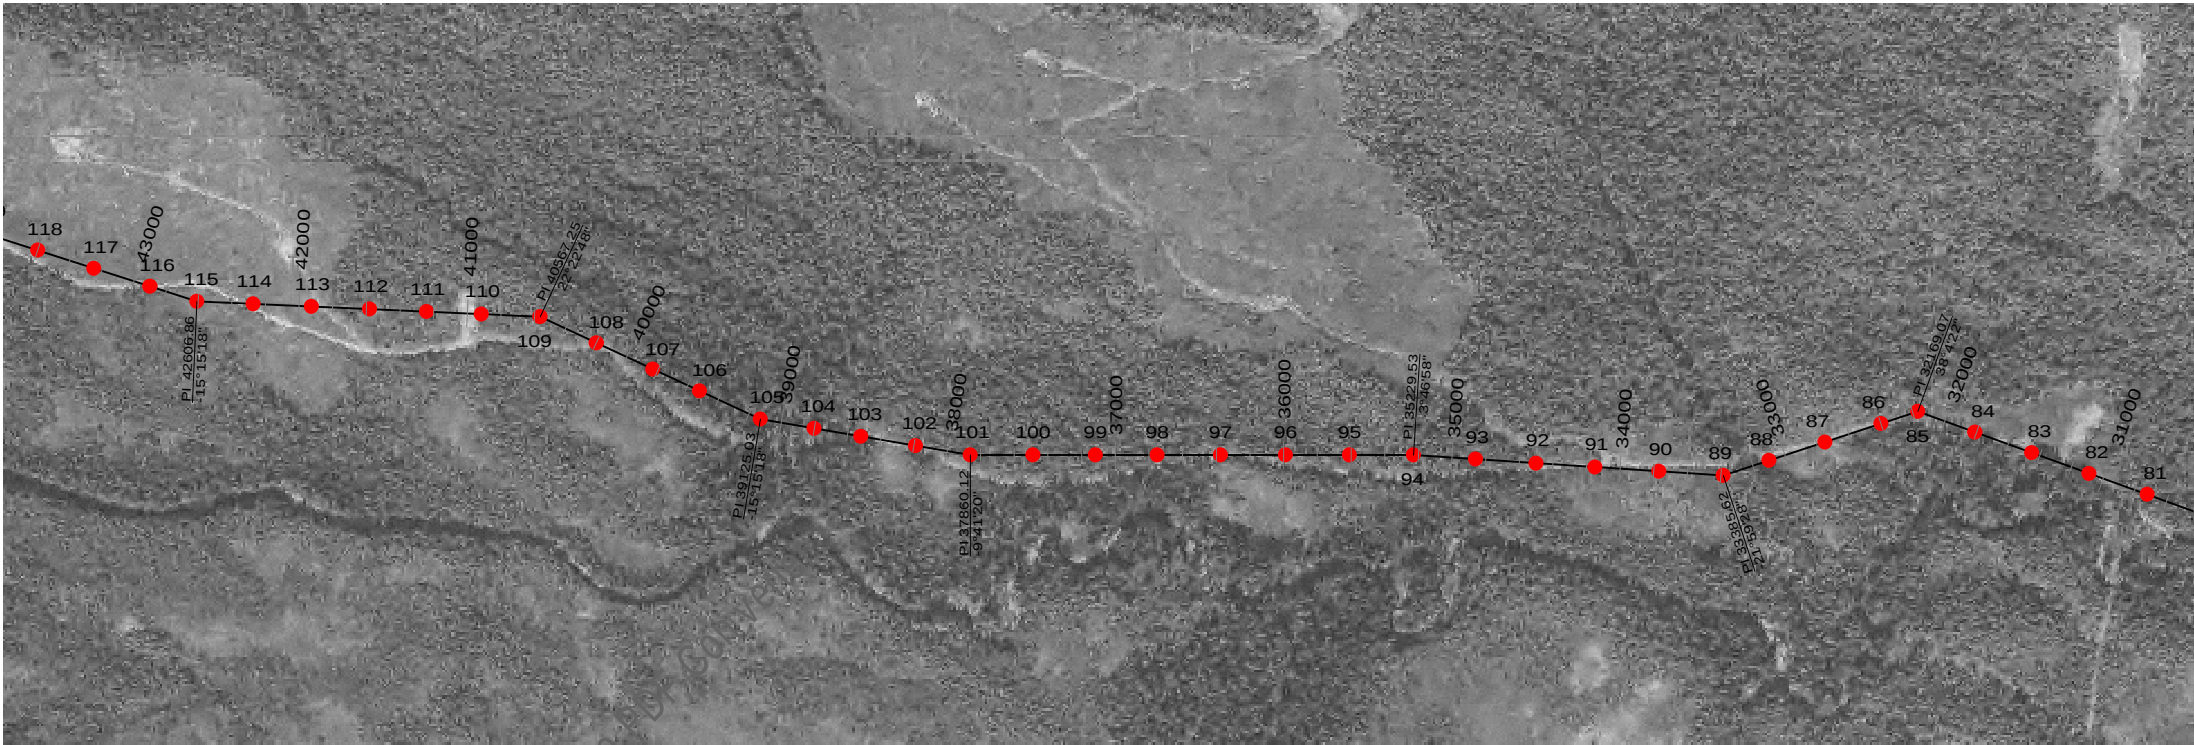


PETERSBURG TO KAKE
69 KV TRANSMISSION LINE
CONCEPTUAL ROUTING AND LAYOUT
FOR FEASIBILITY STUDY


PREPARED FOR D. HITTLE & ASSOC. BY:


CAI Commonwealth Associates, Inc.
engineers • consultants • construction managers
WWW.CAI-ENGR.COM PHONE: (360)466-2214

3/27/2023
PAGE 20/23

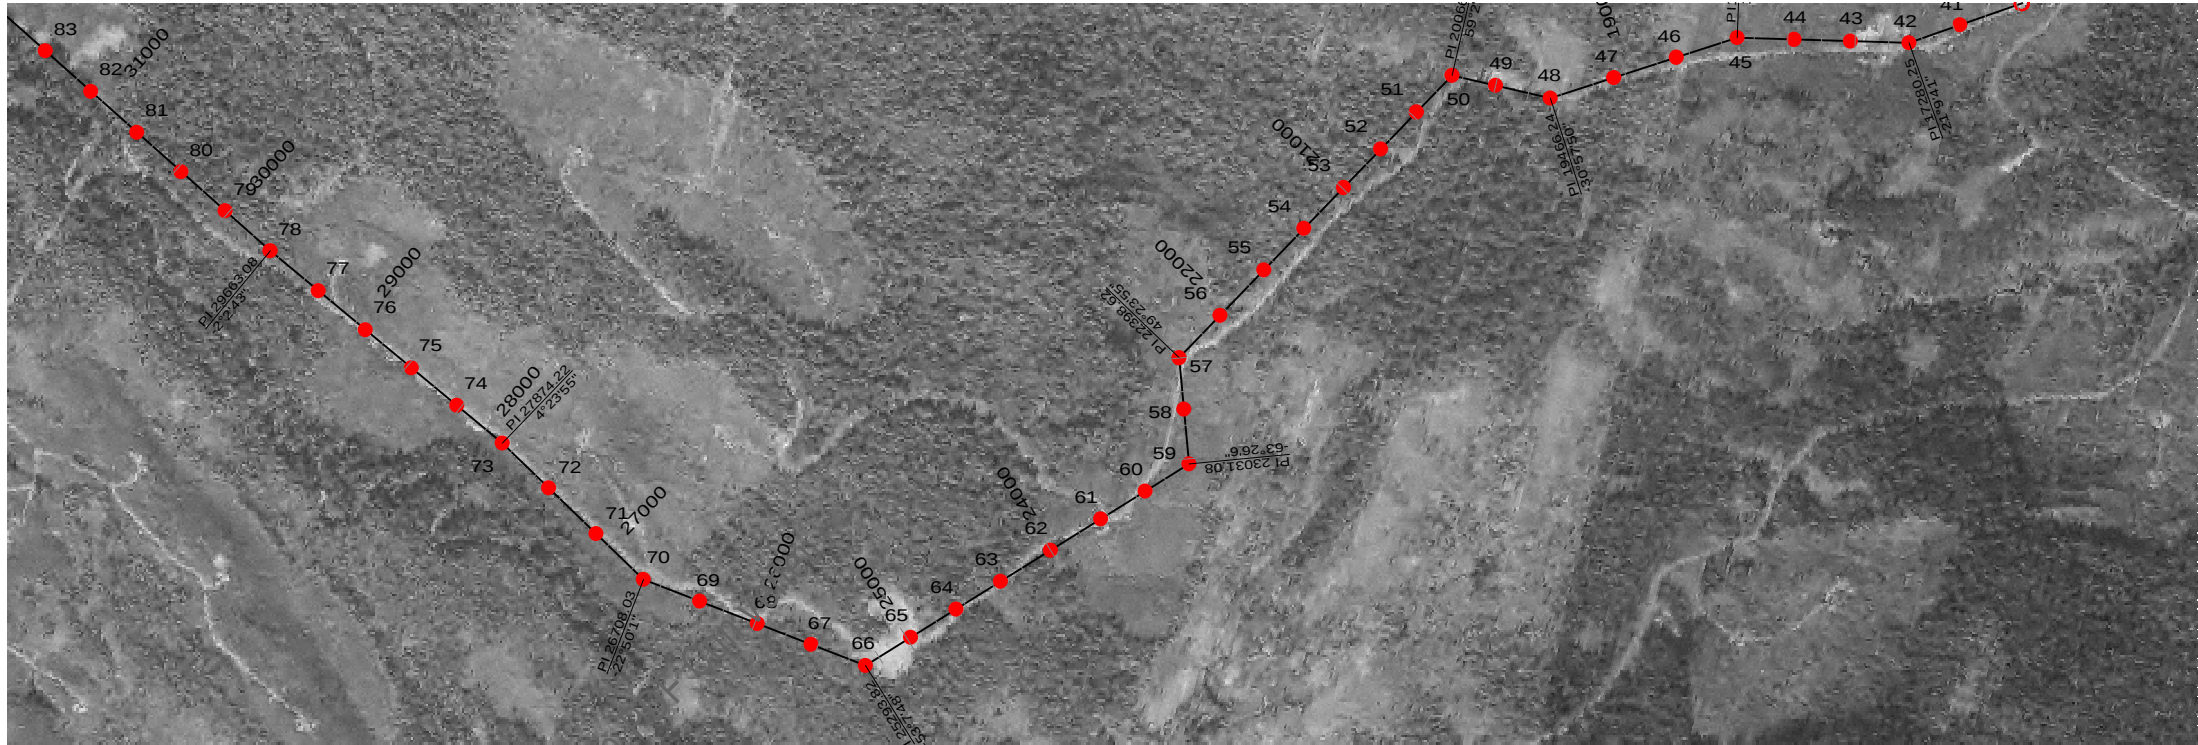


1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
2. DASHED LINE IN PROFILE DENOTES 25" CLEARANCE LINE.

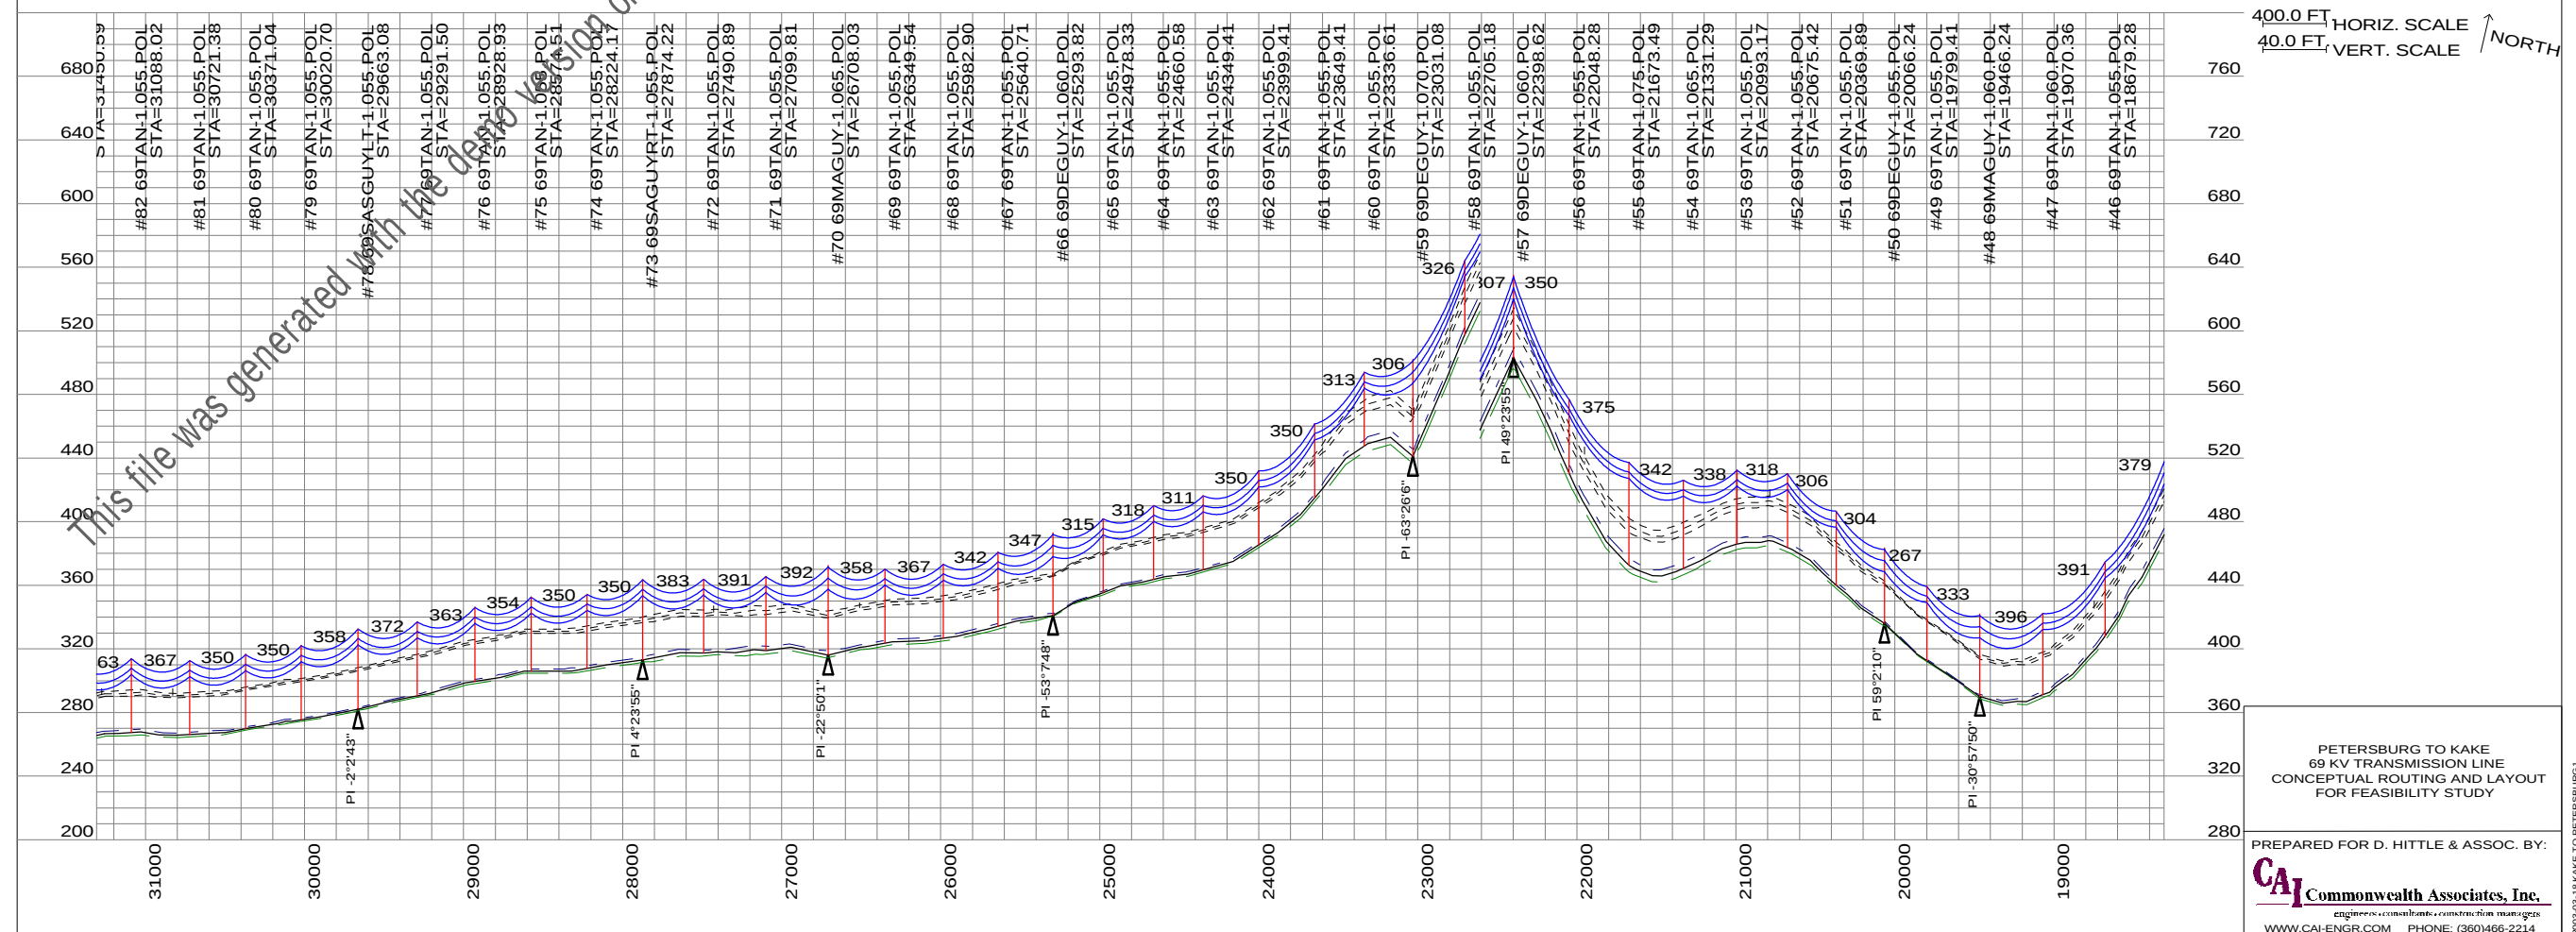

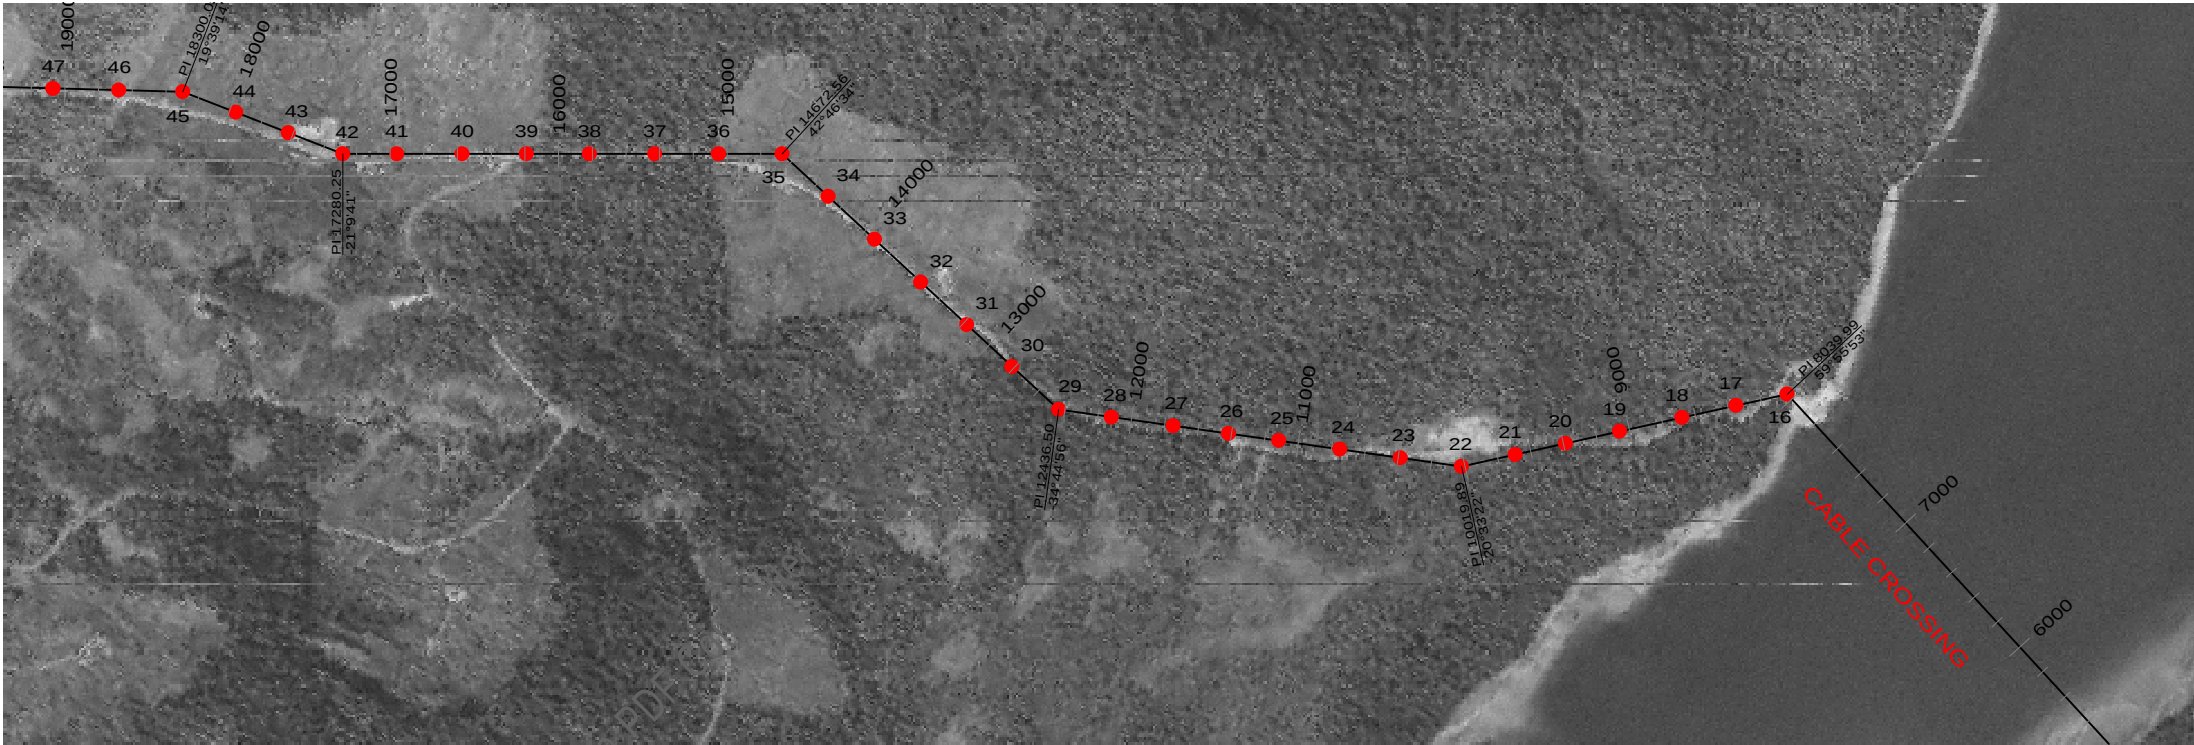

- GENERAL NOTES:
1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
 2. DASHED LINE IN PROFILE DENOTES 25' CLEARANCE LINE.

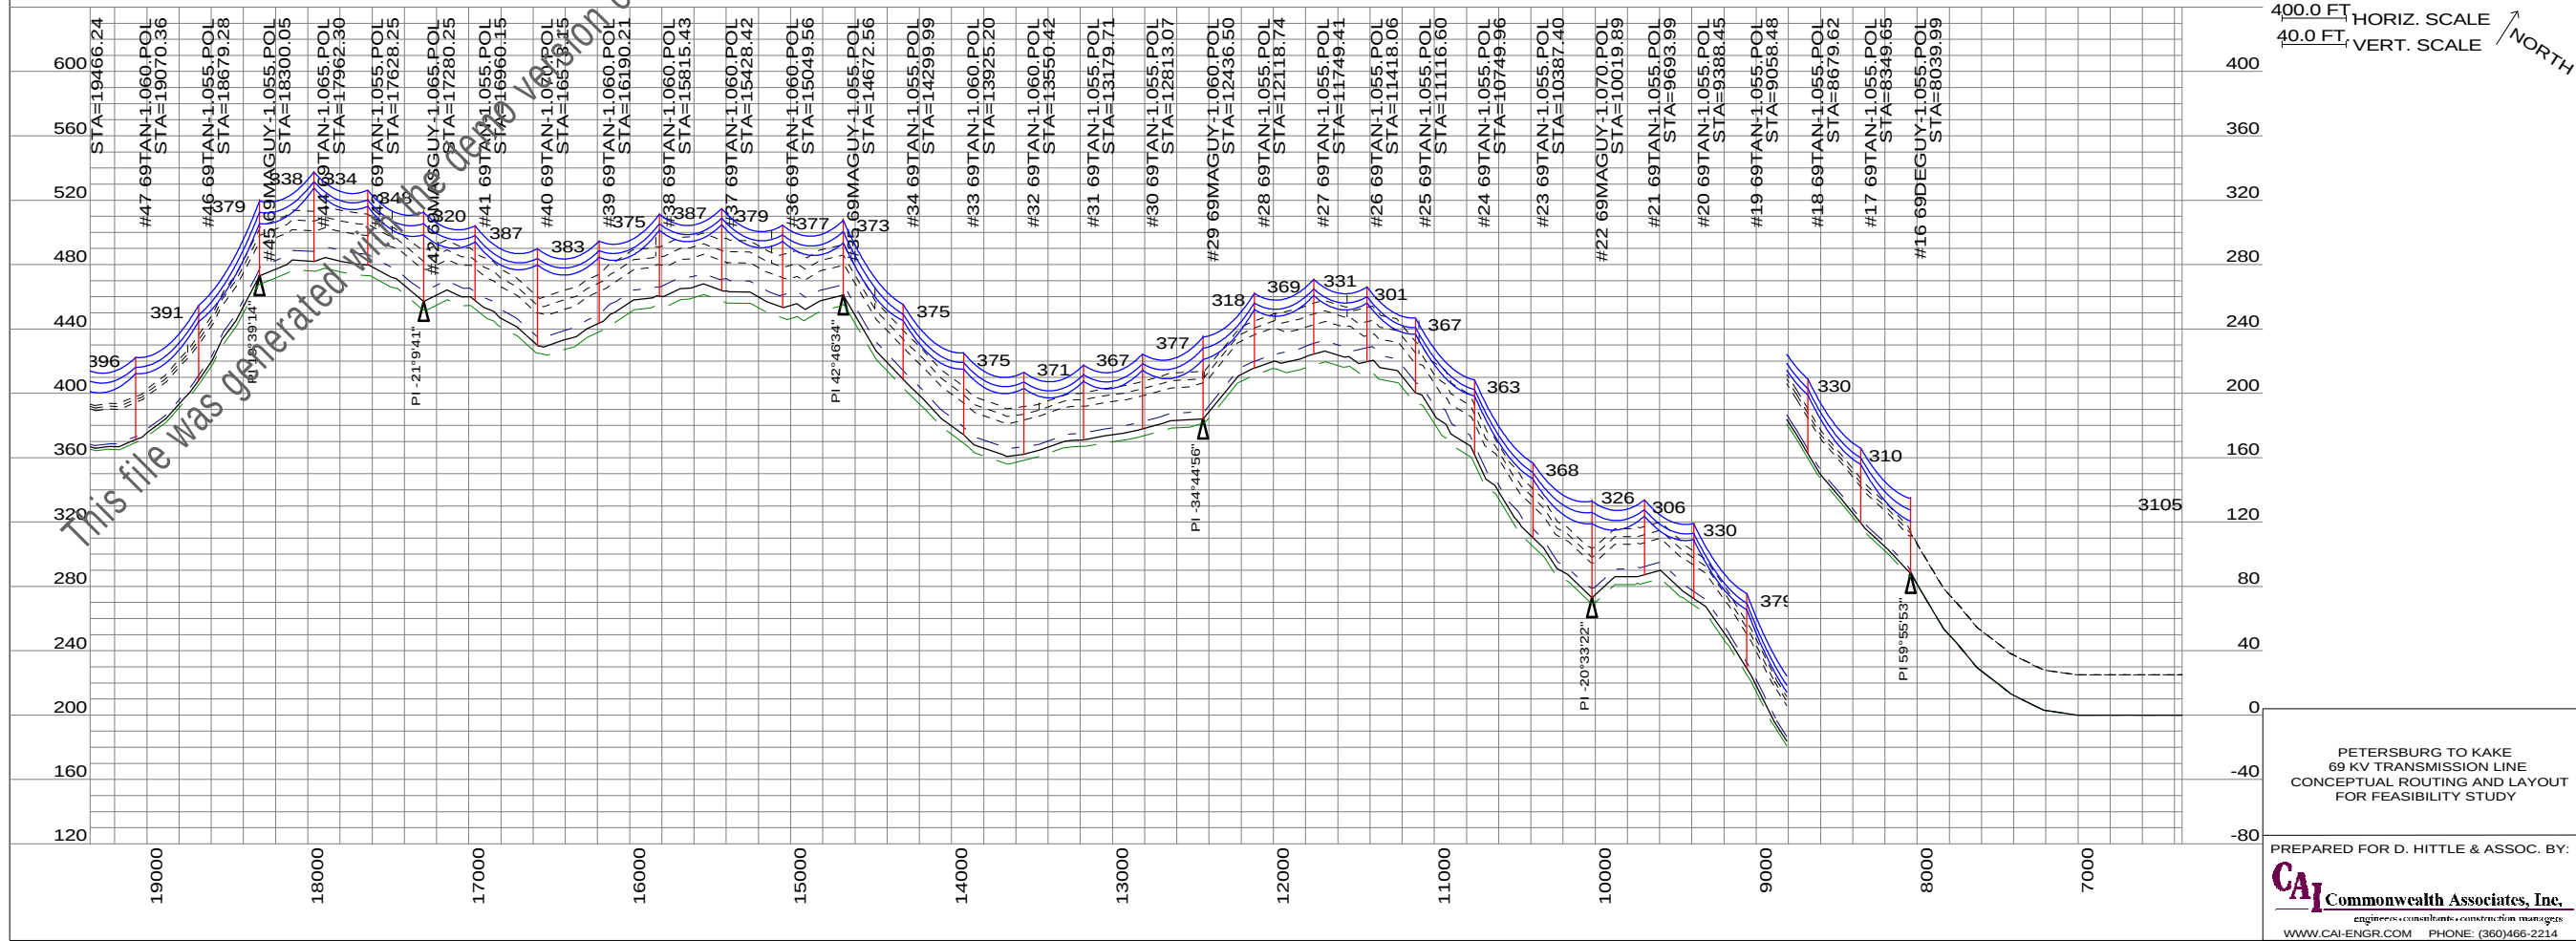



1. CONDUCTOR SHOWN AT 120 DEG F FINAL.
2. DASHED LINE IN PROFILE DENOTES 25" CLEARANCE LINE.

