


Existing & Proposed Minimum Instream Flow Requirements

Hydrologic Index


Cumulative inflow to Lake Pillsbury (Acre Feet) as of						
	1/1	2/1	3/1	4/1	5/1	6/1
Normal	≥8,000	≥39,200	≥65,700	≥114,500	≥145,600	≥160,000
Dry	<8,000	<39,200	<65,700	<114,500	<145,600	<160,000
Critical	<4,000	<20,000	<45,000	<50,000	<70,000	<75,000
Water Supply Conditions Prevailing on 6/1 Apply Through 12/31						

LEGEND
All flows are minimums, expressed in cubic feet per second.
USGS Stream Gage

Upper Russian River Flows

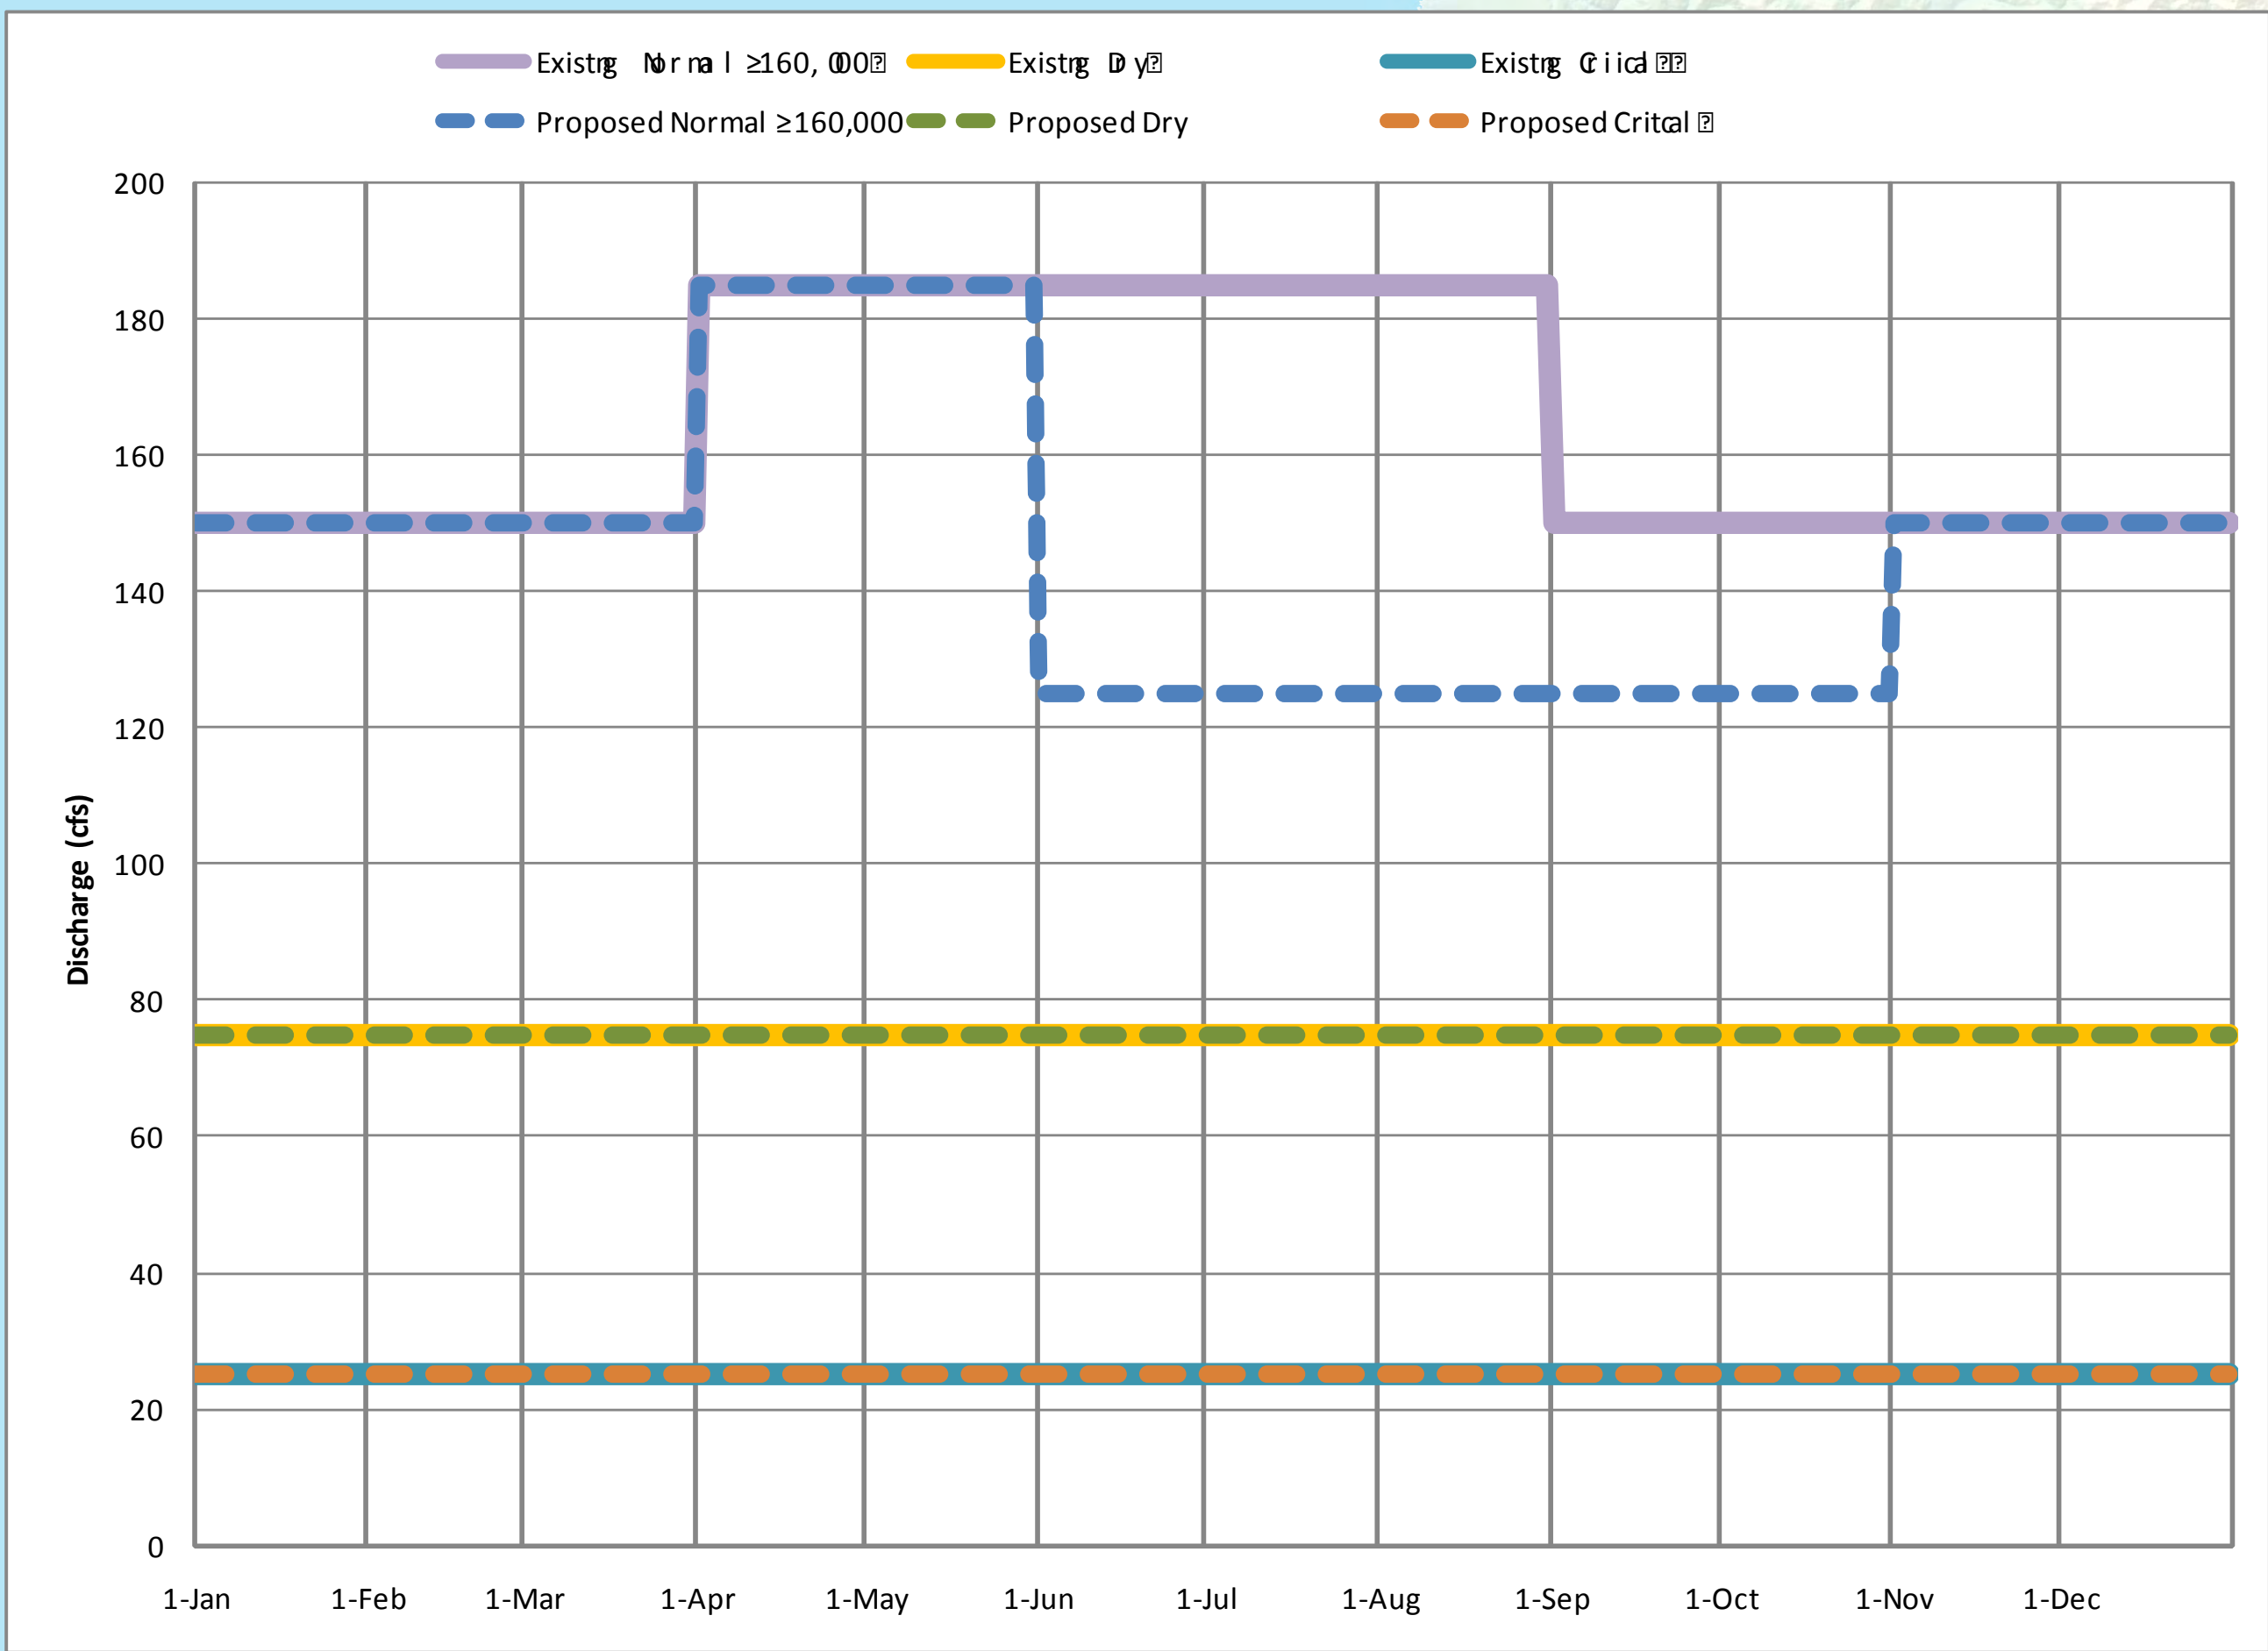

Dry Creek Flows

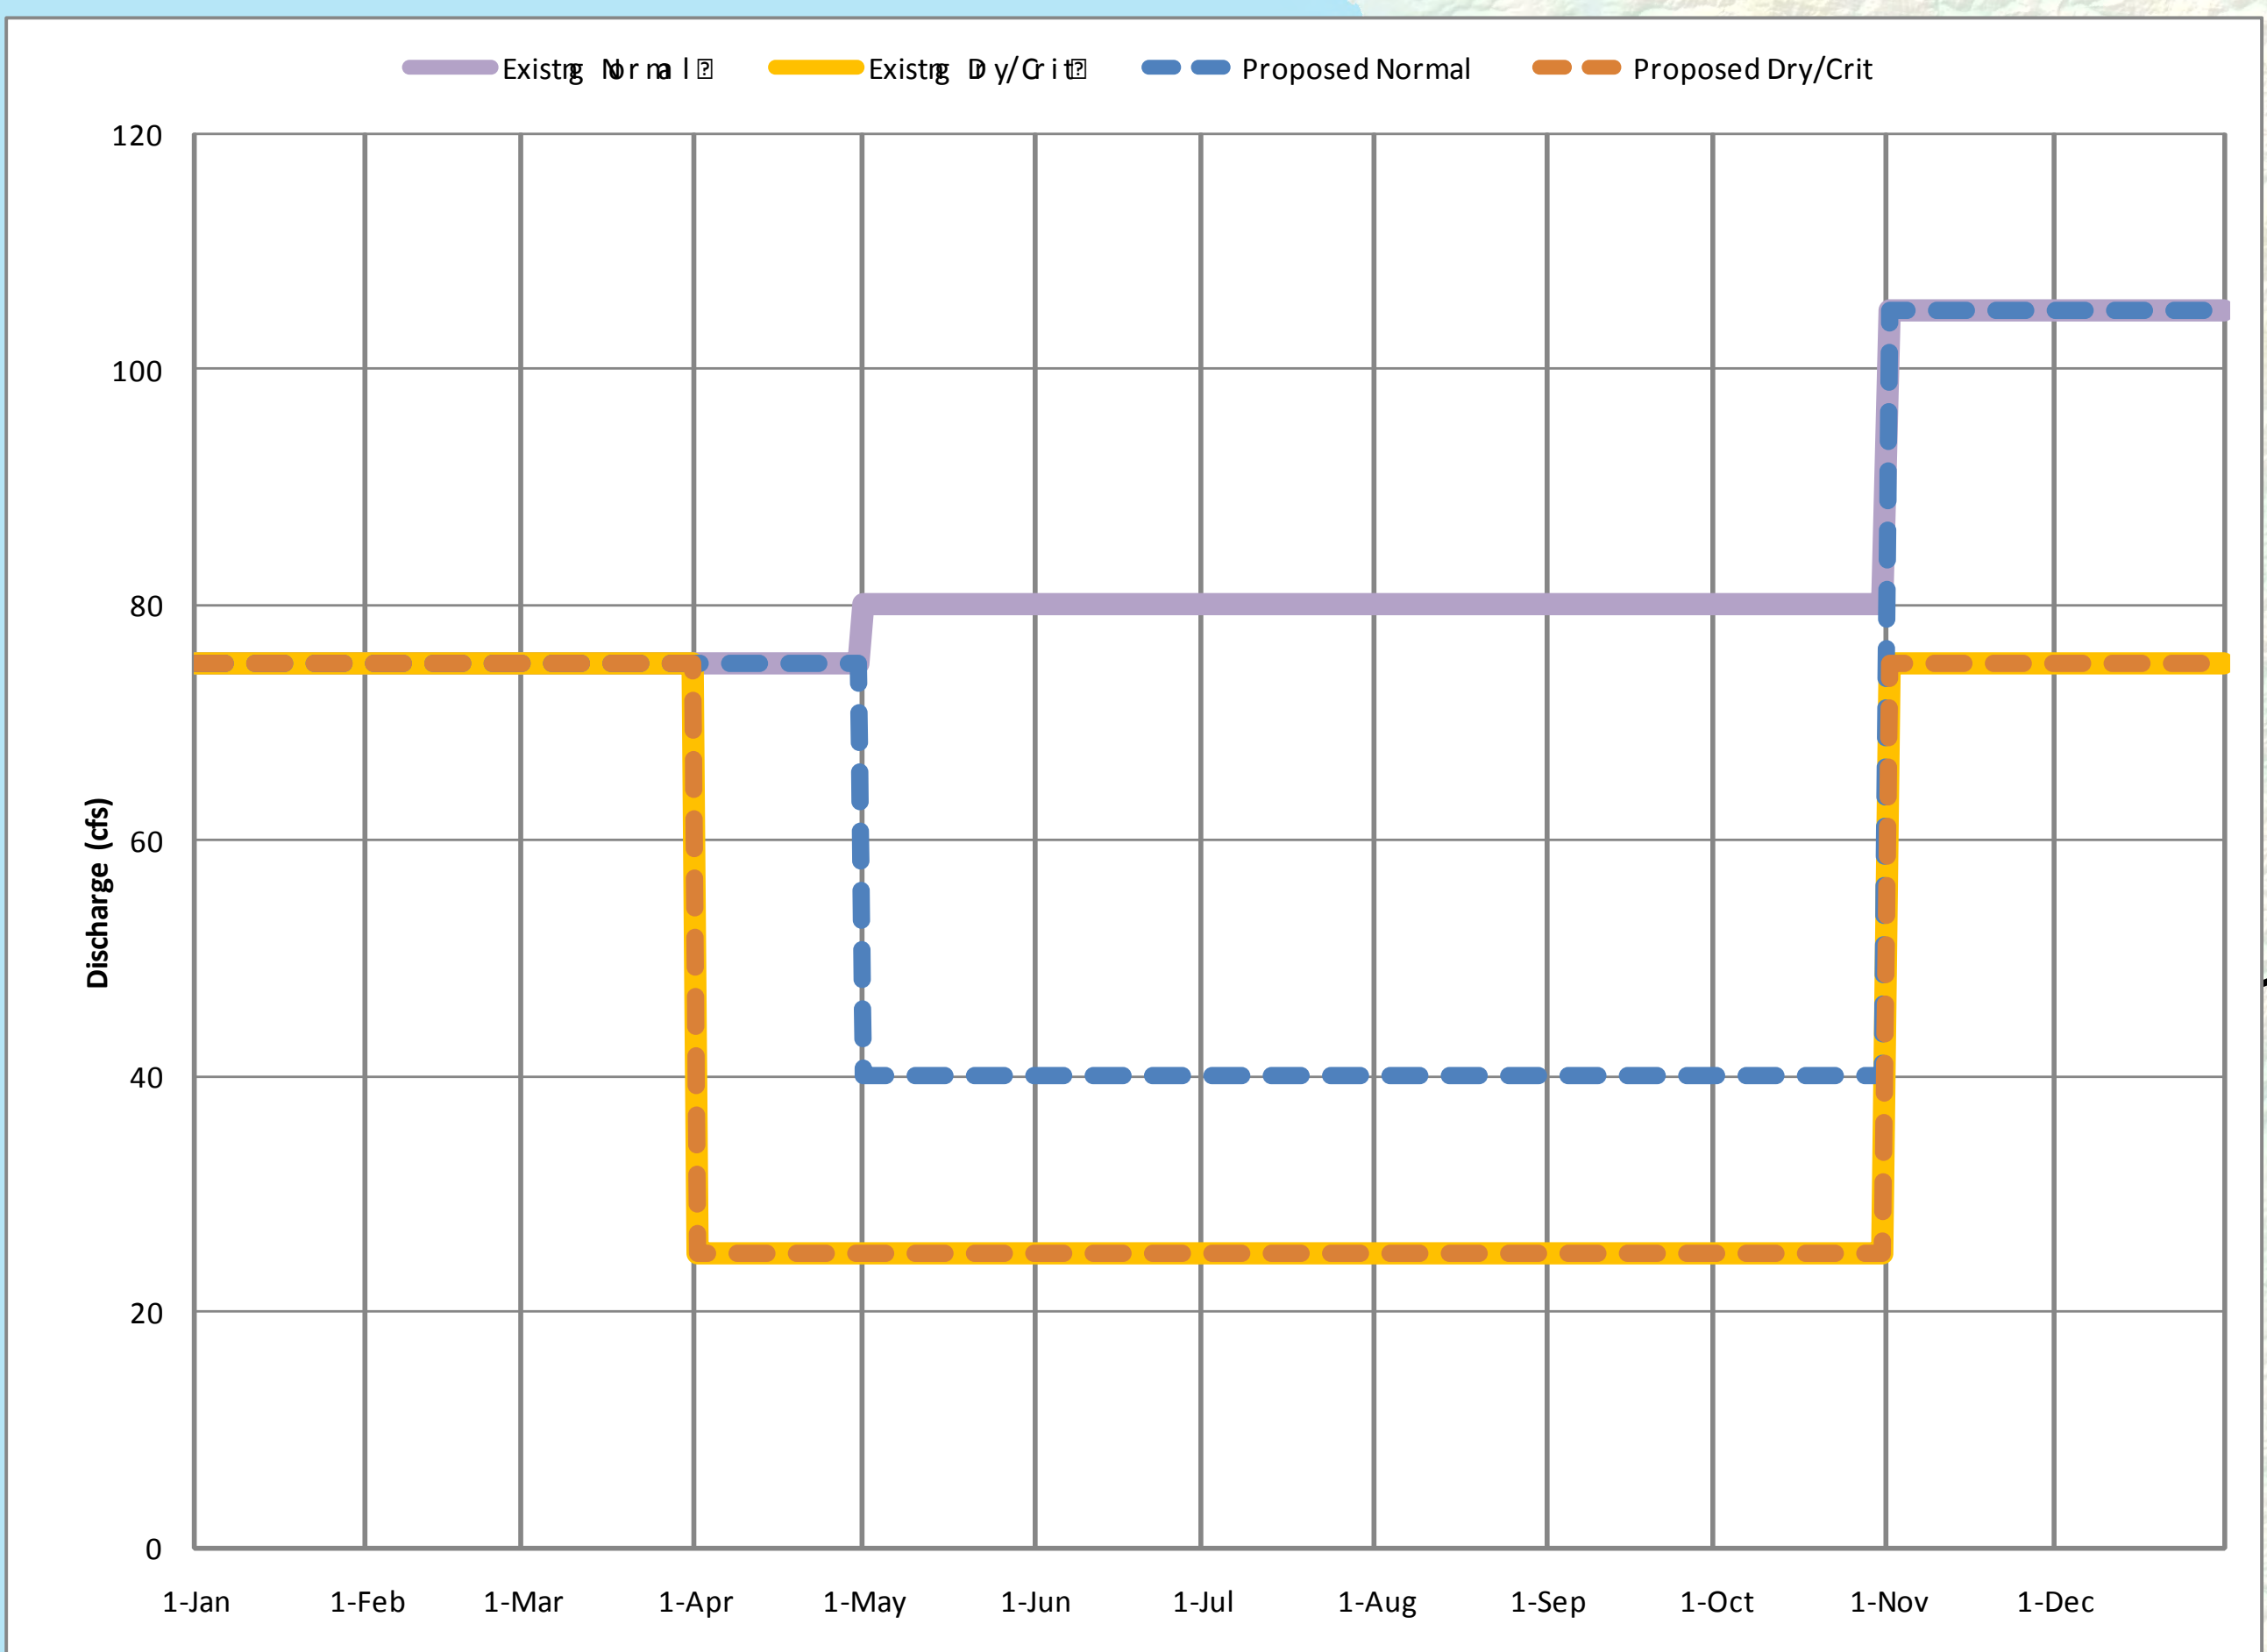

Lower Russian River Flows

